
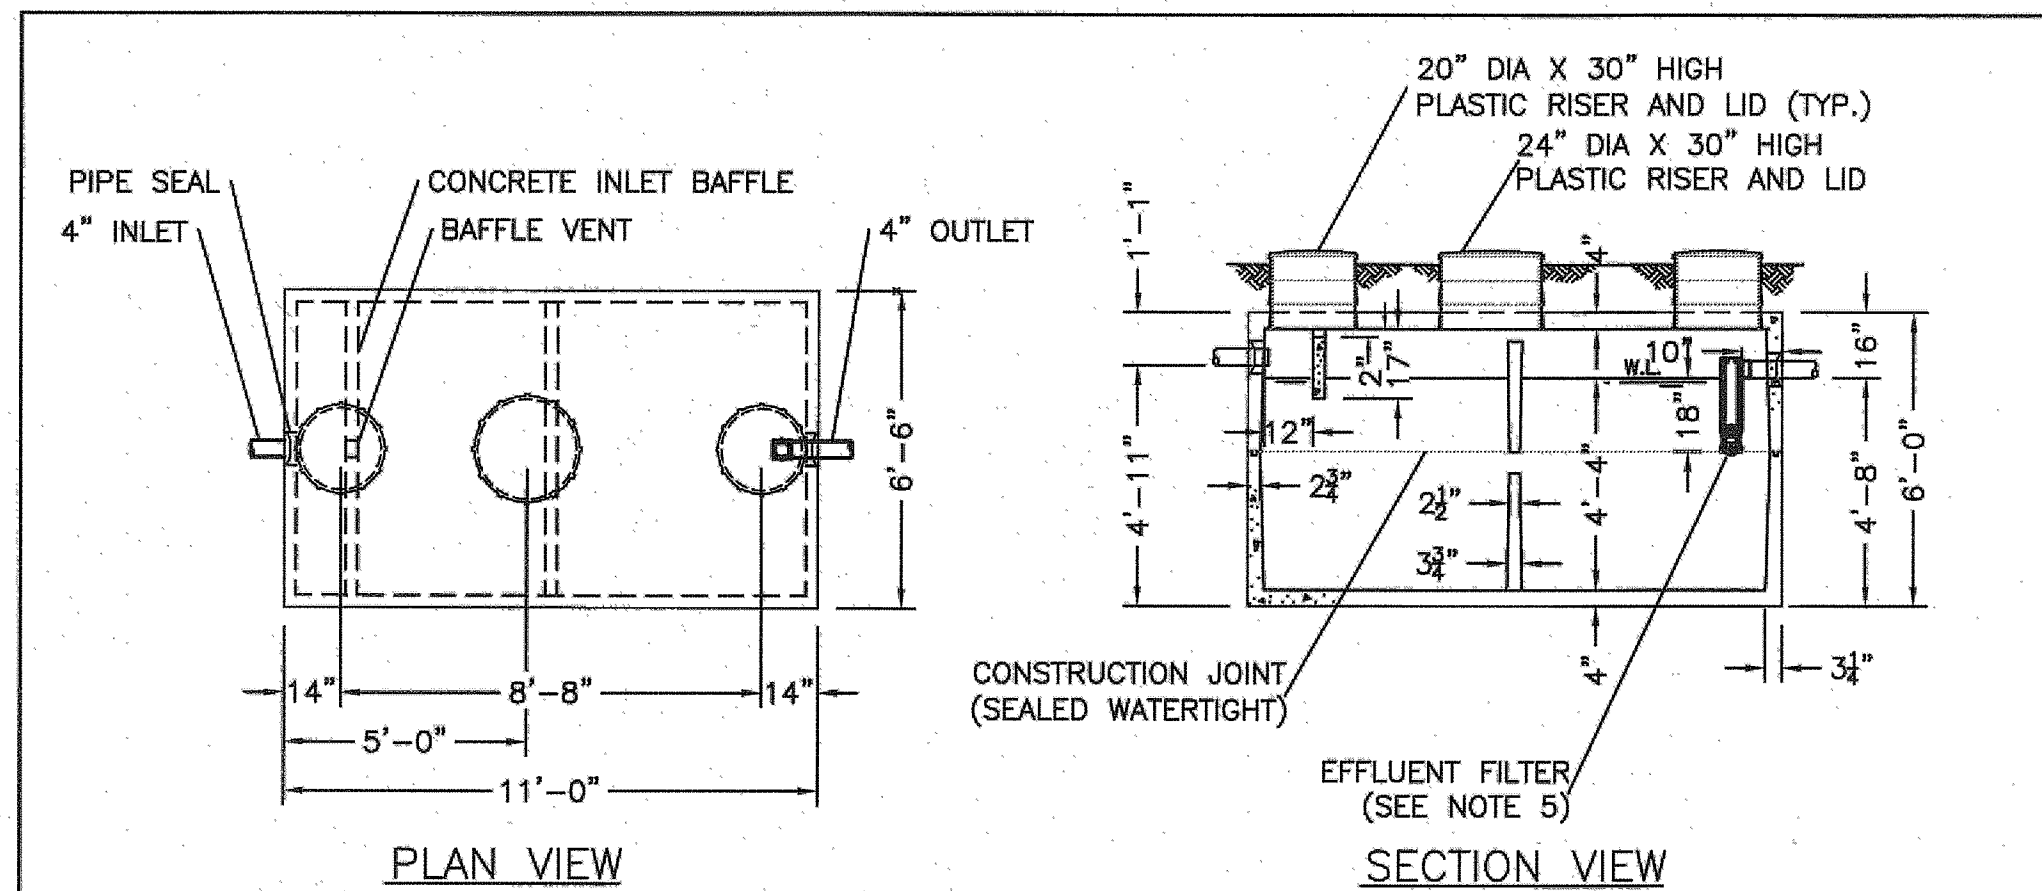


MOUND SAND FILL MUST MEET THE REQUIREMENTS OF FIGURE 5 (WISCONSIN MOUND SOIL ABSORPTION SYSTEM: SITTING, DESIGN AND CONSTRUCTION MANUAL) WHICH IS INCLUDED IN THE DESIGN PACKET. MOUND SAND LOADING RATE SHALL NOT EXCEED 1.0 GAL/DAY/SF. (PER MANUAL RECOMMENDATIONS)

MOUND CALCULATIONS	
NUMBER OF BEDROOMS	3
BASE FLOW RATE (GPD)	360
DIVERSITY FACTOR	-
DESIGN FLOW RATE (GPD)	360
EFFECTIVE MOUND LENGTH	103.00'
OVERALL MOUND LENGTH	115.00'
DESIGN LINEAR LOADING RATE (GPD/LF)	3.50
DESIGN SAND LOADING RATE (GPD/SF)	1.00
MAXIMUM ALLOWABLE BASAL LOADING RATE (GPD/SF)	0.40
ABSORPTION BED AREA (SF)	360.5


- NOTE: 1. THE ENTIRE MOUND SHALL HAVE A MINIMUM OF 6" OF SETTLED TOPSOIL, BUT THE CENTER SHALL BE CROWNED TO 6" MINIMUM TO PROMOTE RUNOFF.
2. ORIFICES SHALL BE PLACED UPWARD EXCEPT FOR THE FIRST AND LAST ONE IN EACH LATERAL. EACH LATERAL SHALL BE PLACED INSIDE A 4" PERFORATED PIPE IN ORDER TO PROVIDE ORIFICE SHIELDING. OTHER SHIELDING METHODS MAY BE USED IF APPROVED BY THE LAKE COUNTY HEALTH DEPARTMENT.

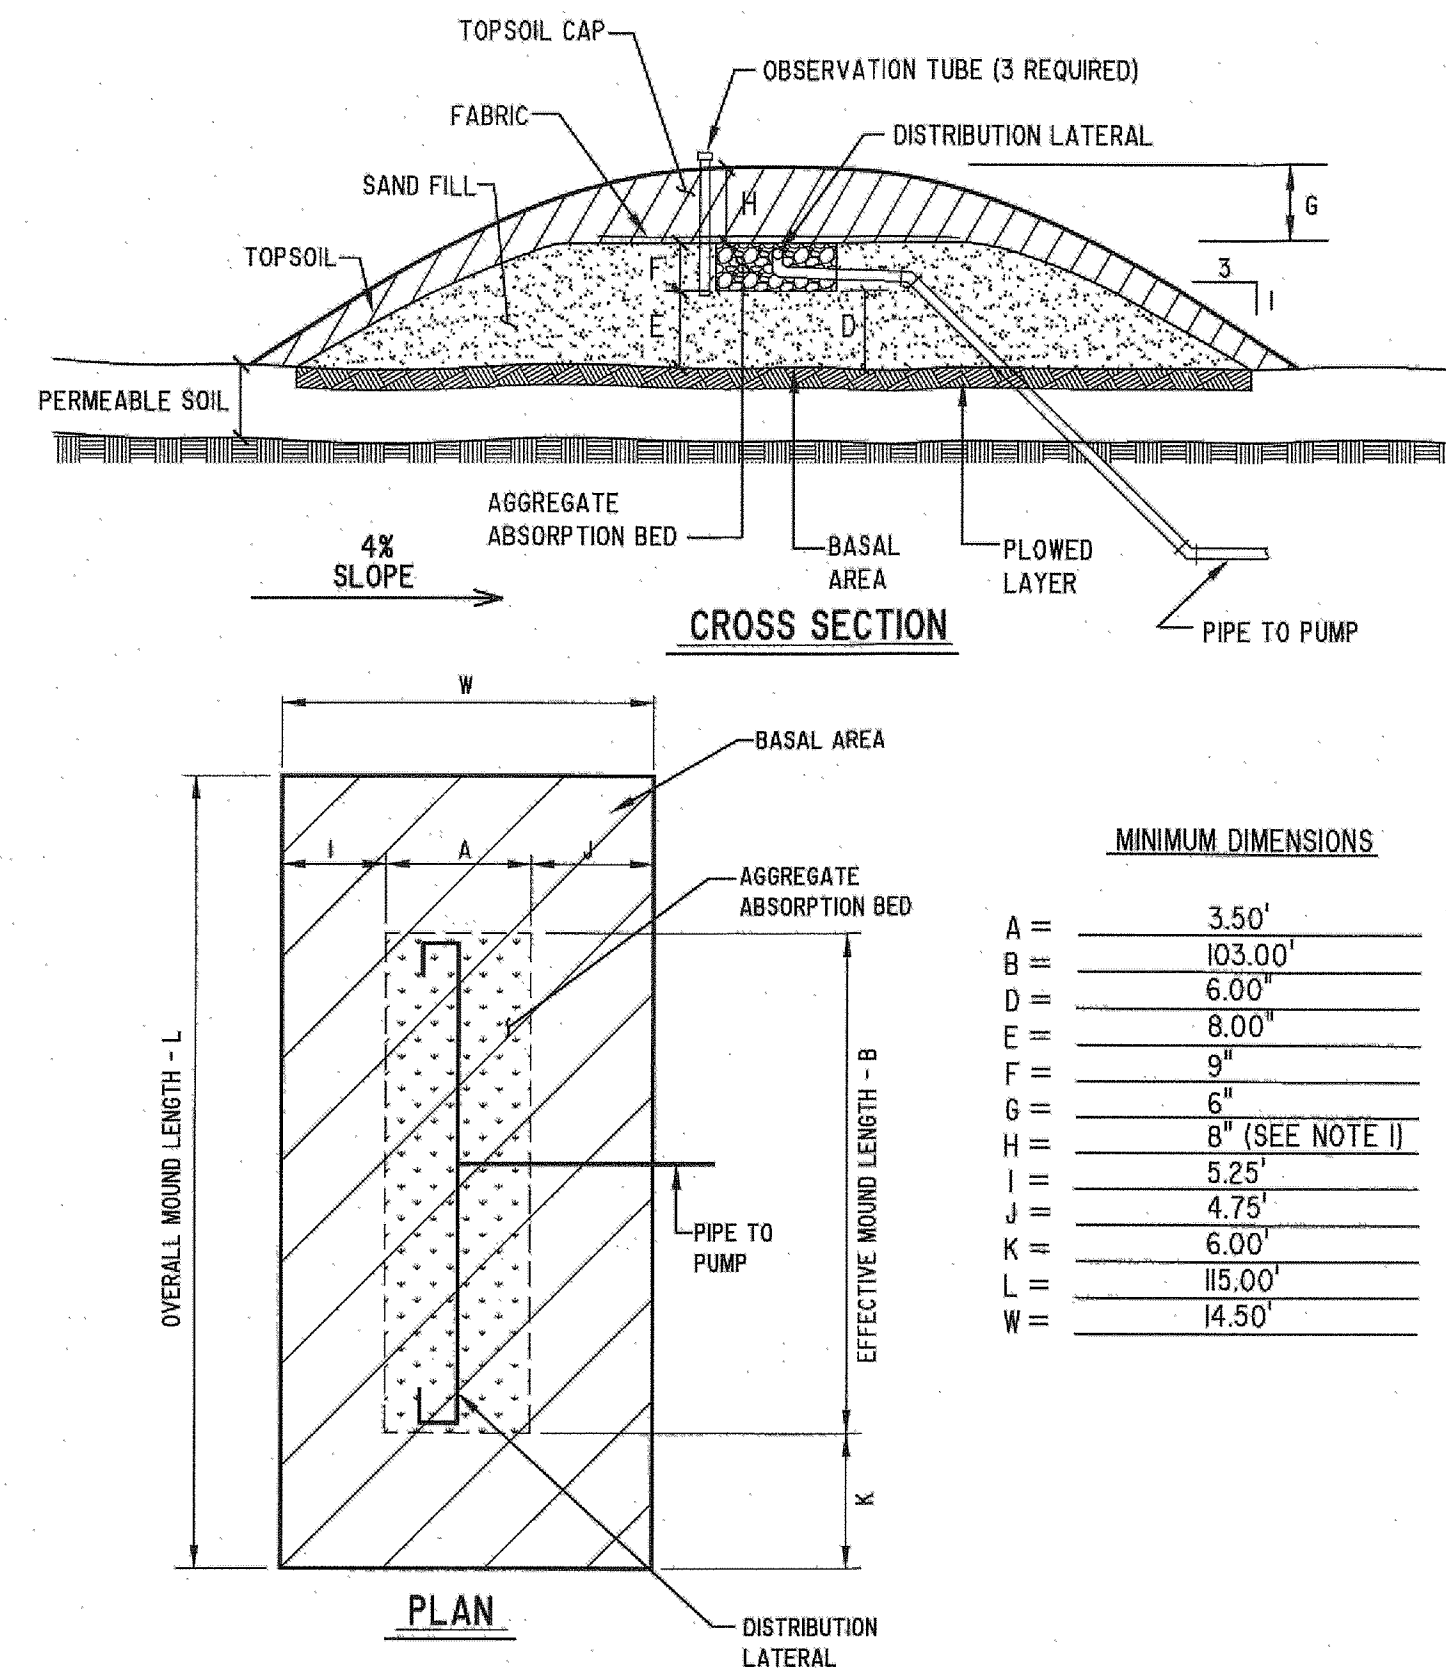

NOTES: (1500 GALLON VERSION TO BE MODIFIED & USED AS DOSING TANK)

1. REINFORCED PRECAST CONCRETE TO HAVE A COMPRESSIVE STRENGTH OF 5000 PSI @ 28 DAYS.
2. PRECAST CONCRETE TANK SHALL MEET OR EXCEED SPECIFICATIONS AS SET BY O.A.C. RULE 3701-293-11.
3. CONCRETE JOINT SEALANT CONFORMS TO ASTM C-990.
4. TANK SEALS CONFORM TO ASTM C-923.
5. EFFLUENT FILTER RETAINS SOLIDS GREATER THAN 1/16" AND CONFORMS TO ASTM C-1227 (USE ZOELLER WWI EFFLUENT FILTER).
6. STAMP OR LABEL TOP OF TANK AS FOLLOWS:
MACK INDUSTRIES LOGO
2000 GAL. TANK CAPACITY
DATE OF MANUFACTURE

STATE APPROVAL PENDING			
DUAL COMPARTMENT 2000 GALLON SEPTIC TANK			
O.D.H. 2007 COMPLIANCE, OAC RULE 3701-29-11			
DRAWN BY:	CJ	SCALE: 1/4"=1'-0"	DRAWING NO.:
DATE:	4/5/07	REV:	D 1000 GAL
MACK INDUSTRIES, INC.			
201 COLUMBIA ROAD, VALLEY CITY, OHIO 44280		(330) 483-3111	

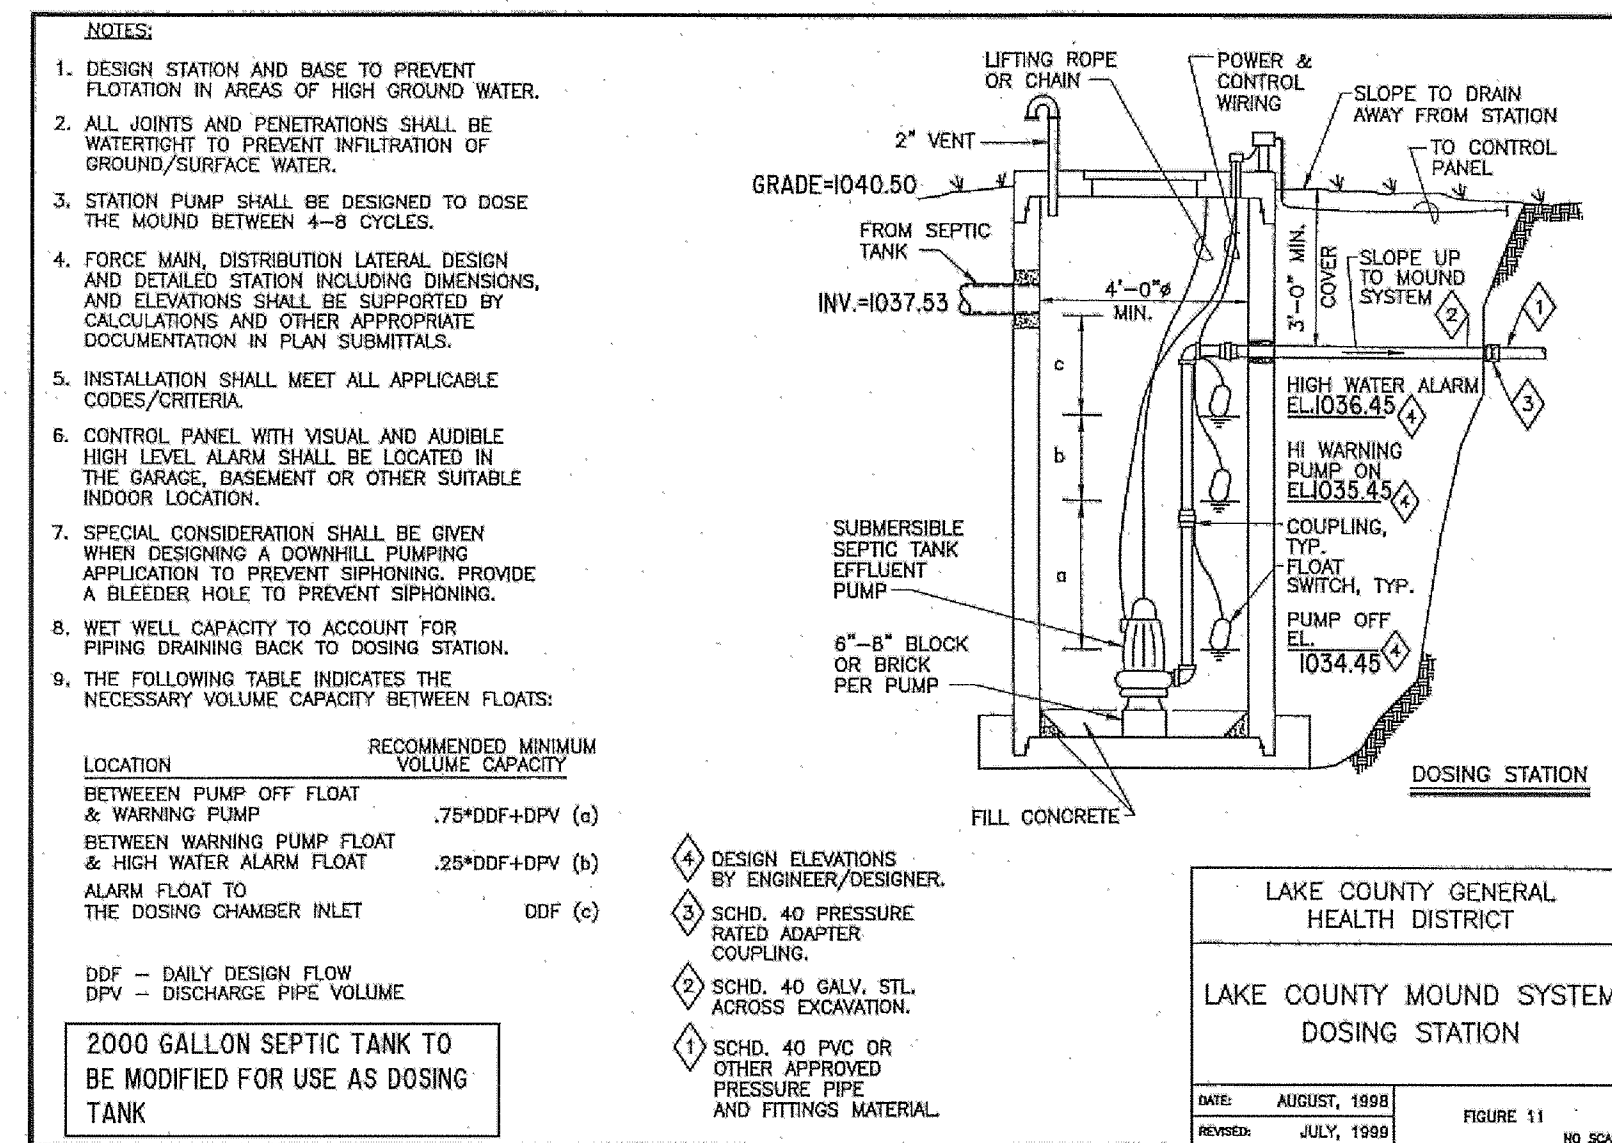

REVISIONS	BY

Barrington
CONSULTING GROUP, INC.
9114 TYLER BLVD., MENTOR, OHIO 44060
PHONE 440.205.1260 FAX 440.205.1262
www.BarringtonCGI.com

W.R. DAWSON CONSTRUCTION, LLC.
BILL DAWSON JR.
12167 GIRLED ROAD
CONCORD TWP., OHIO 44077
PH:440-223-4446 / FAX:440-209-8796

SITE PLAN
P.P. No. 08-A-002-0-00-050-0 CONCORD-HAMBDEN ROAD
CONCORD TWP., OHIO 44077

DRAWN: WSO
CHECKED: DWN
DATE: AUG. 14, 2014
SCALE: 1" = 20'
JOB NO.: 14088
SHEET: 2/2
OF SHEETS