

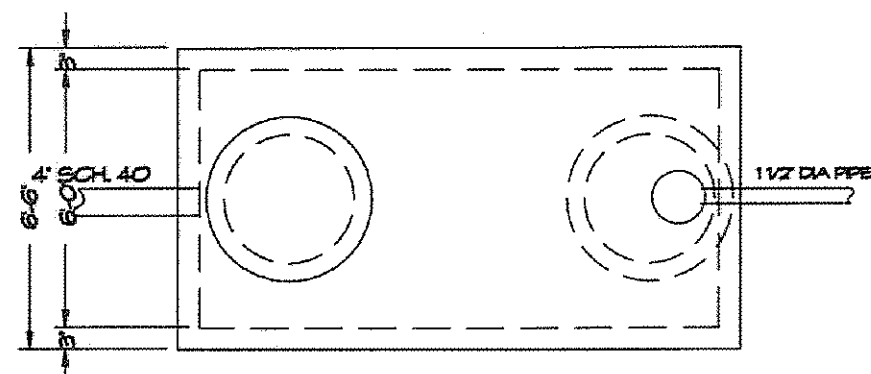


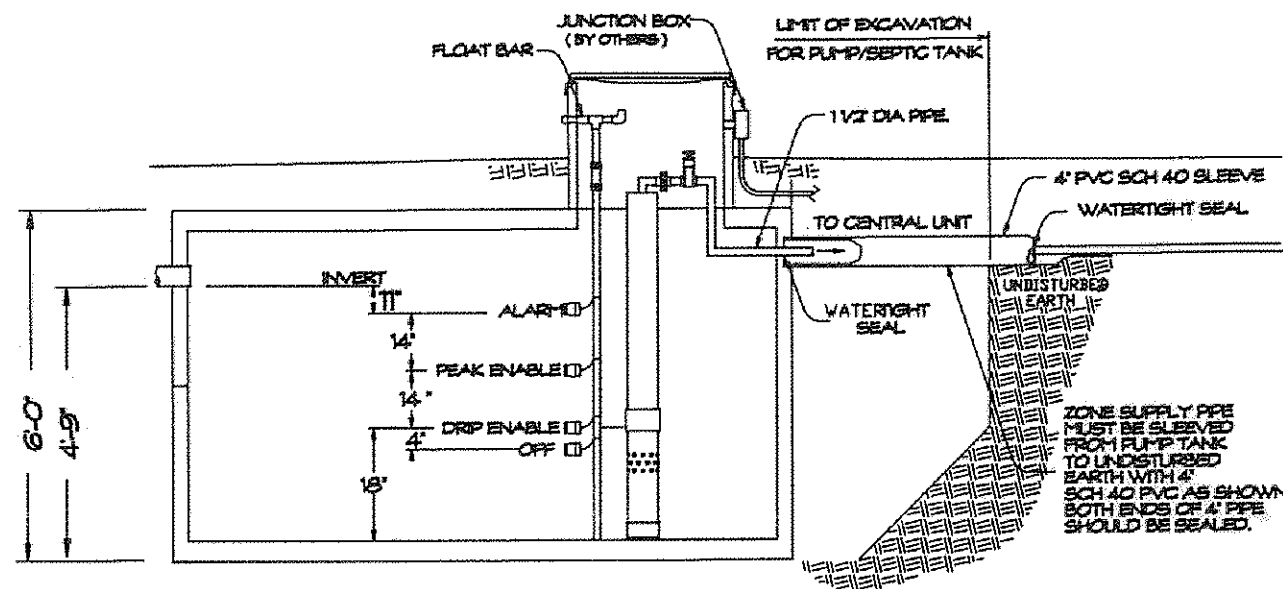

**2000 GALLON
DRIP DOSE TANK DETAIL**

NTS

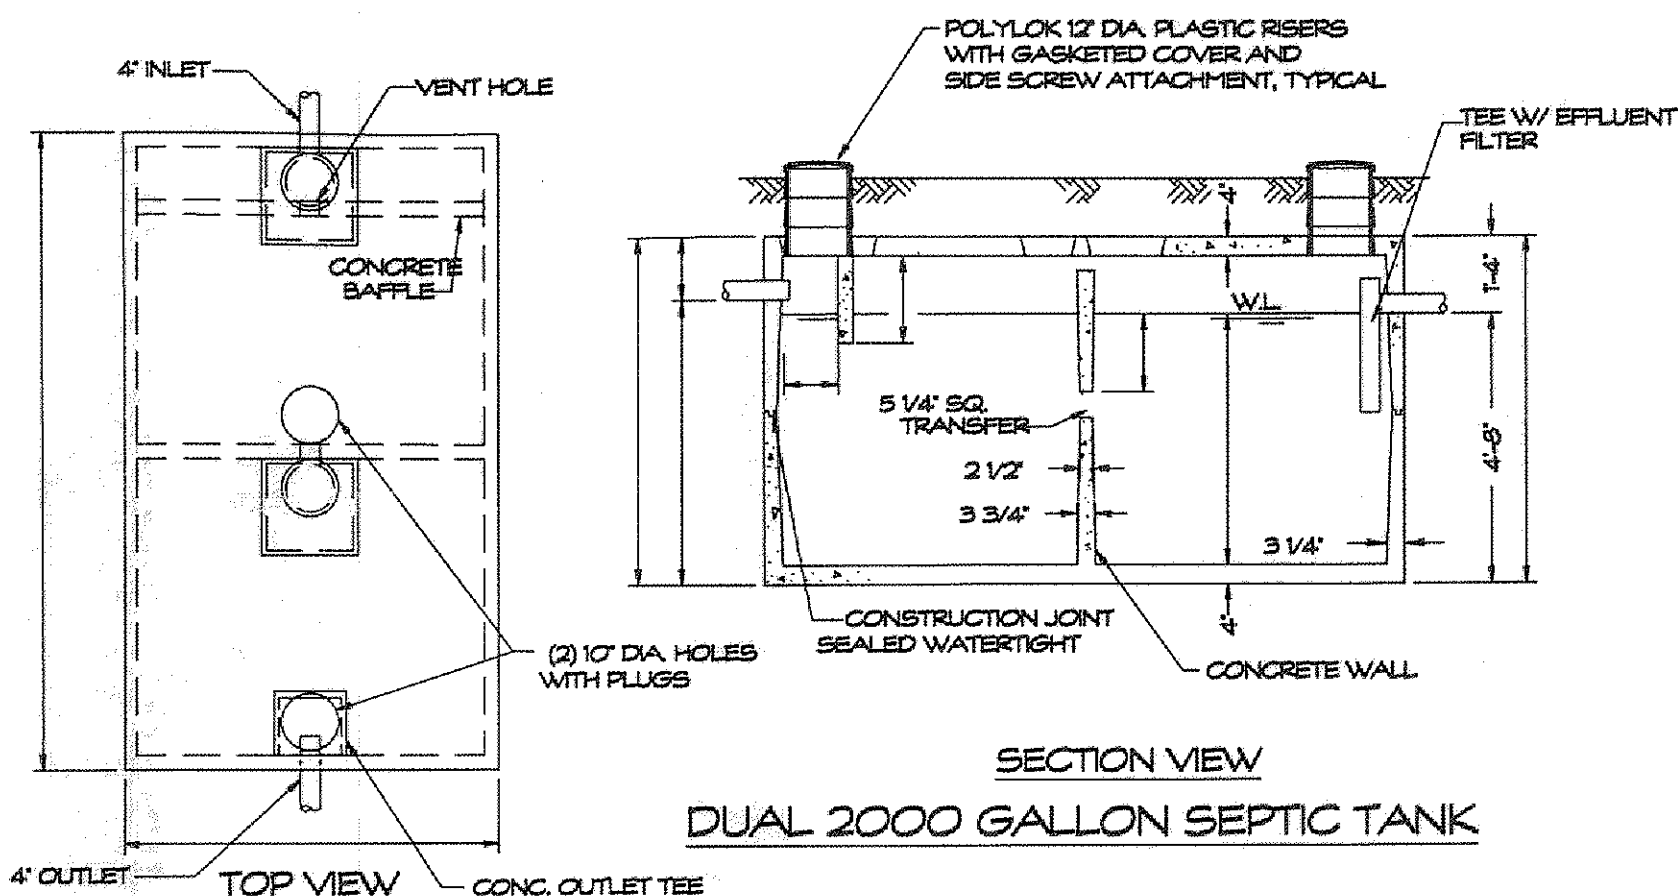

**SECTION VIEW
DUAL 2000 GALLON SEPTIC TANK**

NOTES:

1. REINFORCED PRECAST CONCRETE SHALL HAVE A COMPRESSIVE STRENGTH OF 5000 PSI @ 28 DAYS.
2. POLYLOK SEALS SHALL BE PROVIDED FOR INLET AND OUTLET CONNECTIONS. SEALS CAN BE USED FOR EITHER 3" OR 4" DIA. PIPE.

KRB Engineering, Inc.
Professional Civil Engineering

330 Downing Drive
Chardon, Ohio 44024

Phone: (440) 286-7150
Email: kbender1@windstream.net

**WASTEWATER TREATMENT
DETAILS**

New Three Bedroom Home
9855 Little Mountain Road
Concord Twp., Lake County
March, 2011

SHT. 3/7