


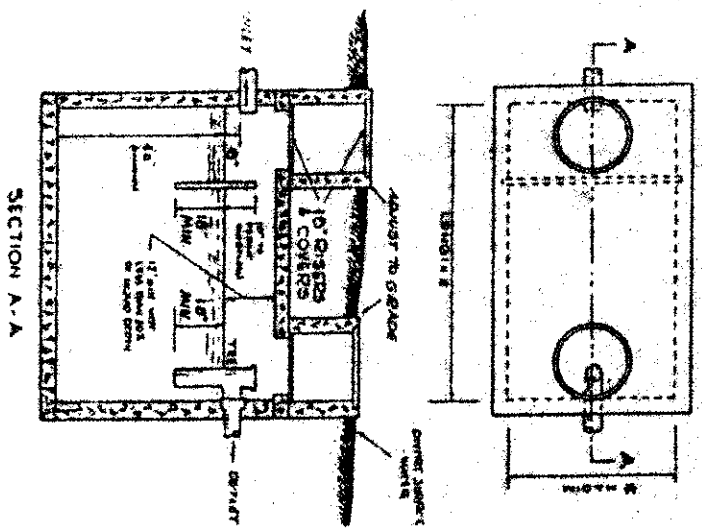


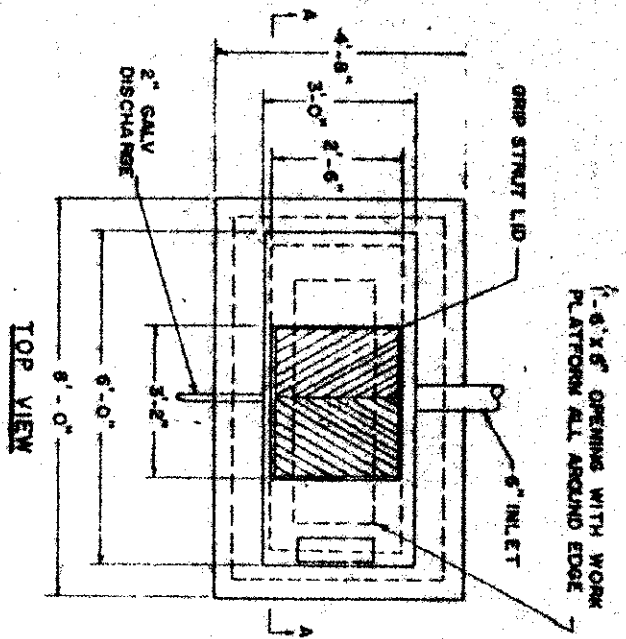


- * Dimensions - The following general criteria should be followed:
- (1) Ratio of length to width to depth, 2:1:1. If dual compartment tanks are used, this ratio may be extended to 3:1:1, except.
 - (2) Maximum width, 18 ft.
 - (3) Maximum liquid depth, 4 ft.
 - (4) Maximum liquid depth, 10 ft.
 - (5) Minimum free board, 1/2 ft. of liquid depth.

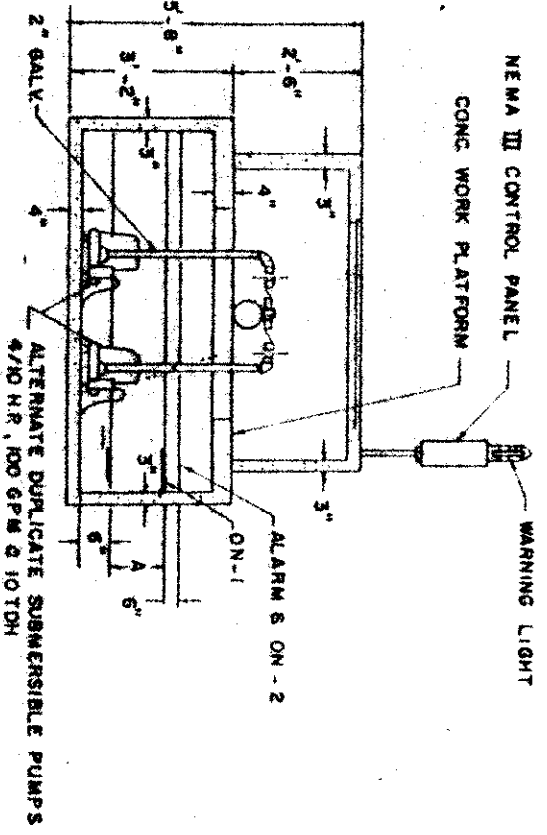


500 GALLON DOSING TANK
K.T.S.

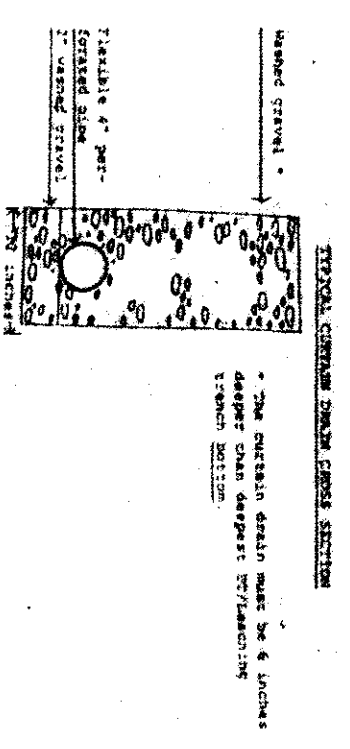


TRENCH DETAILS

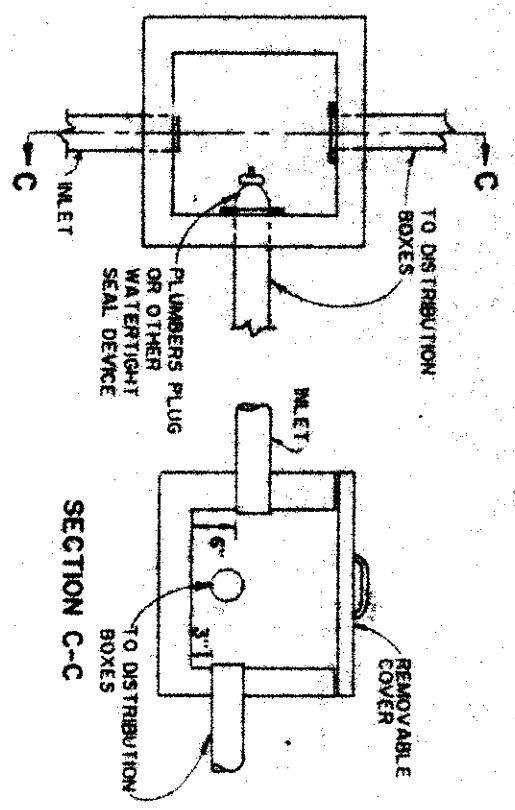

SPLITTER BOX DETAIL

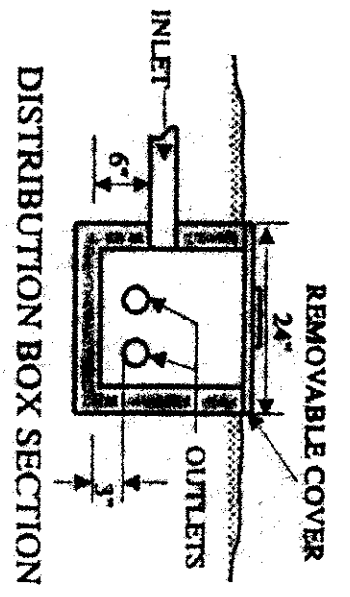

DISTRIBUTION BOX SECTION

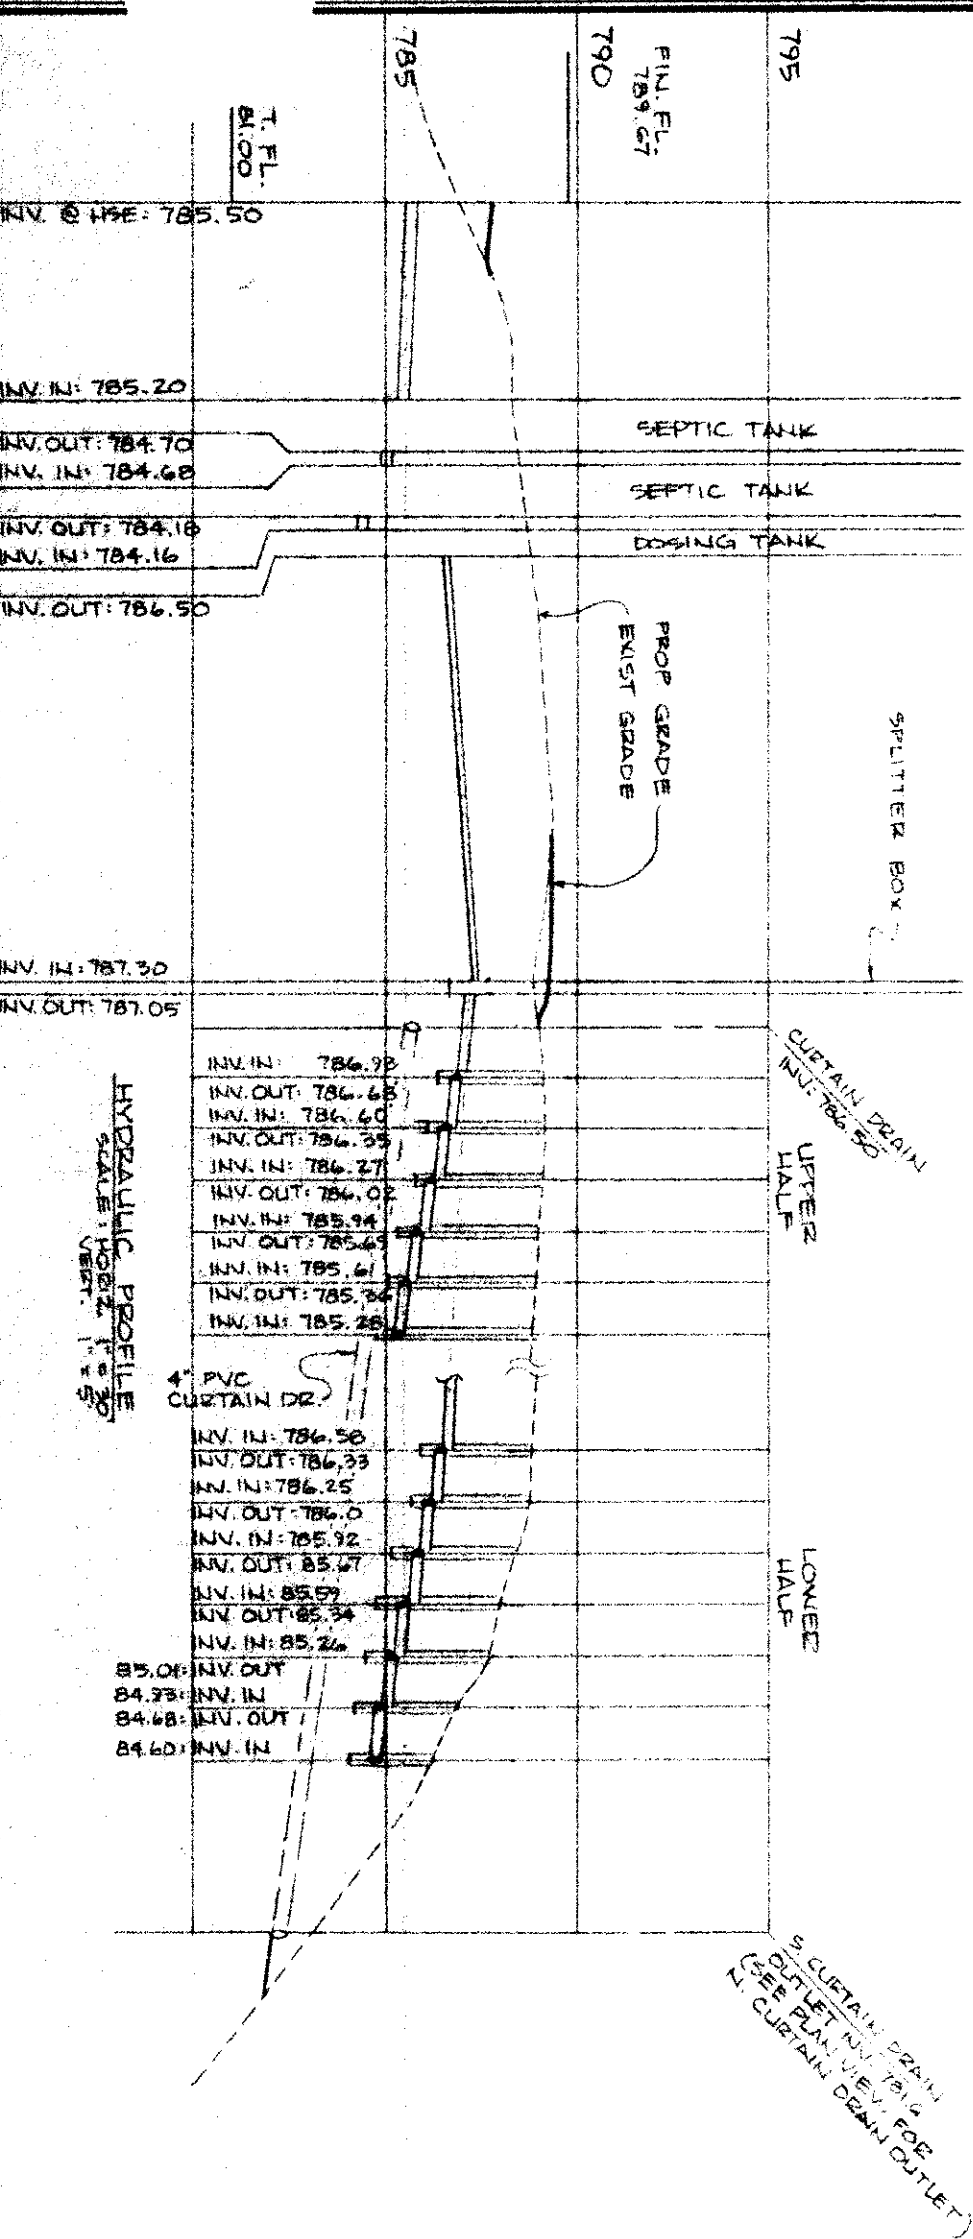

HYDRAULIC PROFILE
SCALE: HORIZ. 1" = 5'
VERT. 1" = 5'