

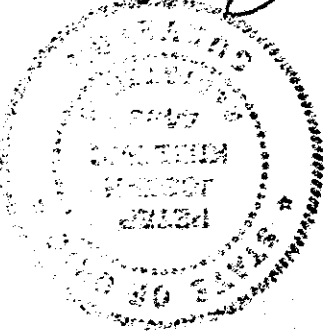


PROPOSED HOUSE AND GARAGE, WELL & SEPTIC SYSTEM
 3-18-91
 DATE DUE
 PRELIMINARY SITE PLAN FOR RICHARD J. JONES
 TITLE
 ROBERTS ROAD, CONCORD TWP.

John J. Jones
 No. 4499

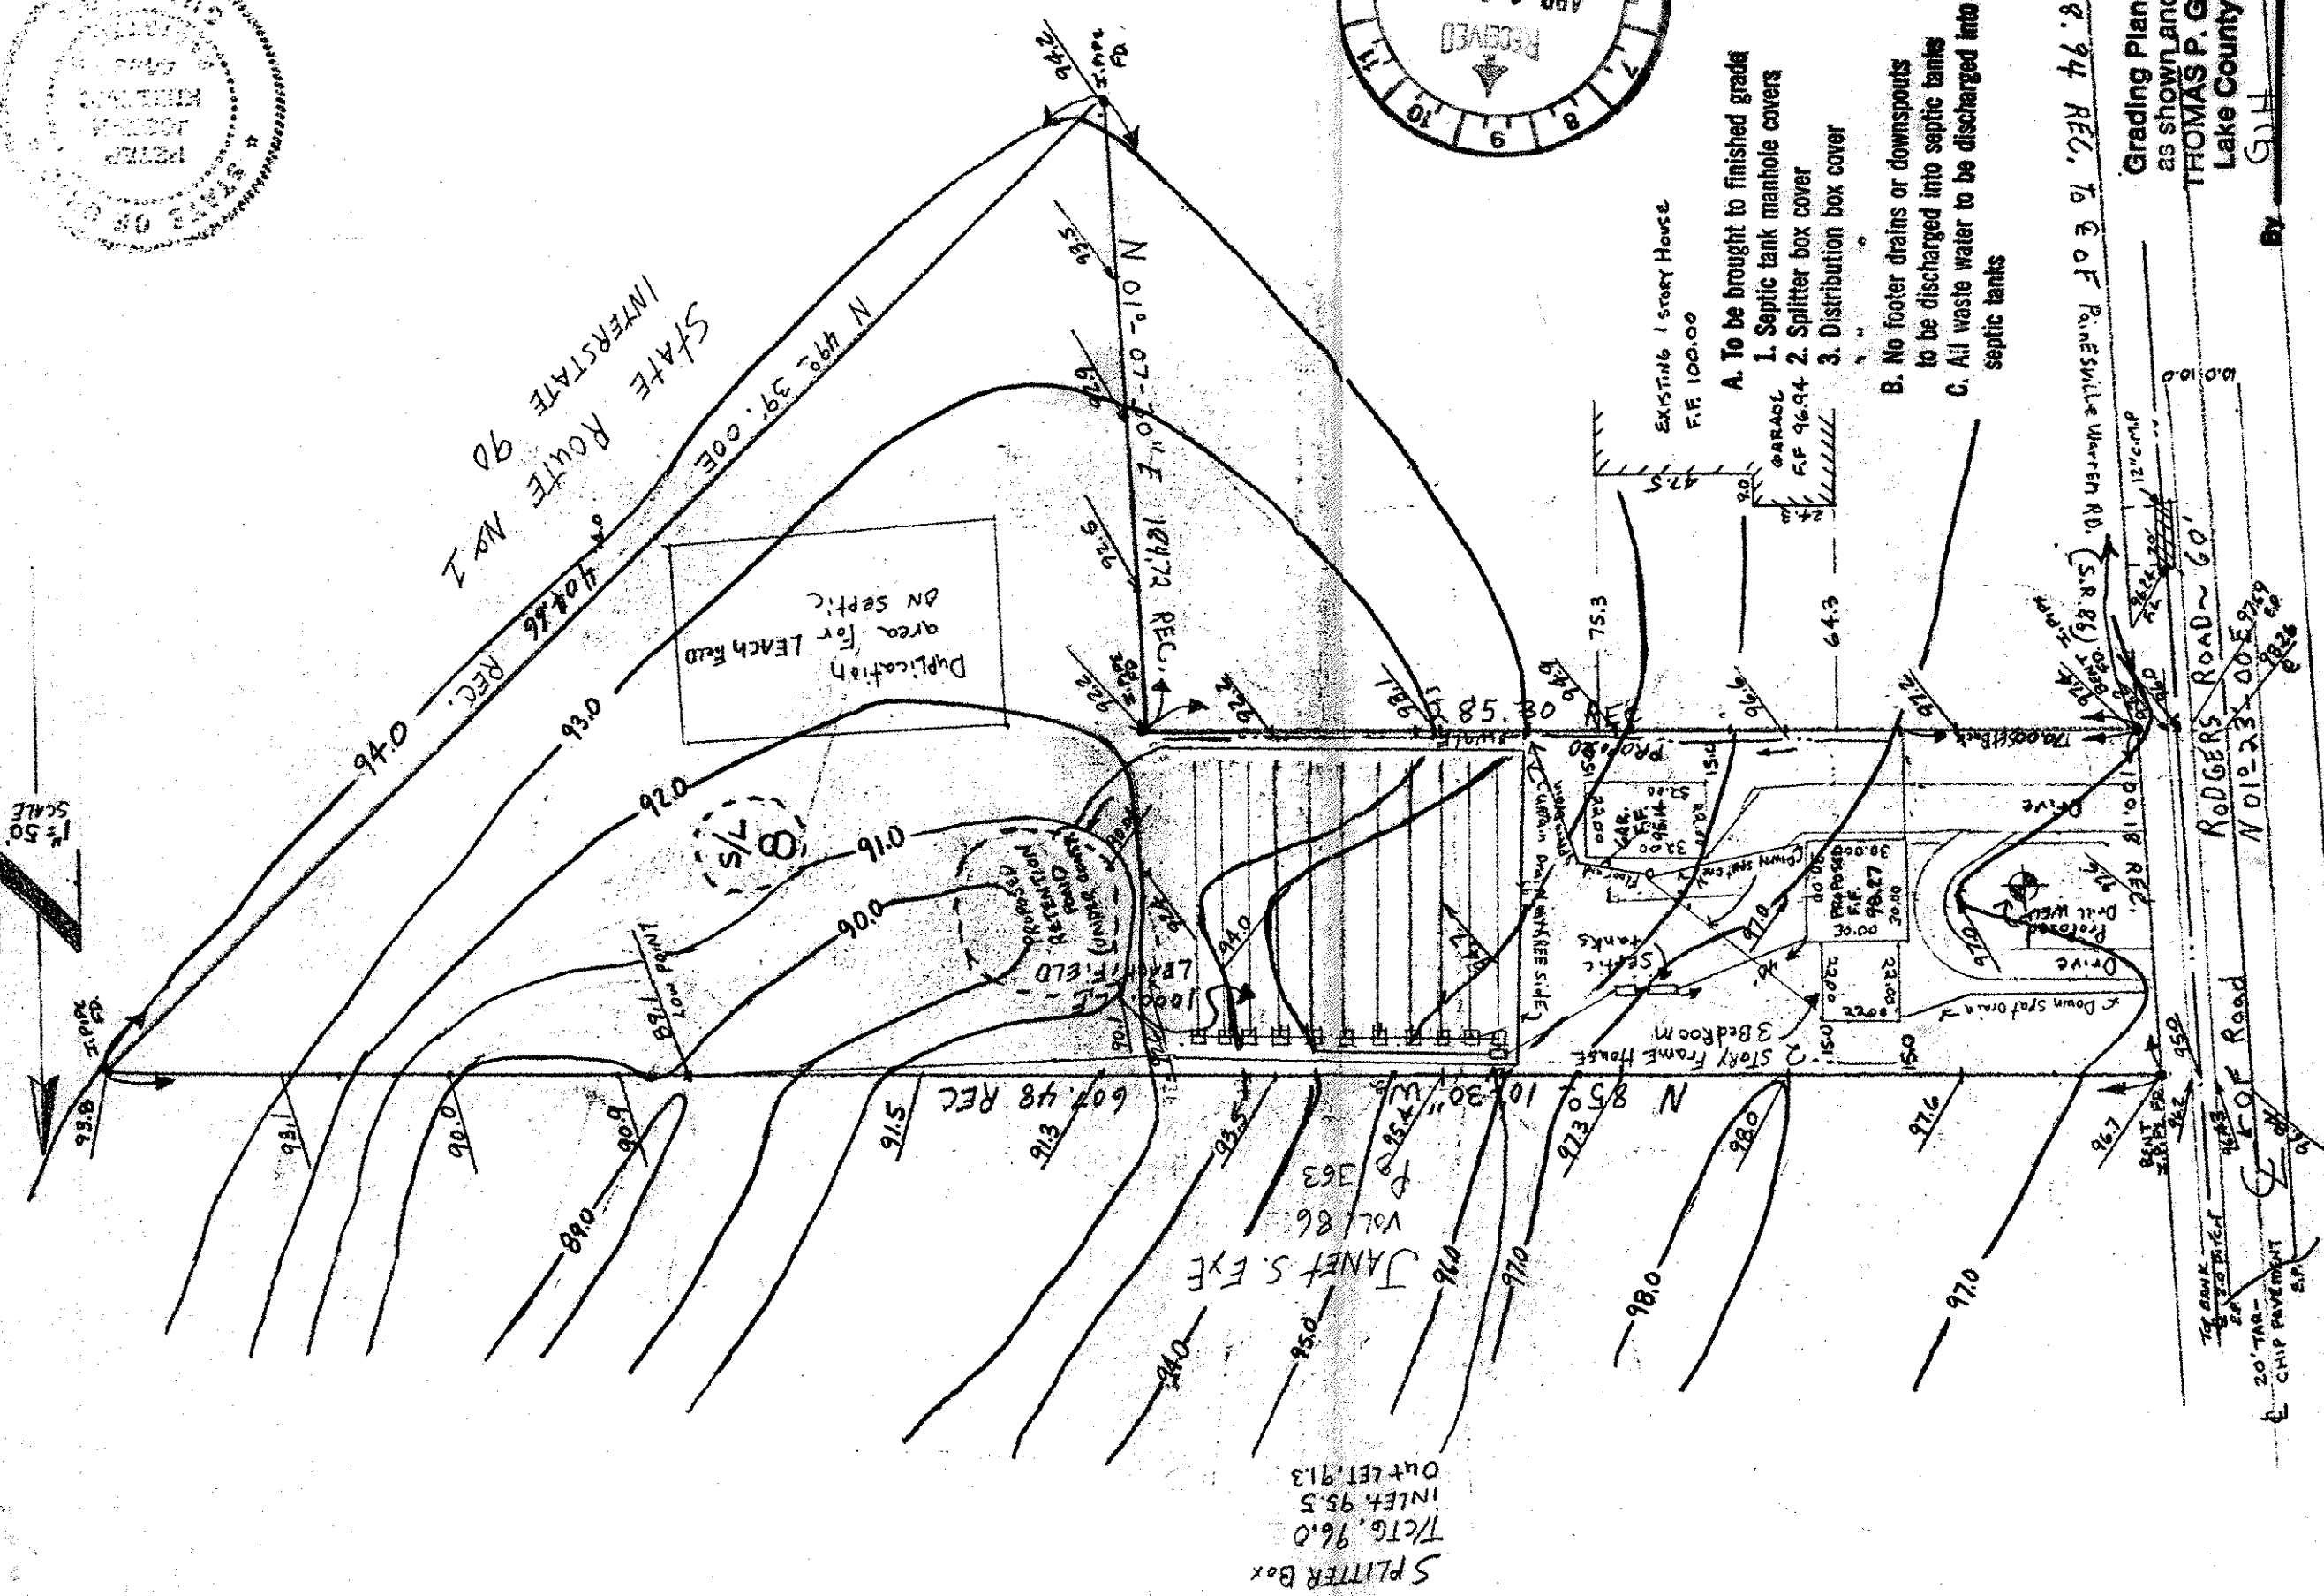

4-1-91

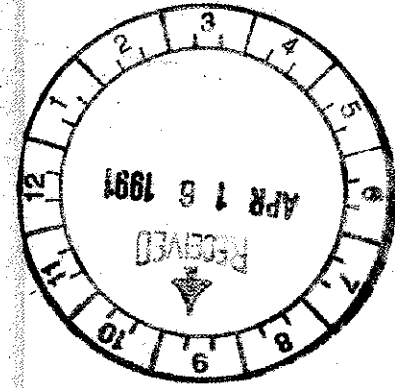

- A. To be brought to finished grade
1. Septic tank manhole covers
 2. Splitter box cover
 3. Distribution box cover
- B. No footer drains or downspouts to be discharged into septic tanks
- C. All waste water to be discharged into septic tanks

Grading Plan Approved
 as shown and/or noted
 THOMAS P. GILLES, P.E.
 Lake County Engineer

By GJH Date 4/1/91

Reviewed and Accepted

LAKE COUNTY GENERAL HEALTH DISTRICT

Date 4-16-91

JOEL LUCIA, R. S. M. P. H.
Health Commissioner

By David B. Jones

SEWAGE DISPOSAL PERMIT MUST BE
 OBTAINED BY A LAKE COUNTY LICENSED
 INSTALLER BEFORE INSTALLATION IS
 STARTED.

LOW YIELD WATER
 FIXTURES REQUIRED
 ON ALL
 Shower Head
 Toilet

zoning #
 6700

SPLITTER BOX
 T/C 96.0
 INLET 95.5
 OUTLET 91.3

JANET S. EYE
 VOL 86
 363