

HYDRAULIC PROFILE


SCALES

HORIZONTAL - 1" = 50'



VERTICAL - 1" = 5'

EXISTING GROUND

PROPOSED GROUND



WILLIAMS ROAD 60'

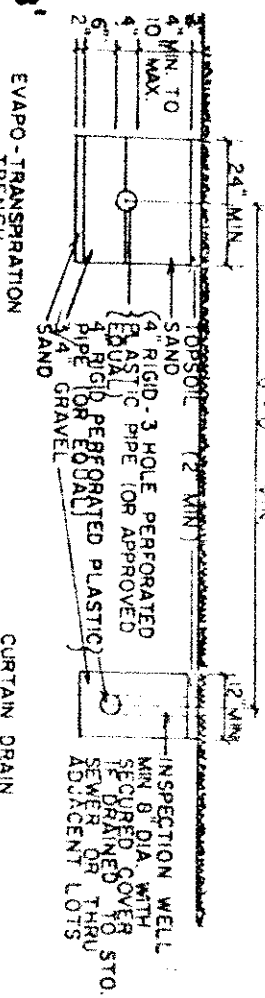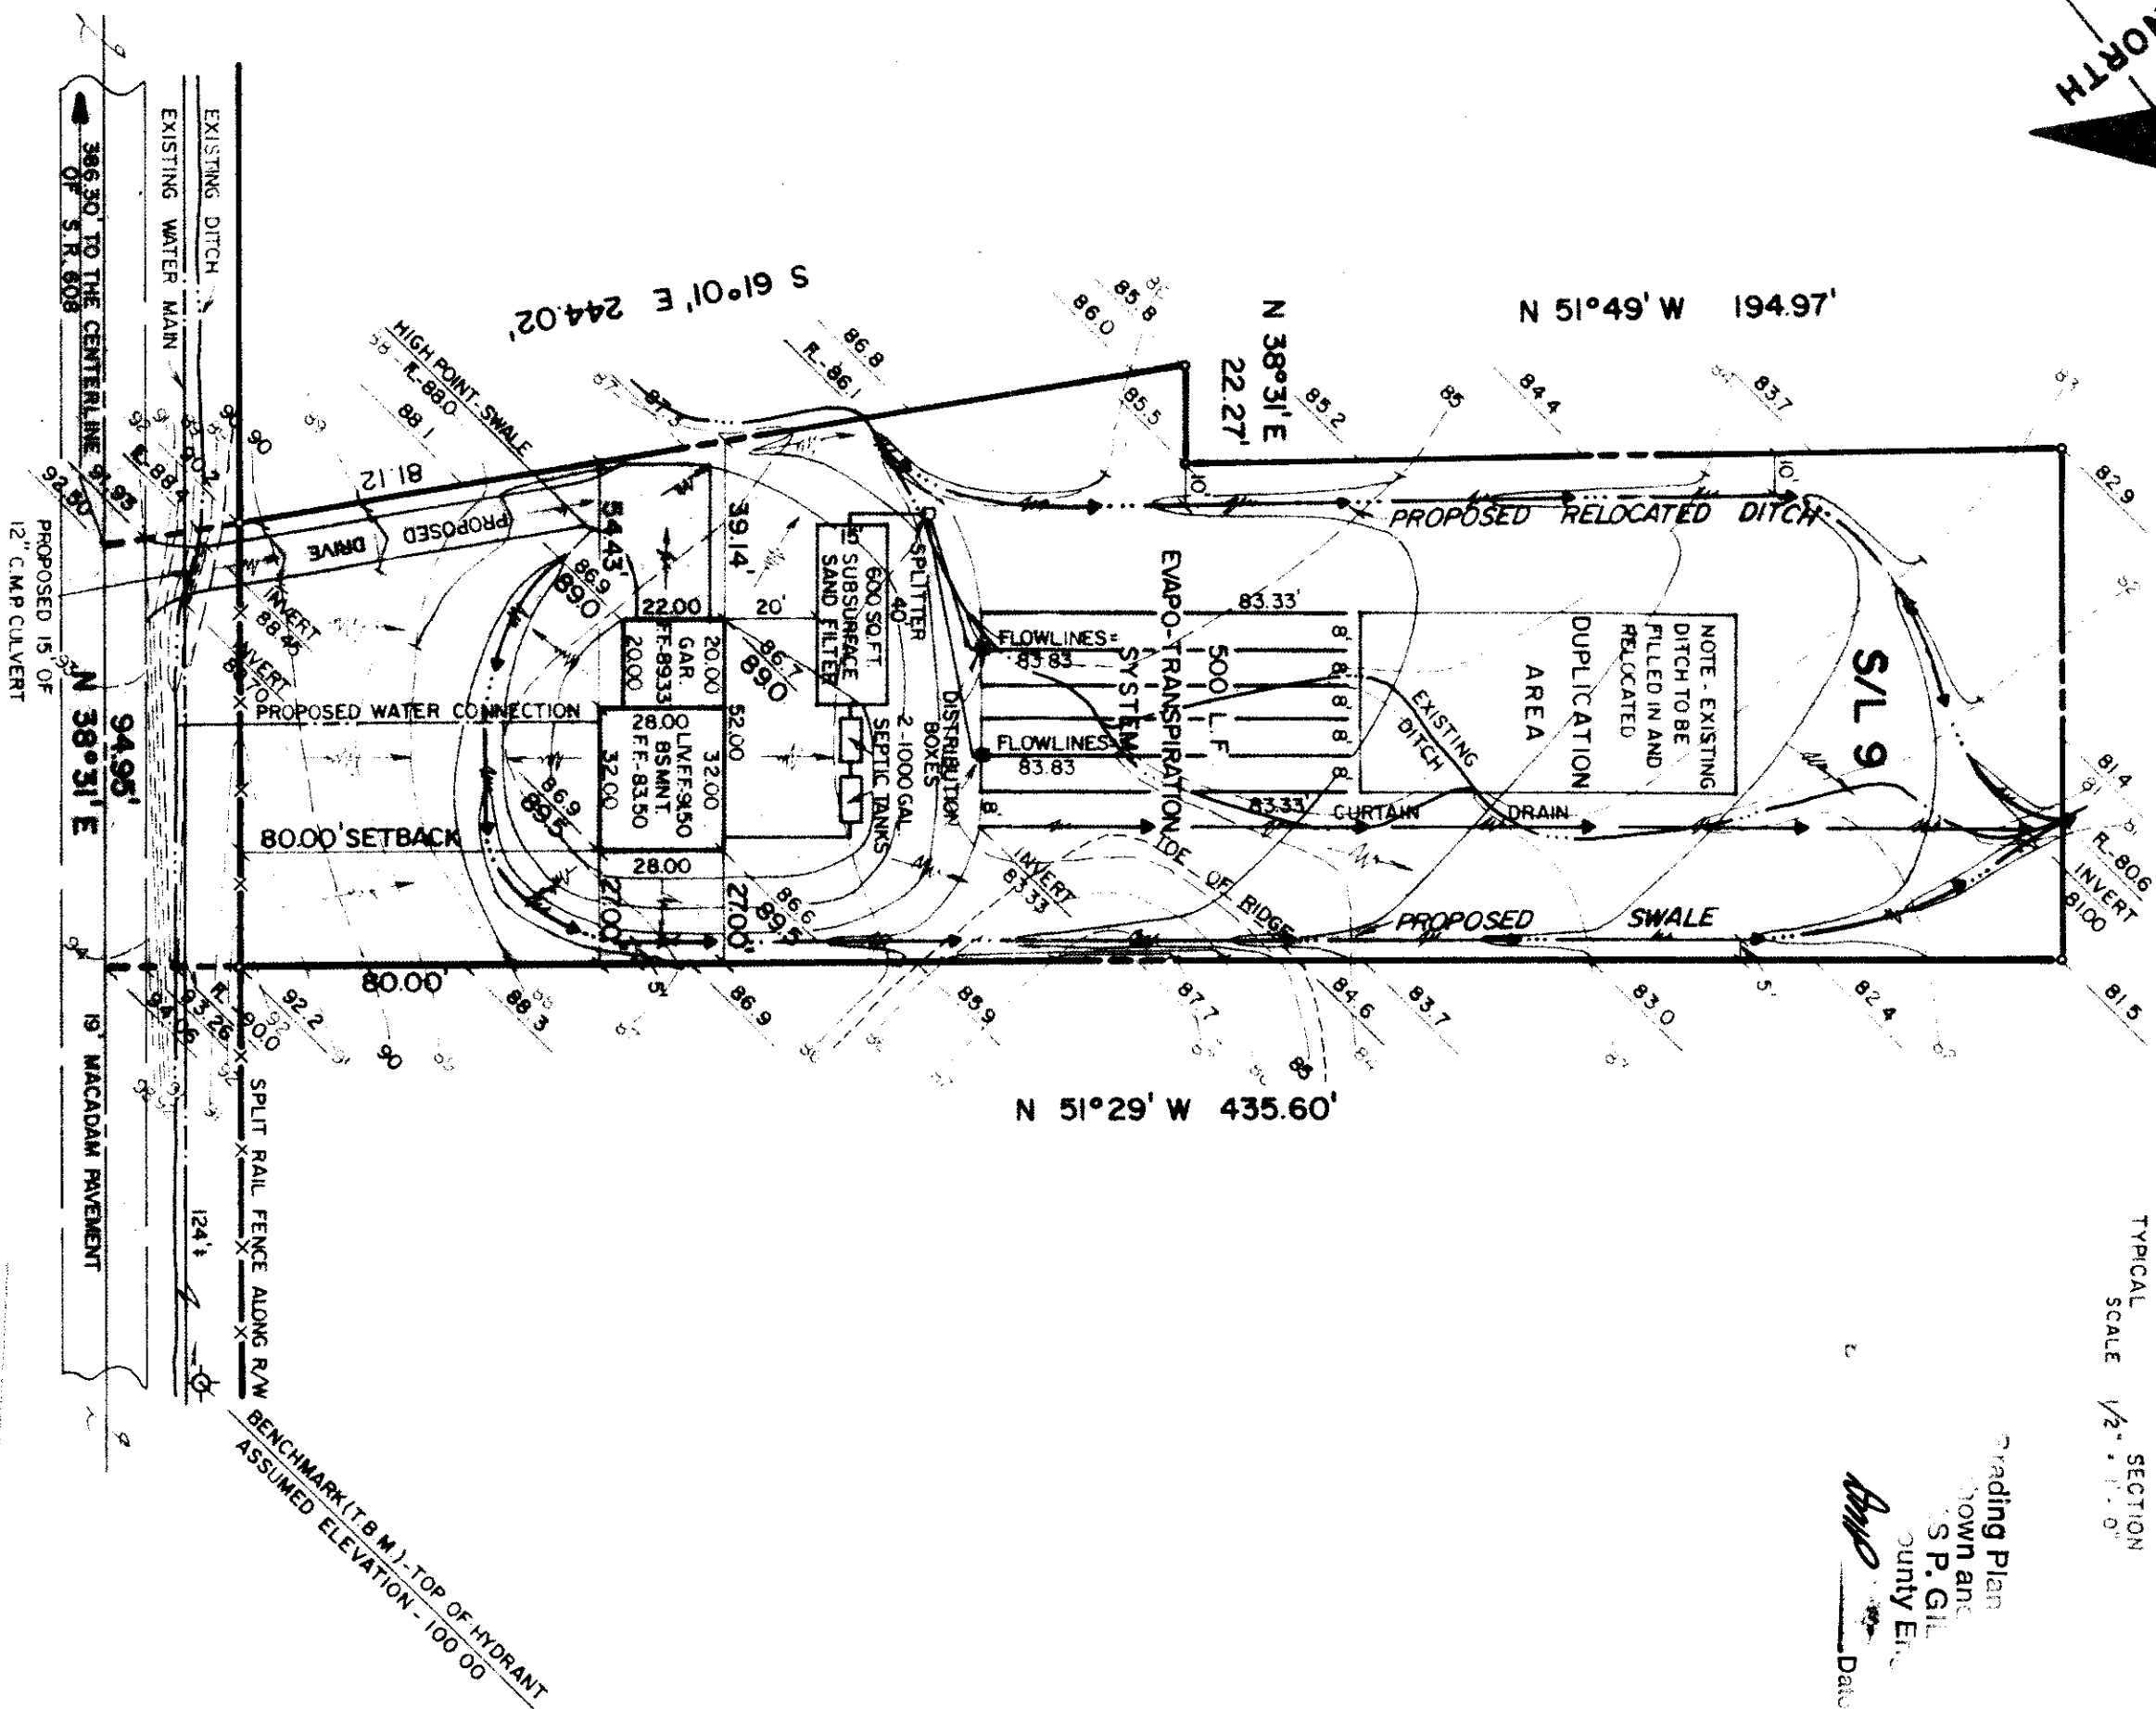

TYPICAL SECTION SCALE 1/2\"/>

Trading Plan
Town and
S.P. Gil
County E.
Date 7-18-84

SITE PLAN

CONCORD LAKE COUNTY, OHIO

for: SPEAR BUILDERS

7581 MIDDLE RIDGE ROAD, MADISON, O 44057

ADDRESS STREET CITY

ROBEY'S SUBDIVISION
SUBDIVISION L. 96 NAME
VOL. PG. WILLIAMS ROAD
SUBLOT NO. STREETLOT TRACT
VOLUME PAGE
PERM PARCEL NO. STREET

LEGEND

SANITARY MANHOLE
STORM MANHOLE
INLET OR CATCH BASIN
HYDRANT
EXISTING CONTOURS
PROPOSED CONTOURS
EXIST. ELEV. 100.0
PROP. ELEV. 100.0

WATER VALVE (GAS)
WATER METER (GAS)
AS BUILT ELEVATION
INDICATES
DIRECTION OF
SURFACE DRAINAGE

REMARKS

ALL BOUNDARY DATA SHOWN WAS OBTAINED FROM IDEOS, RECORDED
SUBDIVISION PLAT OR OTHER PUBLIC RECORDS)

LOCATIONS AS SHOWN ON ADJACENT WELLS AND SEPTIC TANKS OBTAINED FROM
STATE COMMISSION OF DEPARTMENT

DESIGN CERTIFICATION

THIS PLAN WAS PREPARED BY ME, AND IS CORRECT
TO THE BEST OF MY KNOWLEDGE AND BELIEF.

NAME SURVEYOR REGISTRATION NO.

CHECK LIST

NO OF BEDROOMS
DIMENSIONS
BEARINGS
THE TO NEAREST STREET
SUBLOT NO. PARCELS
SURROUNDING OWNERS OR
BLDG. DIMENSIONS FROM GR.
BLDG. TIES TO GRADES
SEPTIC TANK LOCATION & DUPPLICATION AREA
WELL LOCATION
ROCK OUTCROPPINGS
ISOLATION RADIUS FROM WELL

WATER MAIN SIZE LOCATION
SAN. SEWER SIZE & GR. LOC.
SAN. MH CAST ELEV. INV. ELEV.
SAN. CONN. SIZE, DEPTH
STORM SEWER SIZE & GR. LOC.
STORM MH CAST ELEV. INV. ELEV.
PAV'T TYPE GRADE CURBS
GAS LINE LOC. SIZE PRESSURE
SIDEWALK TYPE WIDTH THICKNESS
CULVERT TYPE DIA. LENGTH

PLAN PREPARED BY:

DEBEVEC • SALO & ASSOCIATES, INC.

NO.	DATE	BY
1		
2		
3		
4		
5		


DRAWN BY	SCALE	PHONE NO.
L.L.	40'	352-9250
CHK'D.	DATE	DRAWING NO.
AUG. 2/84		
CREW	APPRO.	
CHIEF		6177

"AS BUILT" CERTIFICATION

I HEREBY CERTIFY THAT THE CIRCLED GRADES ARE EXISTING
FINISH GRADES CHECKED IN THE FIELD ON 19
AND ARE CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF.

REGISTERED SURVEYOR REG. NO.

STANDARD SUBSURFACE FILTER

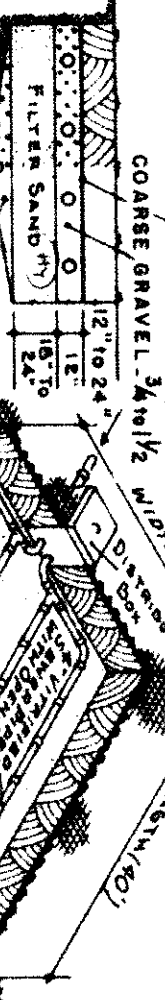UNTREATED BUILDING PAPER
OR STRAW 3\"/>

NOTE:

- SLOPE TOP DISTRIBUTION PIPES
2 INCHES IN 40 FEET.
- SLOPE BOTTOM COLLECTION
TILE 2 INCHES IN 40 FEET.
- SAND SPECIFICATION: EFFECTIVE SIZE
0.4 TO 1.0 MM. UNIFORMITY COEFFICIENT
NOT GREATER THAN 3.0

LANCE COUNTY HEALTH DISTRICT
Date 9-12-84
JOEL LUGA, R. S. M. P. H.
Health CommissionerBY *[Signature]*

SEP 11 1984

6177