


2. ORIFICES SHALL BE PLACED UPWARD EXCEPT FOR THE FIRST AND LAST ONE IN EACH LATERAL. EACH LATERAL SHALL BE PLACED INSIDE A 4" PERFORATED PIPE IN ORDER TO PROVIDE ORIFICE SHIELDING. OTHER SHIELDING METHODS MAY BE USED IF APPROVED BY THE LAKE COUNTY HEALTH DEPARTMENT.

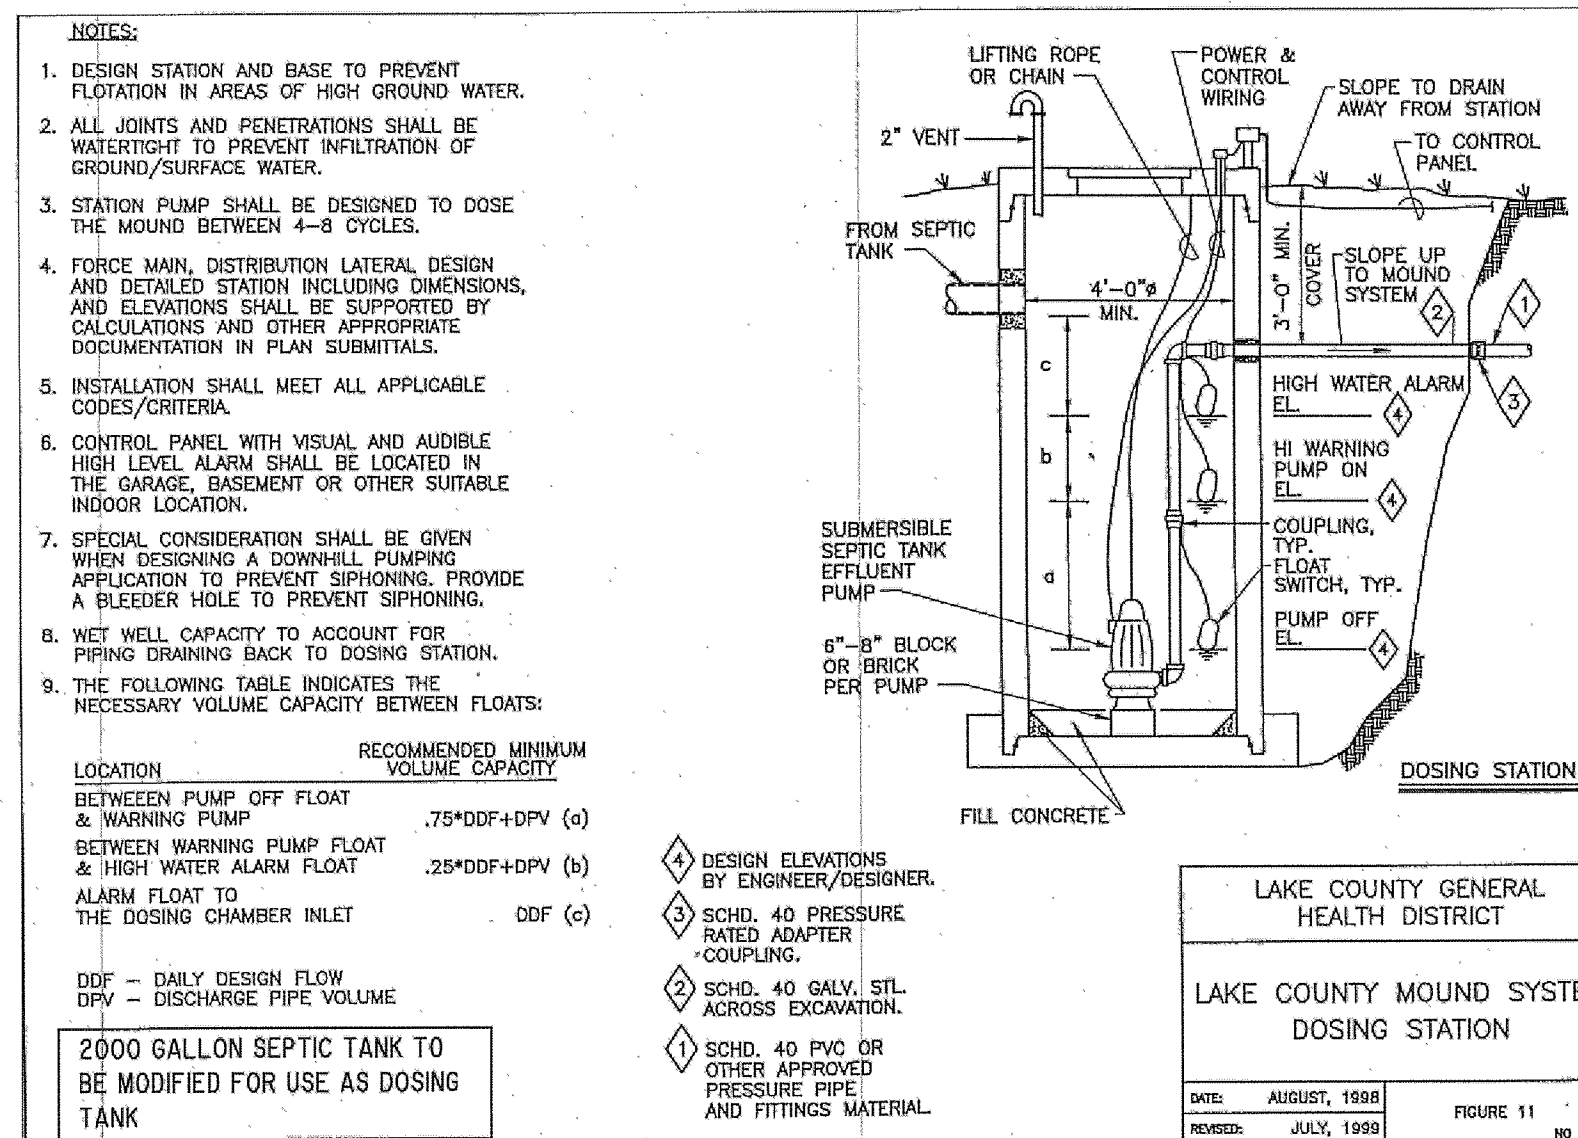

DRAWN
WSO
CHECKED
DWN
DATE
JAN. 16, 2014
SCALE
NONE
JOB NO.
13093
SHEET
2 / 2
OF _____ SHEETS