


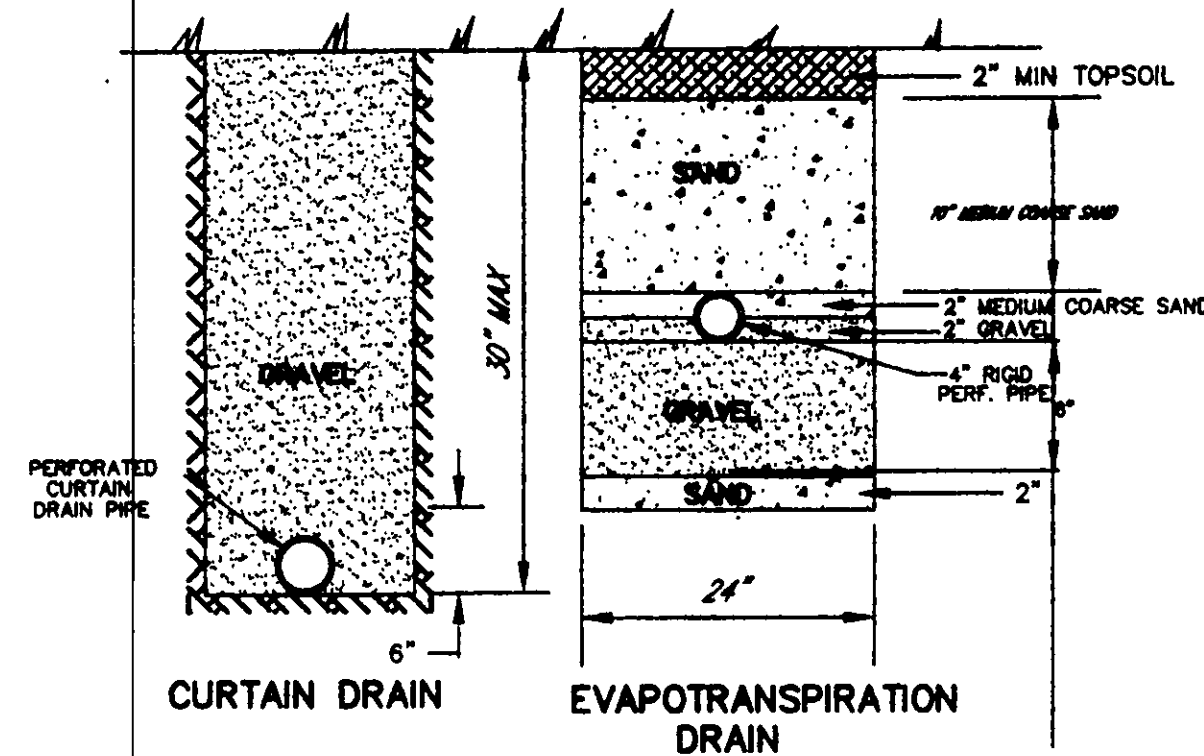


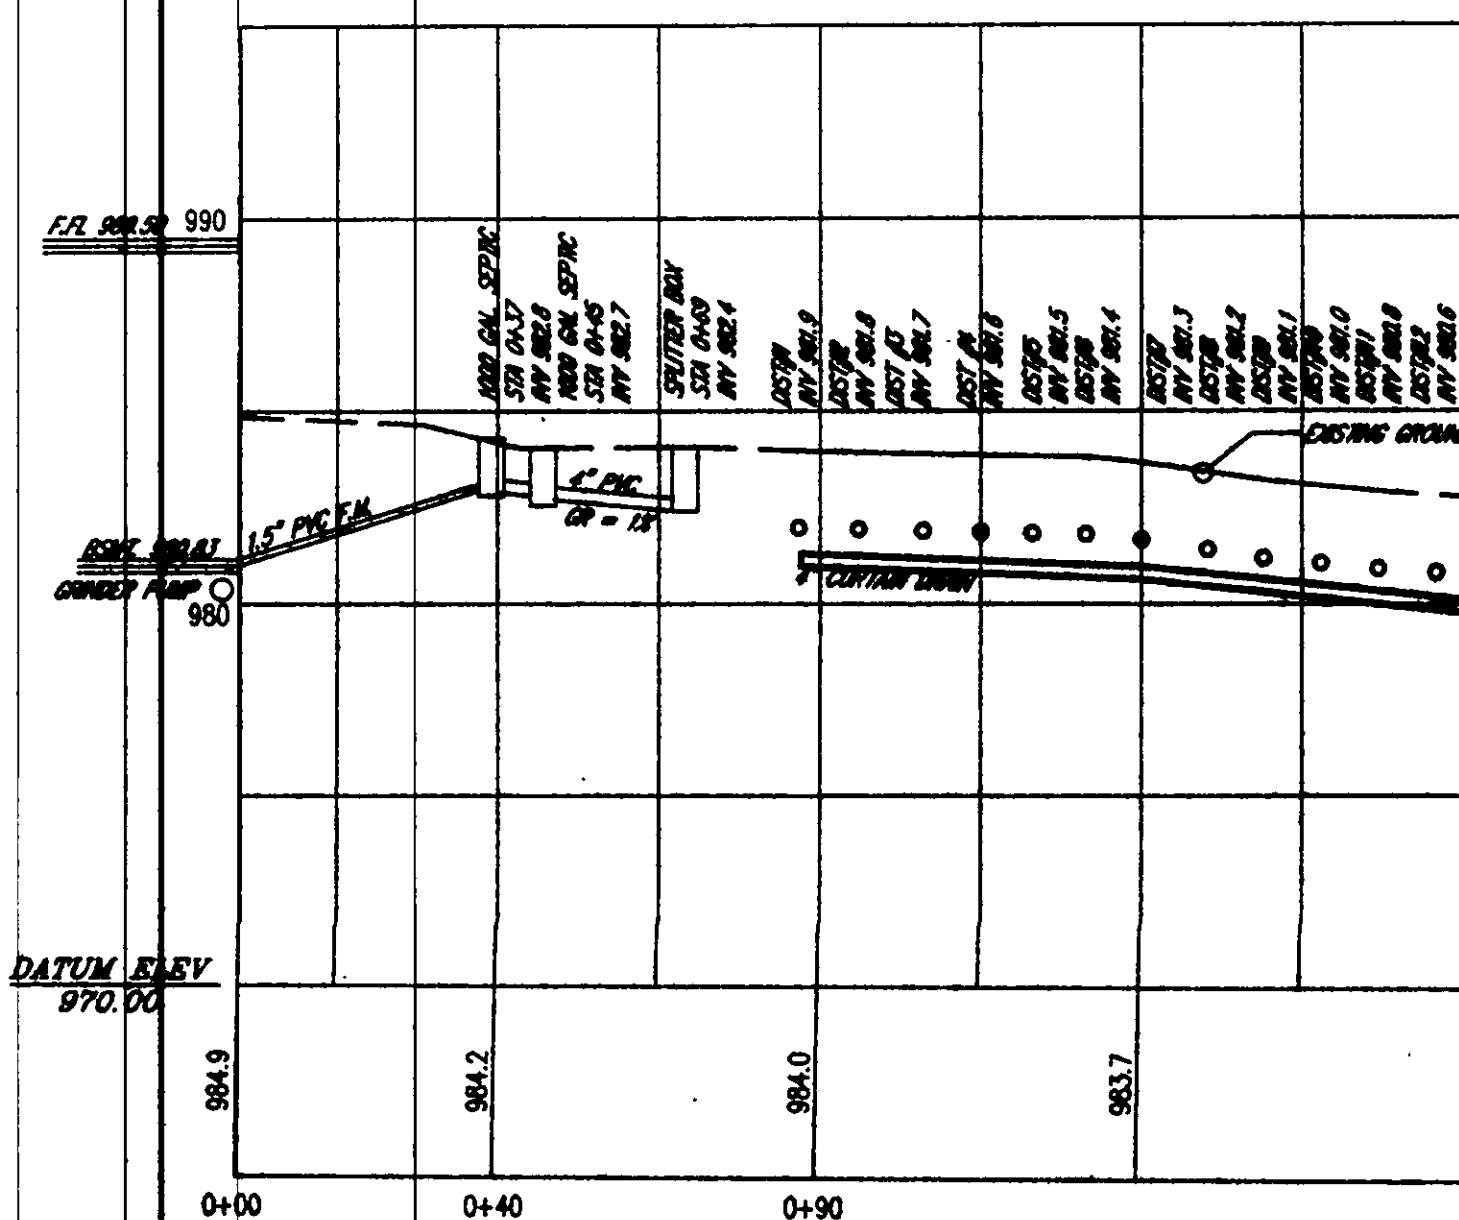

TRENCH DETAIL
NOT TO SCALE

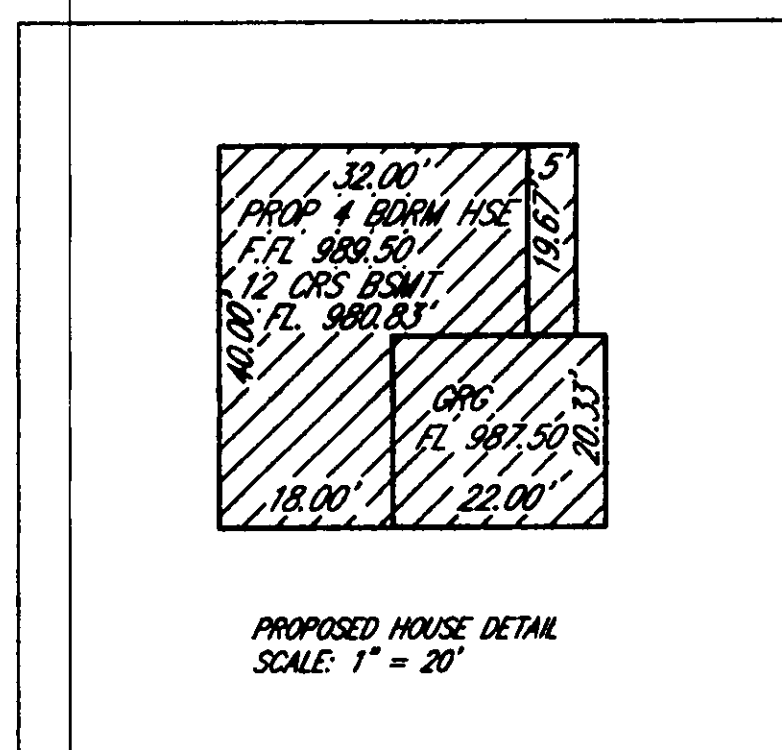


SEPTIC PROFILE
HORIZONTAL SCALE: 1" = 30'
VERTICAL SCALE: 1" = 5'

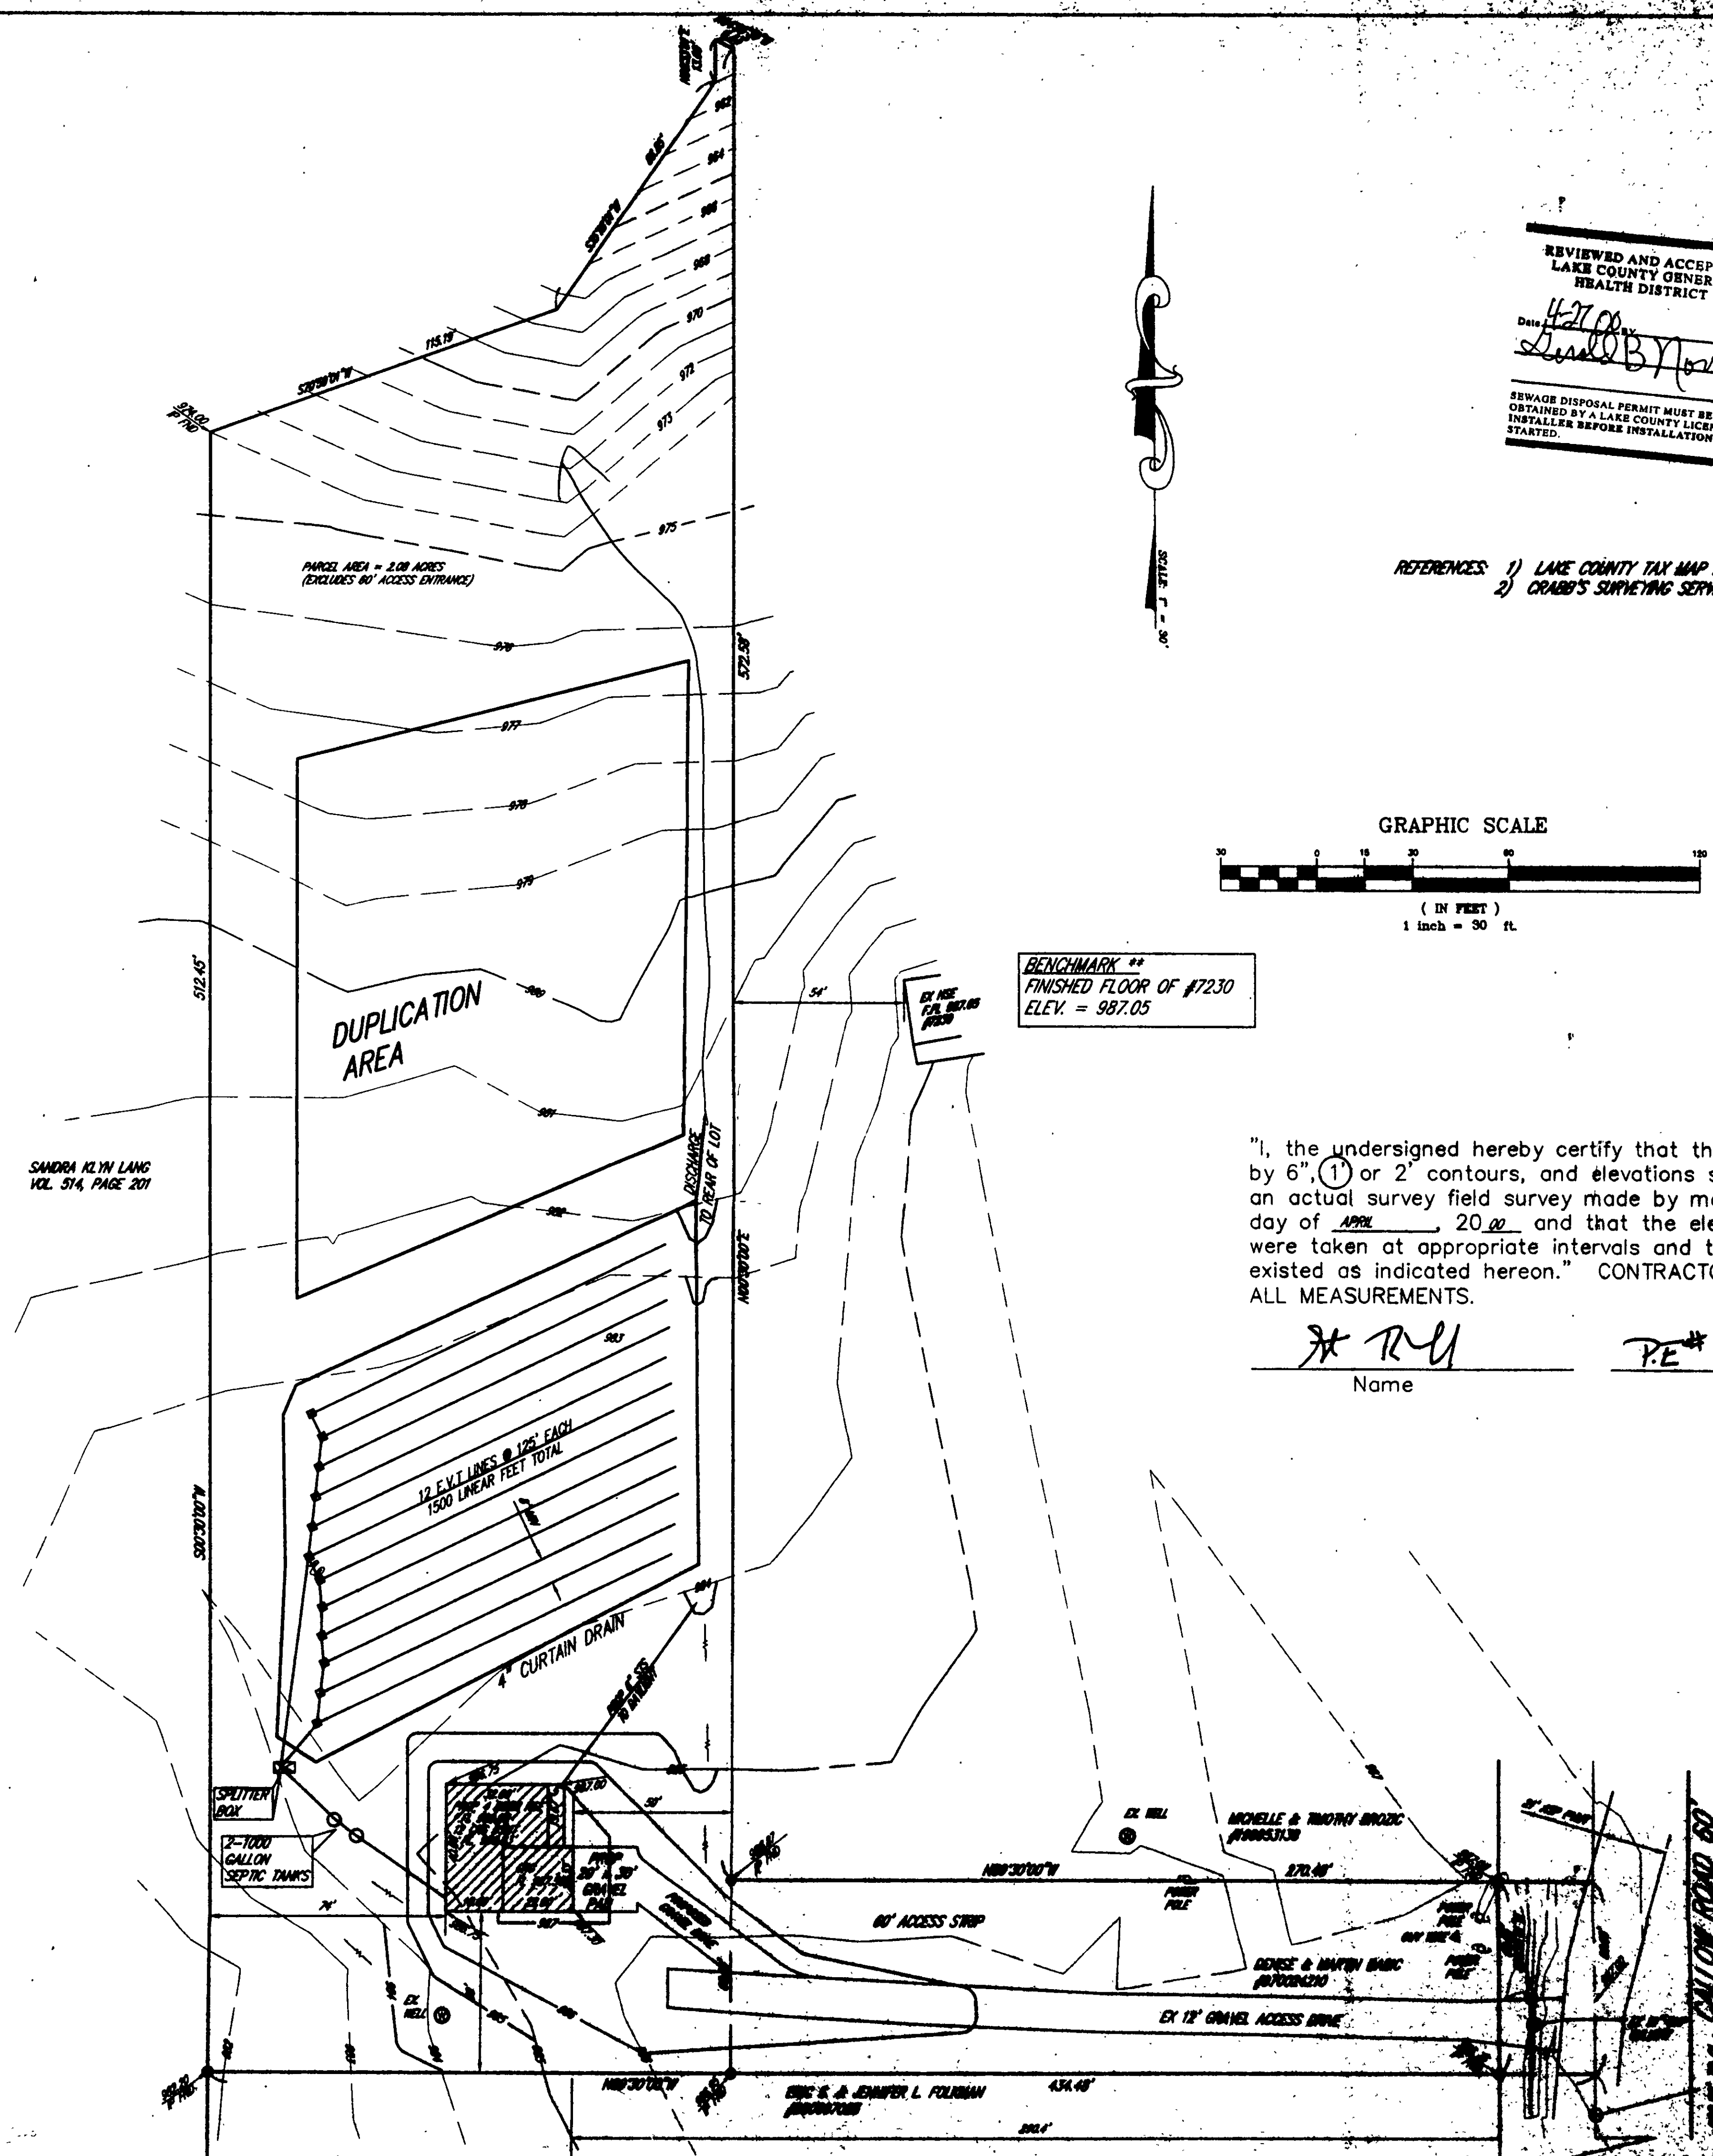

REVIEWED AND ACCEPTED
LAKE COUNTY GENERAL
HEALTH DISTRICT
Date: 4-27-00
Signature: [Signature]
SEWAGE DISPOSAL PERMIT MUST BE
OBTAINED BY A LAKE COUNTY LICENSED
INSTALLER BEFORE INSTALLATION IS
STARTED.

REFERENCES: 1) LAKE COUNTY TAX MAP RECORDS
2) GRABBS SURVEYING SERVICE - APRIL 1997

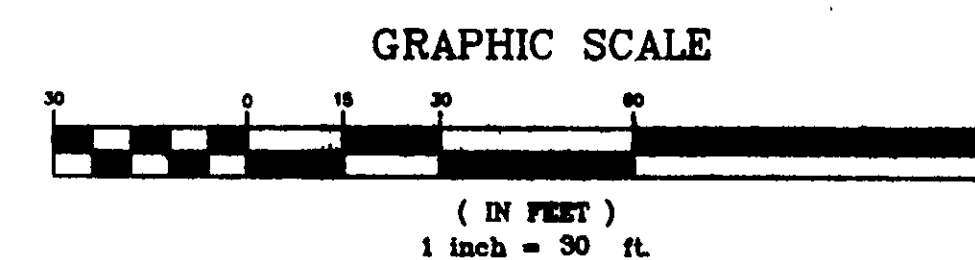

BENCHMARK **
FINISHED FLOOR OF #7230
ELEV. = 987.05

"I, the undersigned hereby certify that this topography, indicated by 6", 1" or 2" contours, and elevations shown hereon represent an actual survey field survey made by me on the 7th day of APRIL, 2000 and that the elevations were taken at appropriate intervals and that as of that date they existed as indicated hereon." CONTRACTOR SHALL FIELD VERIFY ALL MEASUREMENTS.

Name: [Signature]

P.E. # 63332
Reg. #

Grading Plan Approved
as shown and/or noted
THOMAS P. GILLES, P.E.
Lake County Engineer
By: [Signature] Date: 5/4/2000

SITE PLAN FOR
MARTIN BARRIC
235 S. CALLOW ROAD
LAKE COUNTY, INDIANA
43001-1000