

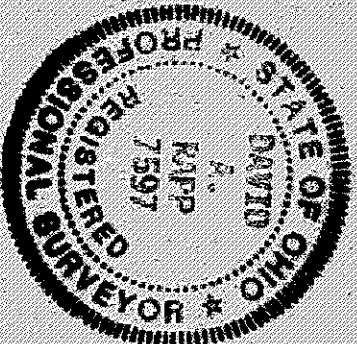



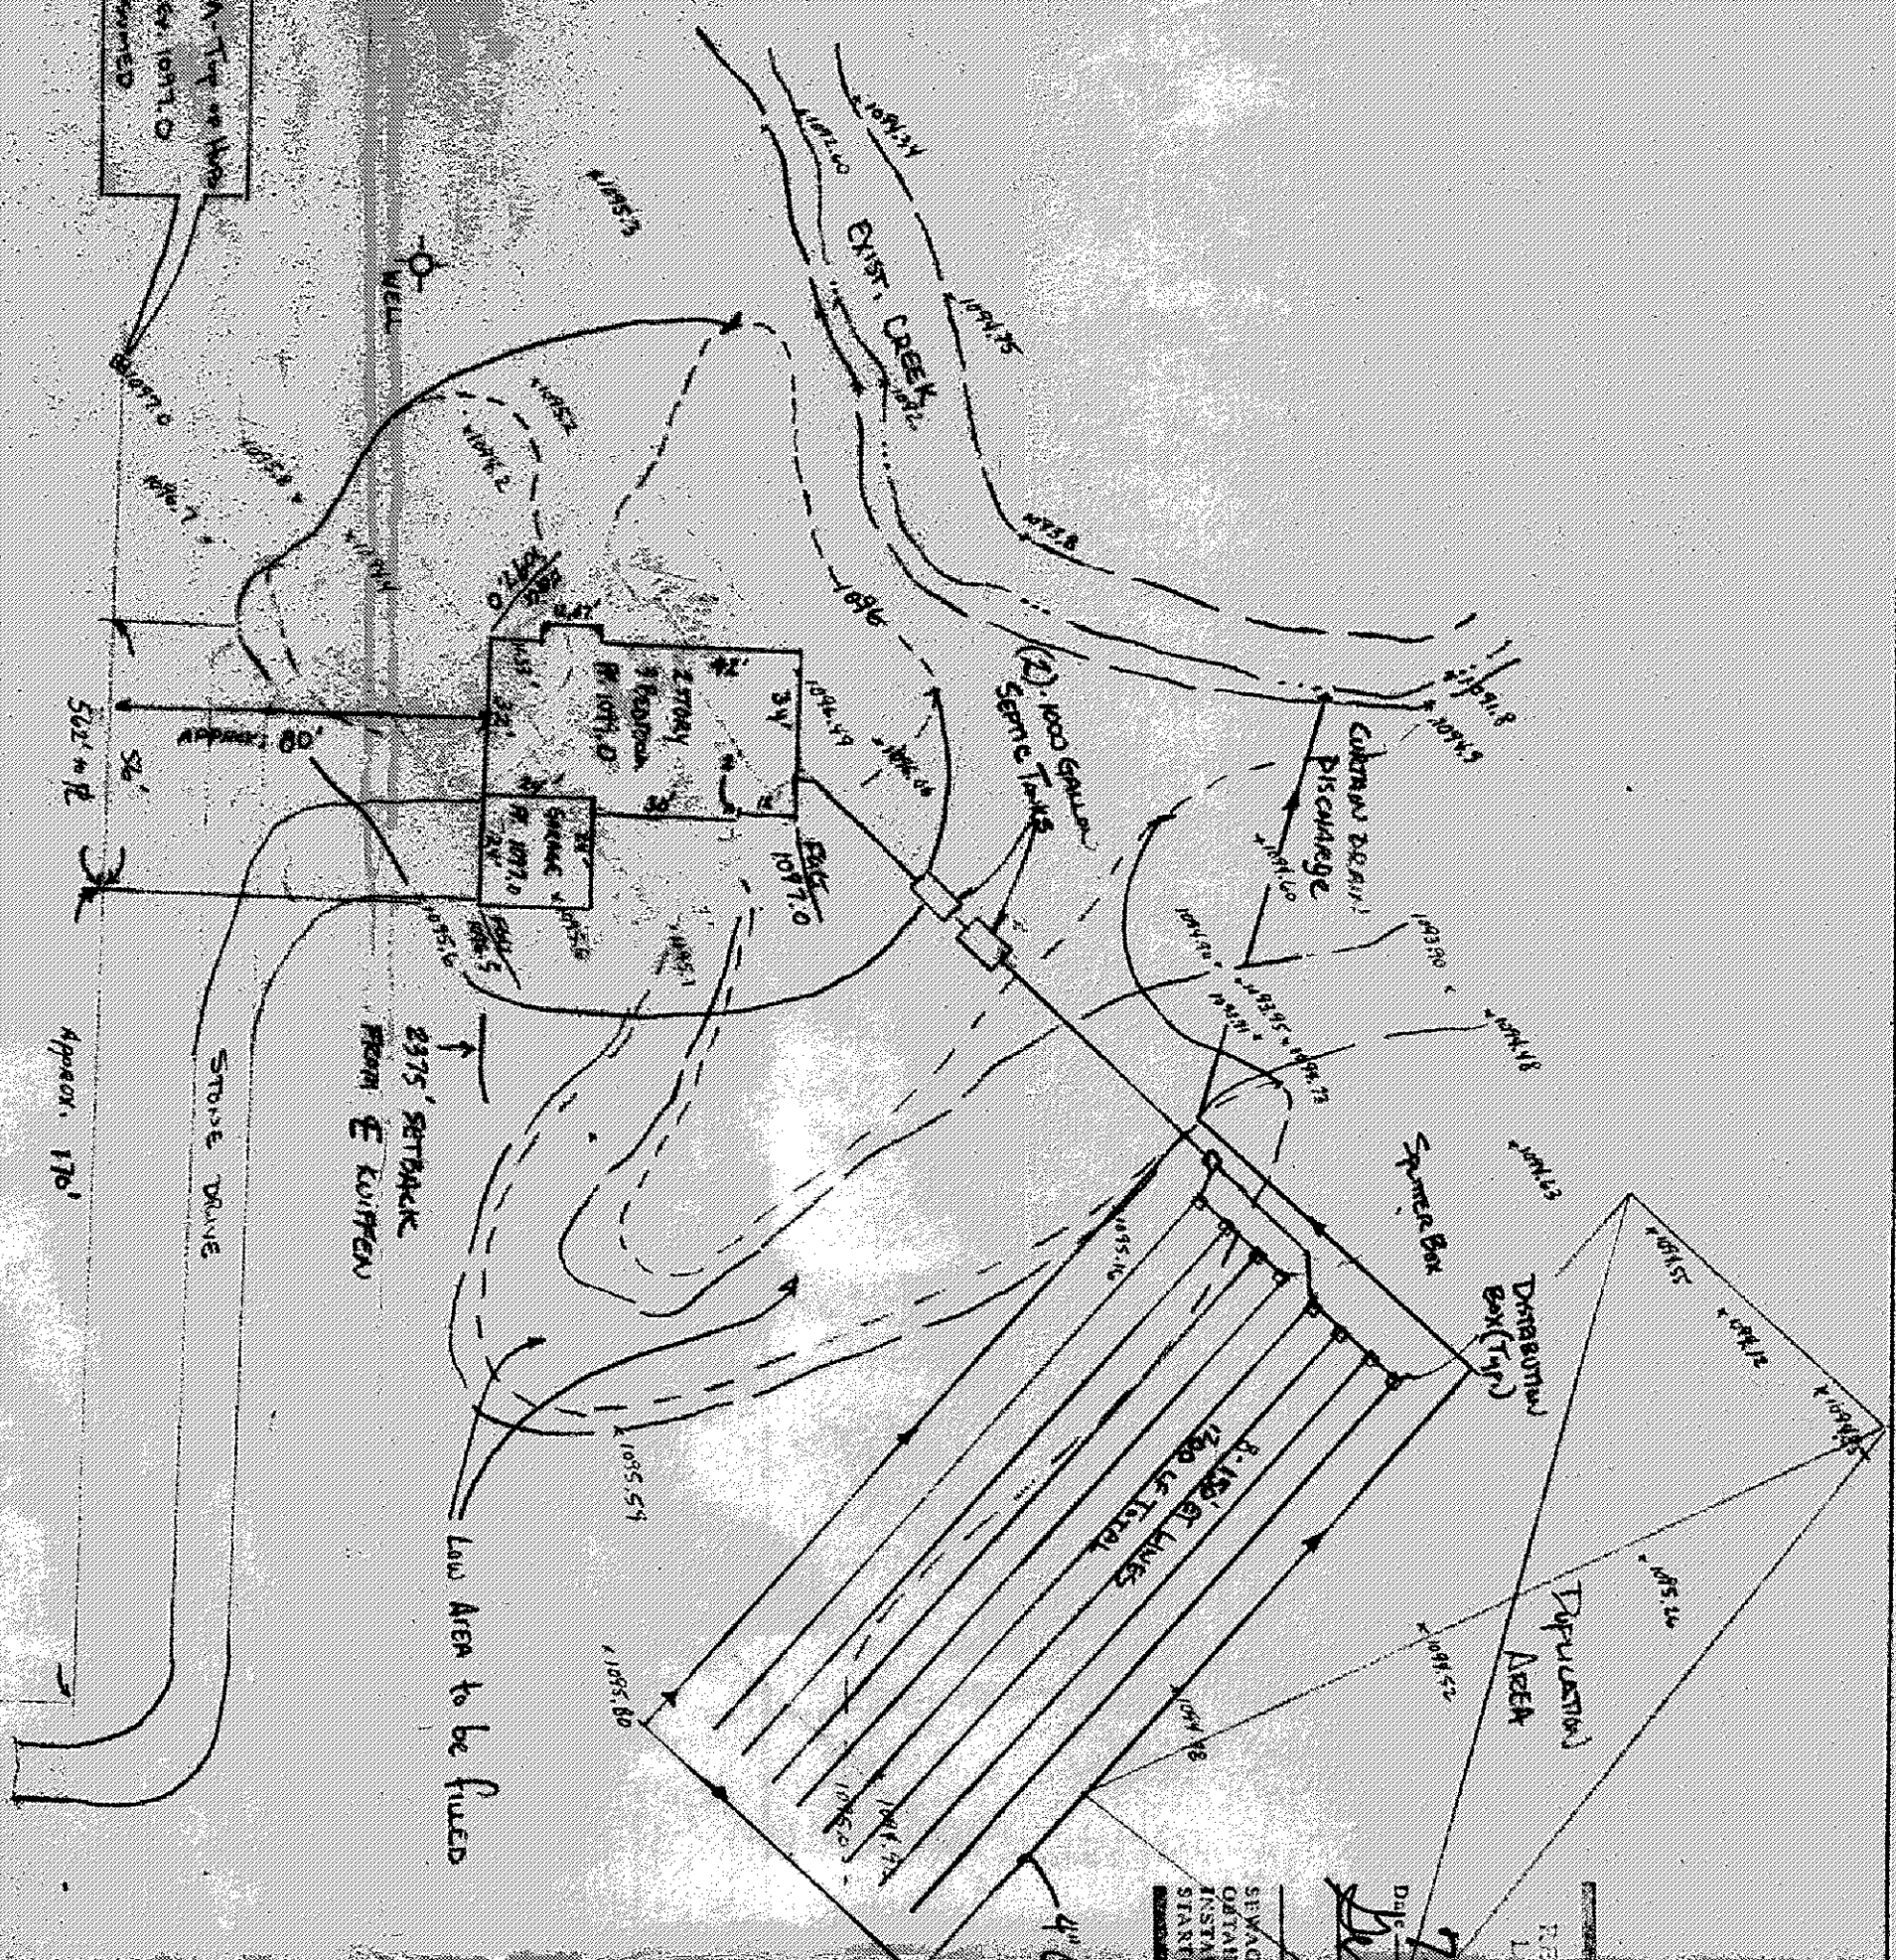


"I, the undersigned hereby certify that the topography shown hereon, indicated by one foot contours and elevations represents an actual field topographic survey made by me March 1997 and that the elevations were taken at appropriate intervals and that as of that date they existed as indicated hereon."

David A. Rapp
Registered Surveyor
7597
Reg. No.

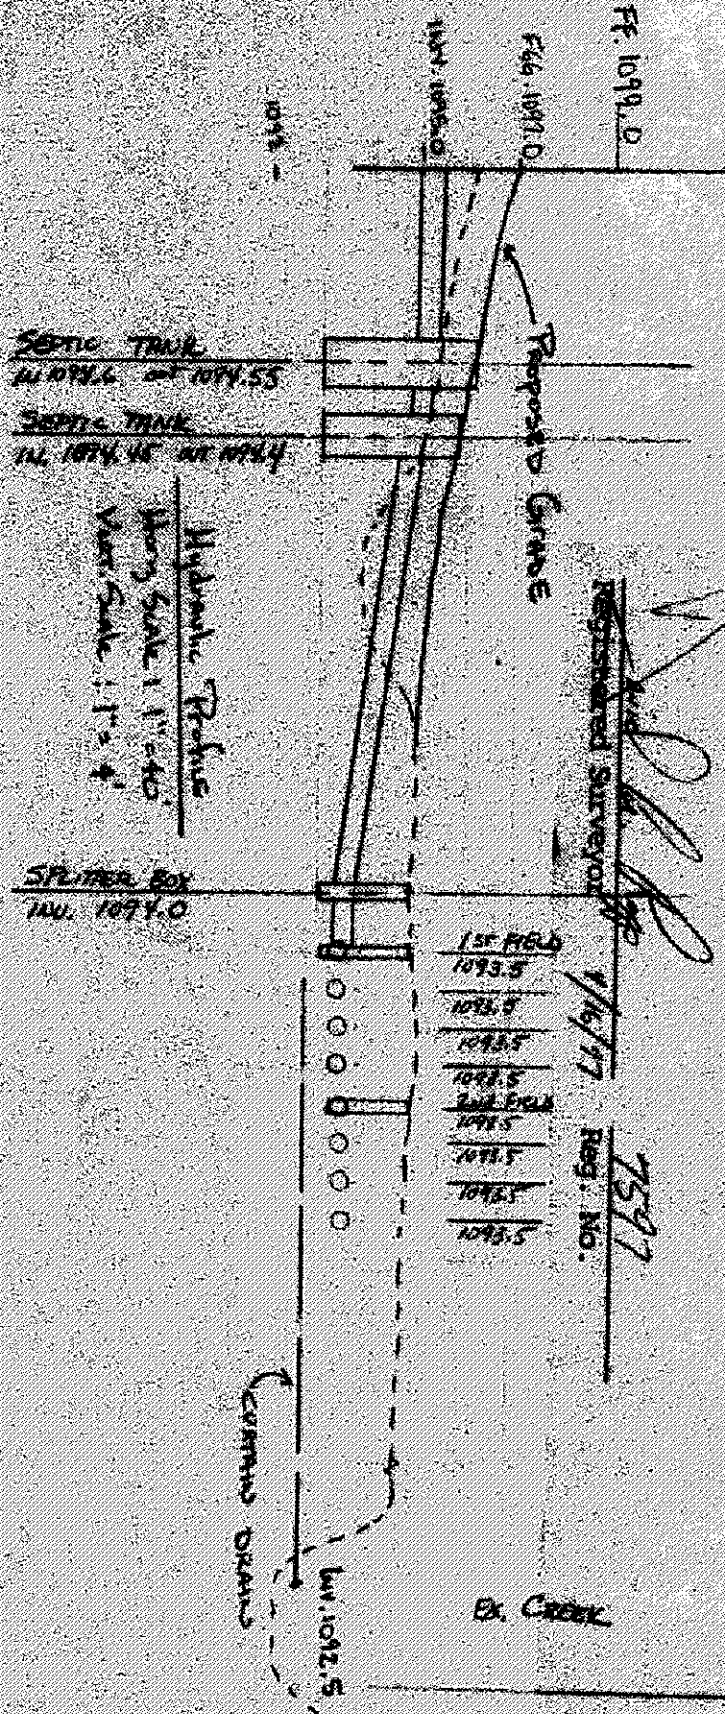

REVIEWED AND ACCEPTED
LAKE COUNTY GENERAL
HEALTH DISTRICT
7-11-97
BY David B. Davis
SEWAGE DISPOSAL PERMIT MUST BE
OBTAINED BY A LAKE COUNTY LICENSED
INSTALLER BEFORE INSTALLATION IS
STARTED.

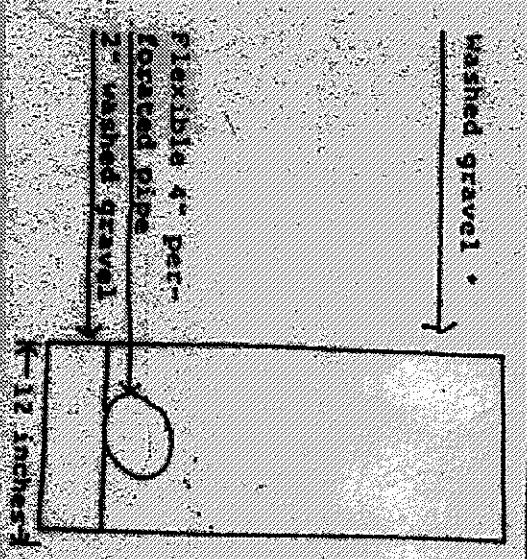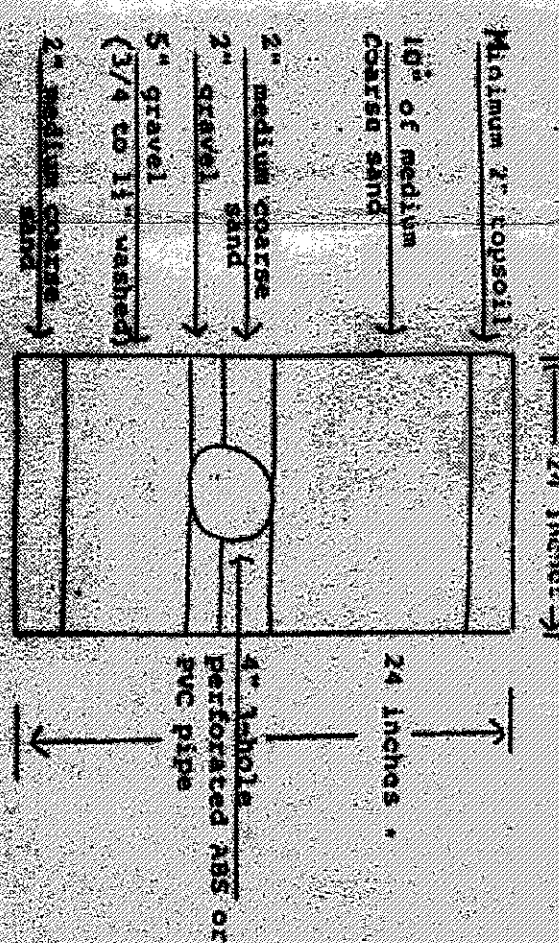

* The curtain drain must be 6 inches deeper than deepest E/I/leaching trench bottom.

* The standard E/I trench is 24 inches however the trench can vary between 18 inches to 30 inches deep if necessary. When trench depth varies, the sand at the top of trench will vary from 10 to 18 inches deep.

