

SITE PLAN

SAM JACKSON

BEING A PART OF TRACT No. 5,
IN THE TOWNSHIP OF MADISON,
COUNTY OF LAKE, STATE OF OHIO
SAM E. & MARY C. JACKSON
Vol. 117, p. 585


LOW YIELD WATER
FIXTURES REQUIRED
ON ALL:
Shower Head
Toilet

- To be brought to finished grade
 - Septic tank manhole covers
 - Soilifier box cover
 - Distribution box cover
- B. No footer drains or downspouts
to be discharged into septic tanks
C. All waste water to be discharged into
septic tanks

SEWAGE DISPOSAL PERMIT MUST BE
OBTAINED BY A LAKE COUNTY LICENSED
INSTALLER BEFORE INSTALLATION IS
STARTED.


Reviewed and Accepted
LAKE COUNTY GENERAL HEALTH DISTRICT
Date 1-15-91
JOEL LUCIA, R. S., M. P. H.
Health Commissioner
By *[Signature]*

CURTAIN DRAIN DETAIL

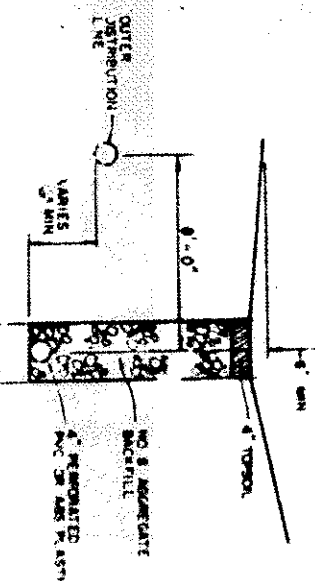

HYDRAULIC PROFILE


VERT. 1" = 5' HORIZ. 1" = 30'

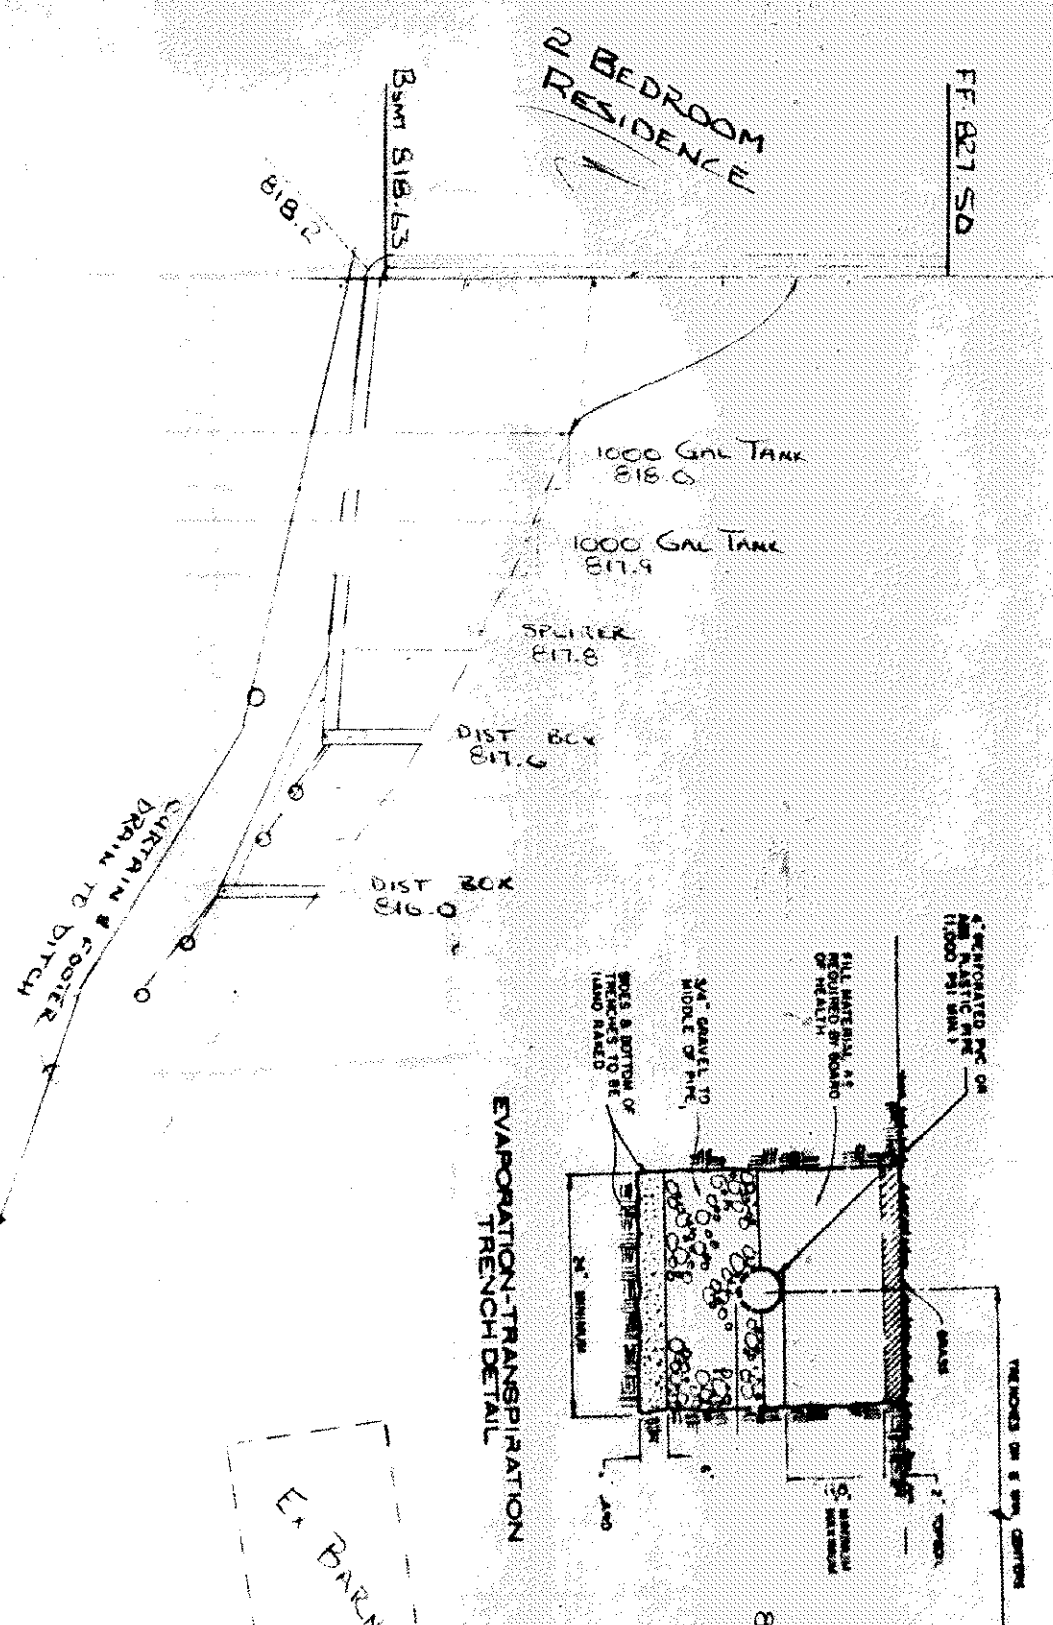

I, the undersigned hereby certify that
this map was indicated by J. contours
and elevations shown hereon represent an
actual field survey made by me on 12-27-90
and that the elevations were taken at
appropriate intervals and that as of the
date they existed as indicated hereon.



VILLAGE SURVEYING CO.
202 THIRD ST. FAIRPORT, OHIO 44027
CALL 337-1245

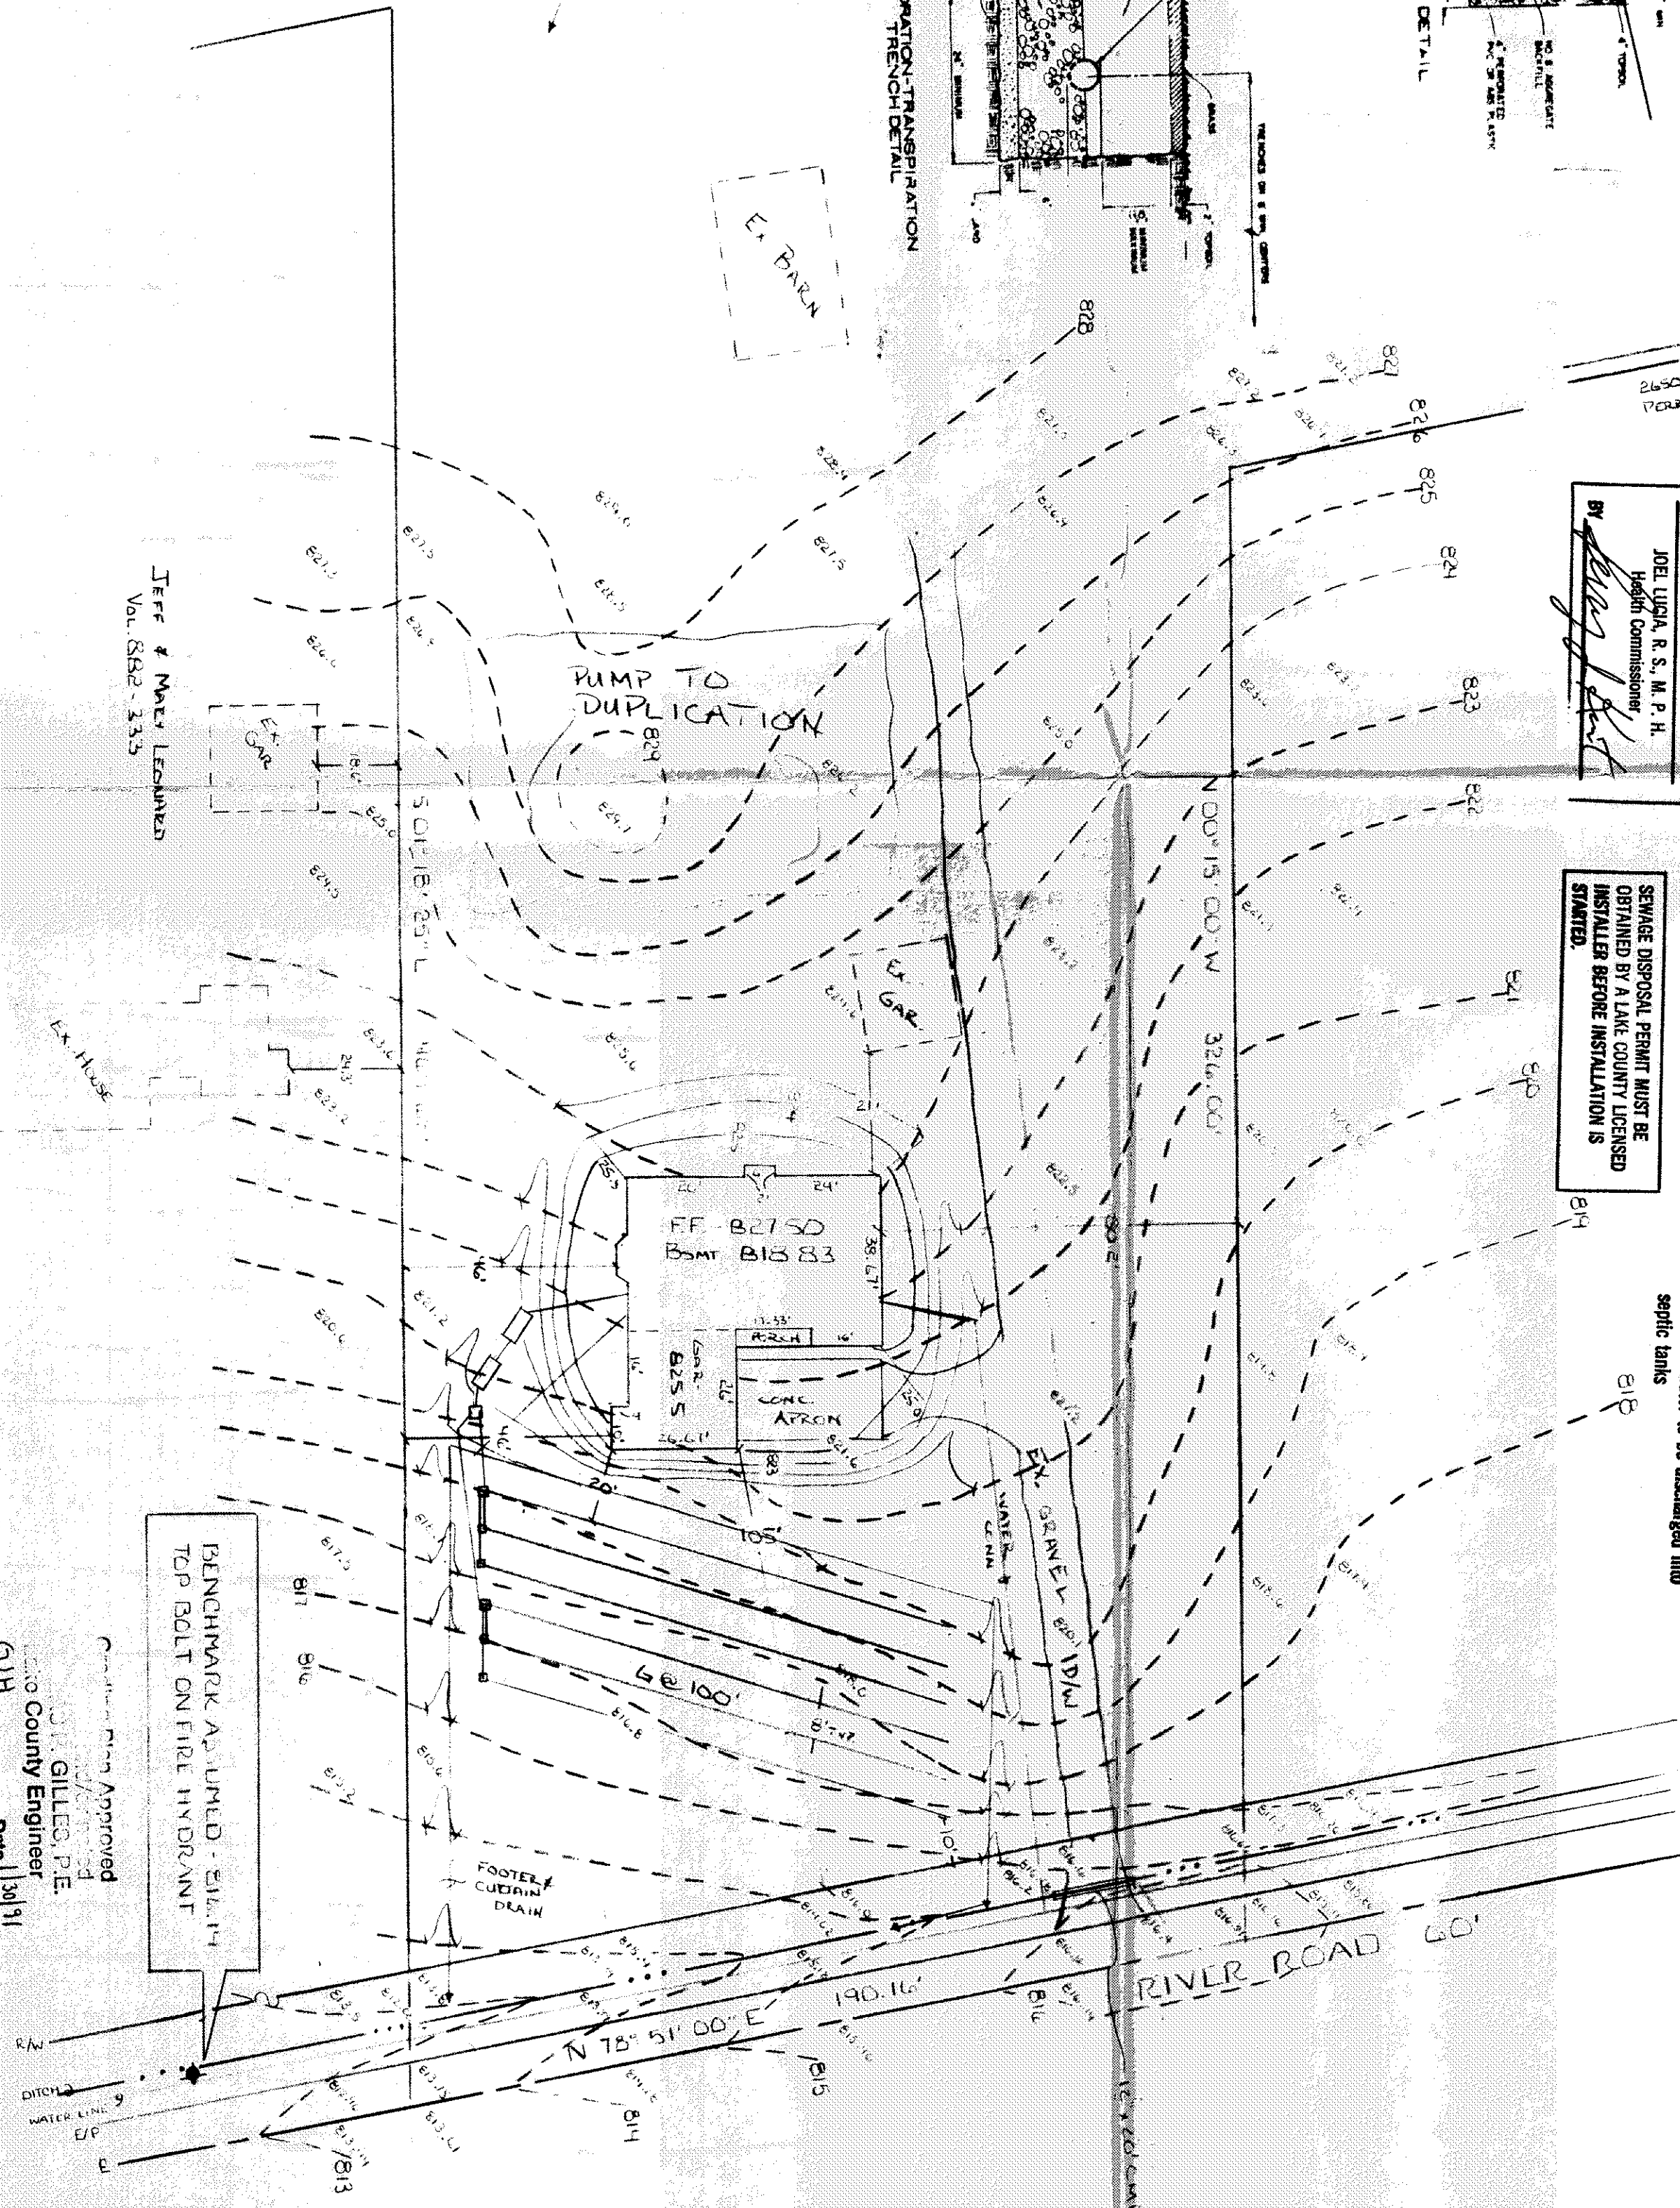

Condition Approved
By G/H
Date 1/30/91

