

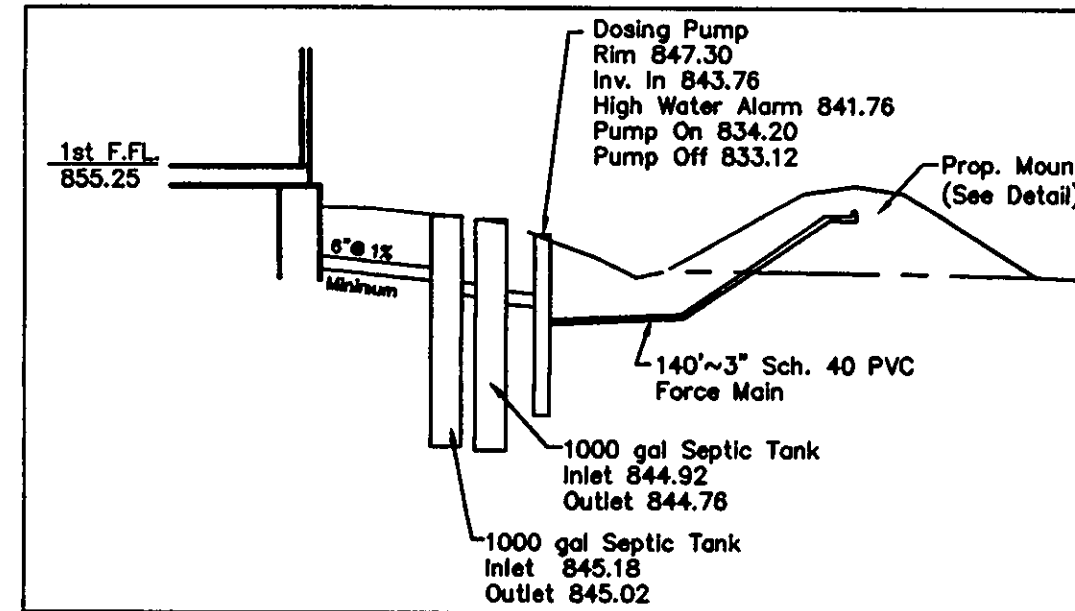


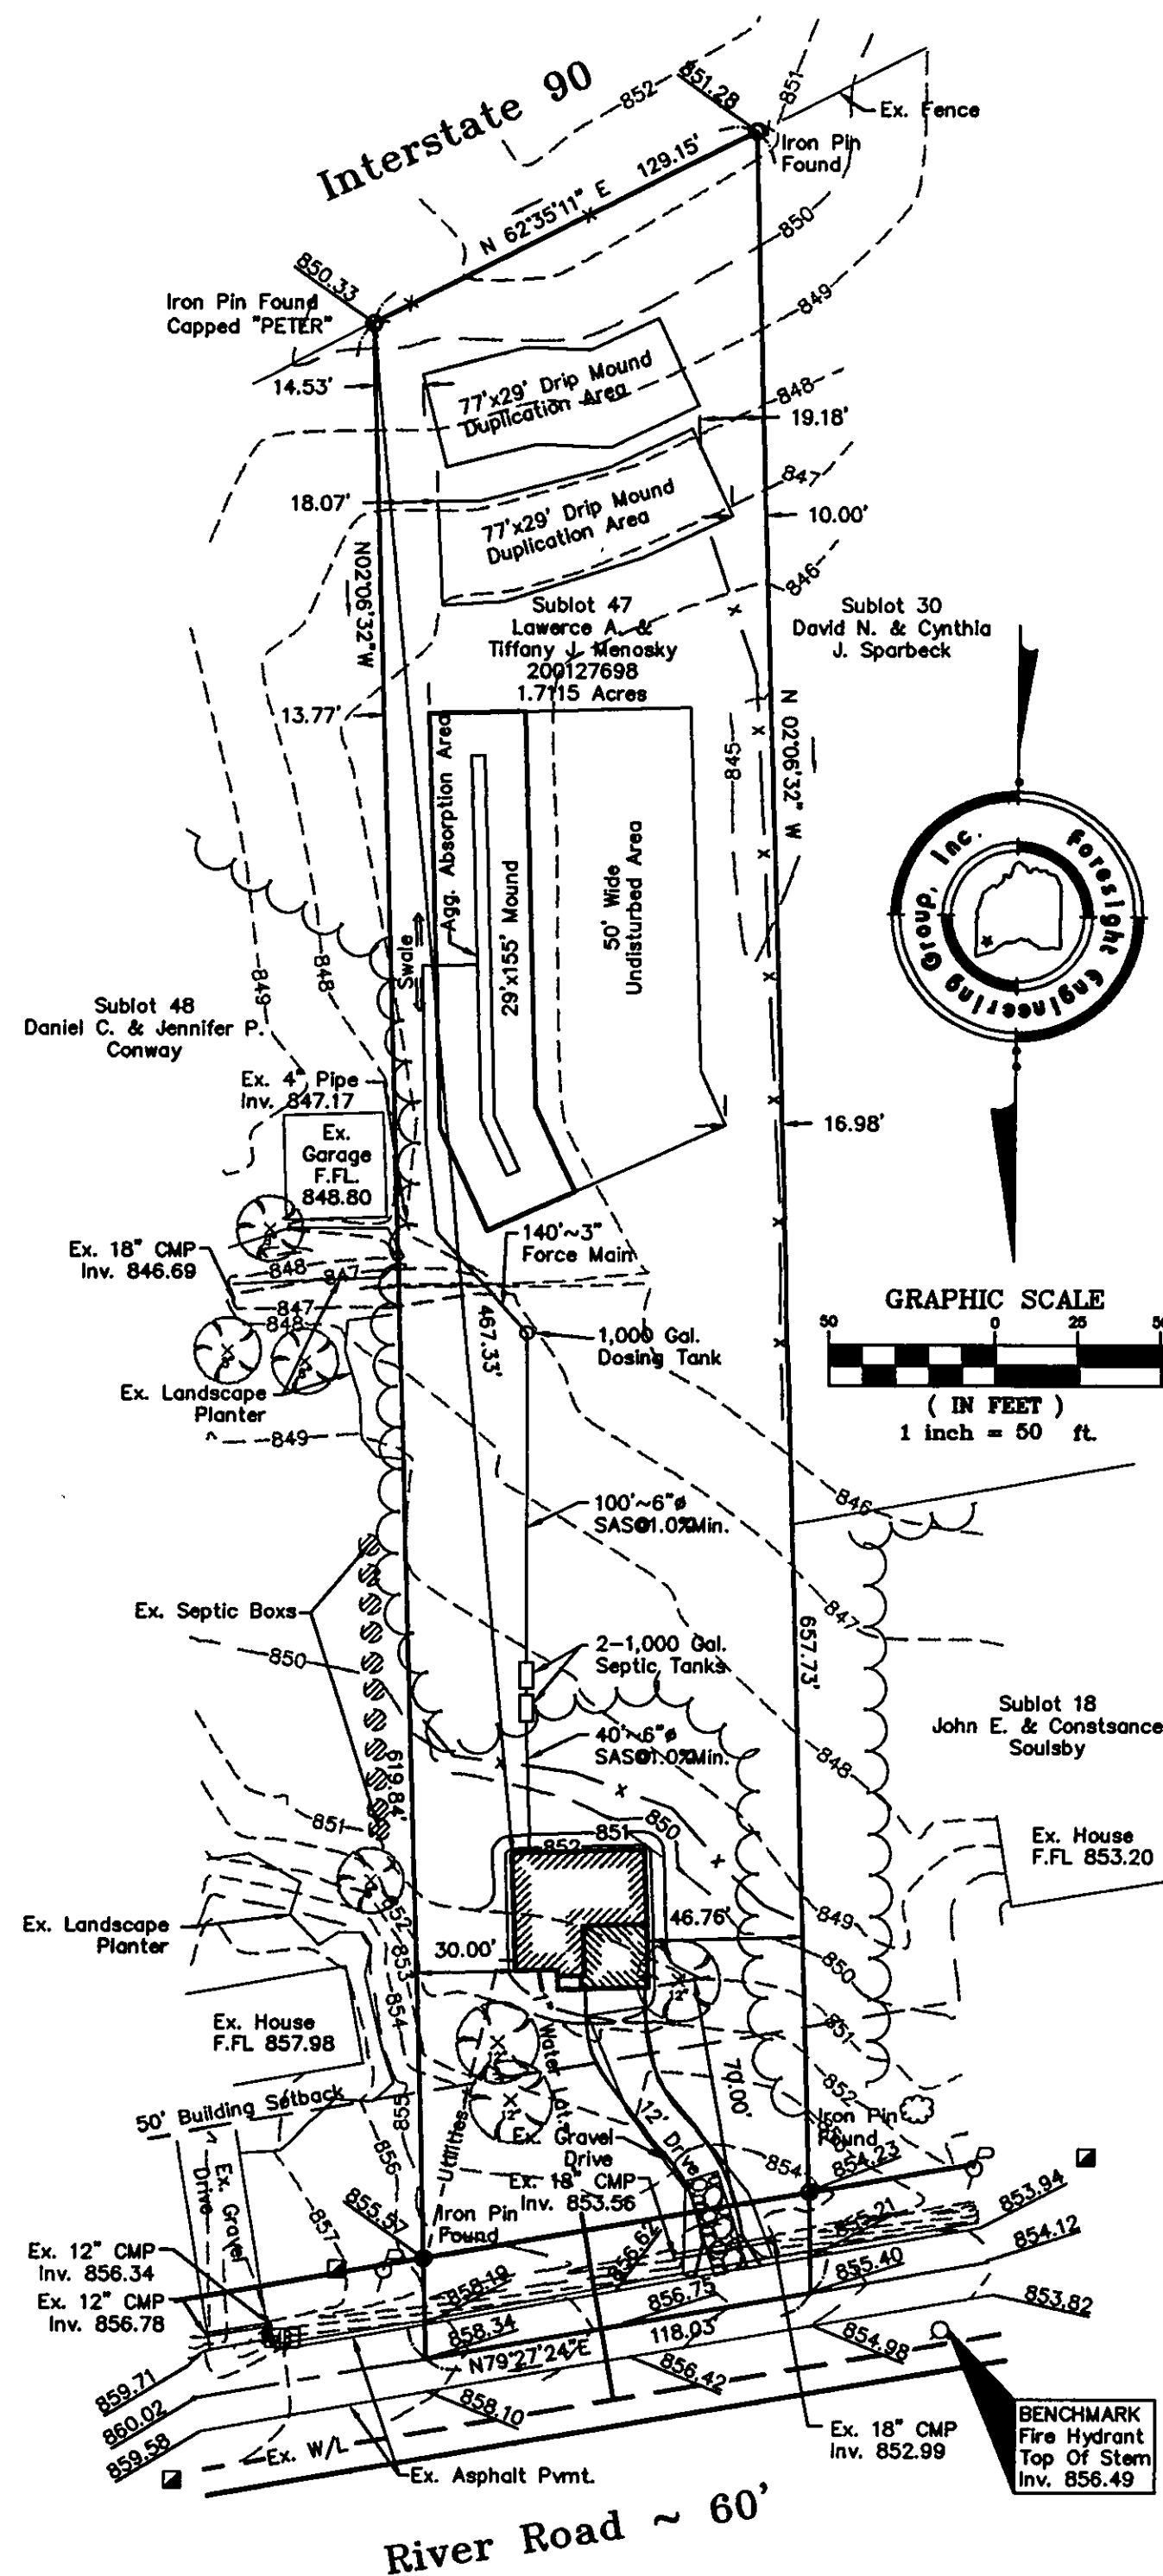

Hydraulic Profile
No Scale

- Notes:**
1. Screen strainer shall be included on discharge tee of second septic tank and should be readily accessible and cleanable. It shall remove materials larger than 1/8" in greatest dimension.
 2. Pump Size: 60 gpm @ 21 ft. TDH.
 3. Sand fill and absorption aggregate shall be per Lake County General Health District specifications.
 4. Mound sizing per Gerald Norris of the Lake County General Health District.
 5. Mound to be constructed from side.
 6. Dosing tank design based on 4" tank.

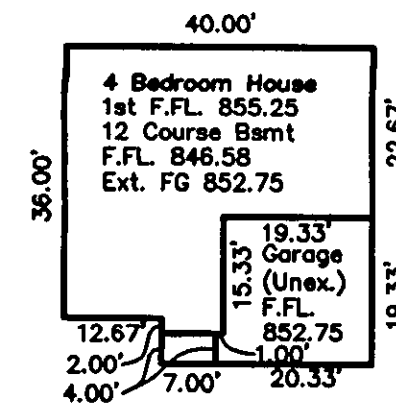

REVIEWED AND ACCEPTED
LAKE COUNTY GENERAL
HEALTH DISTRICT

Date 9-6-01 BY
Gerald B. Norris

SEWAGE DISPOSAL PERMIT MUST BE
OBTAINED BY A LAKE COUNTY LICENSED
INSTALLER BEFORE INSTALLATION IS
STARTED

SYMBOL LEGEND

	Iron Fin Found
	Power Pole
	Fire Hydrant
	Water Meter
	Mail Box
	Gate Valve
	Tree (Size)
	Clean Out
	Bush

Grading Plan Approved
as shown and/or noted
JAMES R. GILLS, P.E.
Lake County Engineer

By TAM Date 9-18-01

SITE PLAN

for : **Lawrence & Tiffany Jo Menosky**
CLIENT
P.O. Box 115 Chardon, Ohio 44024
ADDRESS CITY STATE ZIP

SUBLOT No. SUBDIVISION NAME VOL. PAGE
P.P. # 1A-18-47 Madison Twp. Ohio
LOT TRACT CITY STATE

Foresight Engineering Group
Engineers & Surveyors
440 286-1010
440 286-1034 fax
320 Center Street, Unit F
Chardon, Ohio 44024

SCALE : 1" = 50 1
FILE NAME: 2
I: \Men2-0101\siteplan
DATE : August 31, 2001 3

BENCHMARK: Fire Hyd. Top Stem 856.49


SHEET NO.
1/3

EROSION CONTROL SYMBOLS

- Filter Fabric Erosion Control
- Silt Fence
- Construction Entrance

Zoning District ~ A1
Front Setback 50'
Side Setback 15'
Sum Of Sides 35'
Rear Setback 40'

Utilities include Gas line,
Electric, Phone and Cable.
Contractor to field verify
location and provide
connection at utility.

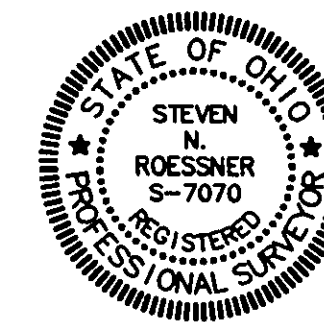

"I, the undersigned hereby certify that this topography,
indicated by 6", 1' or 2' contours, and the elevations
shown hereon represent an actual field survey made by
Foresight Engineering Group, Inc. on the 8 day of August,
2001 and that the elevations were taken at appropriate
intervals and that as of that date they existed as
indicated hereon."

NAME

EXISTING UNDERGROUND UTILITIES NOTES:
The location both horizontal and vertical of the underground utilities
shown hereon, have been obtained by a diligent and comprehensive
search of available records. Verification by field observation, has been
conducted where practical. However, Foresight Engineering Group, Inc.
does not guarantee the completeness nor accuracy thereof.