



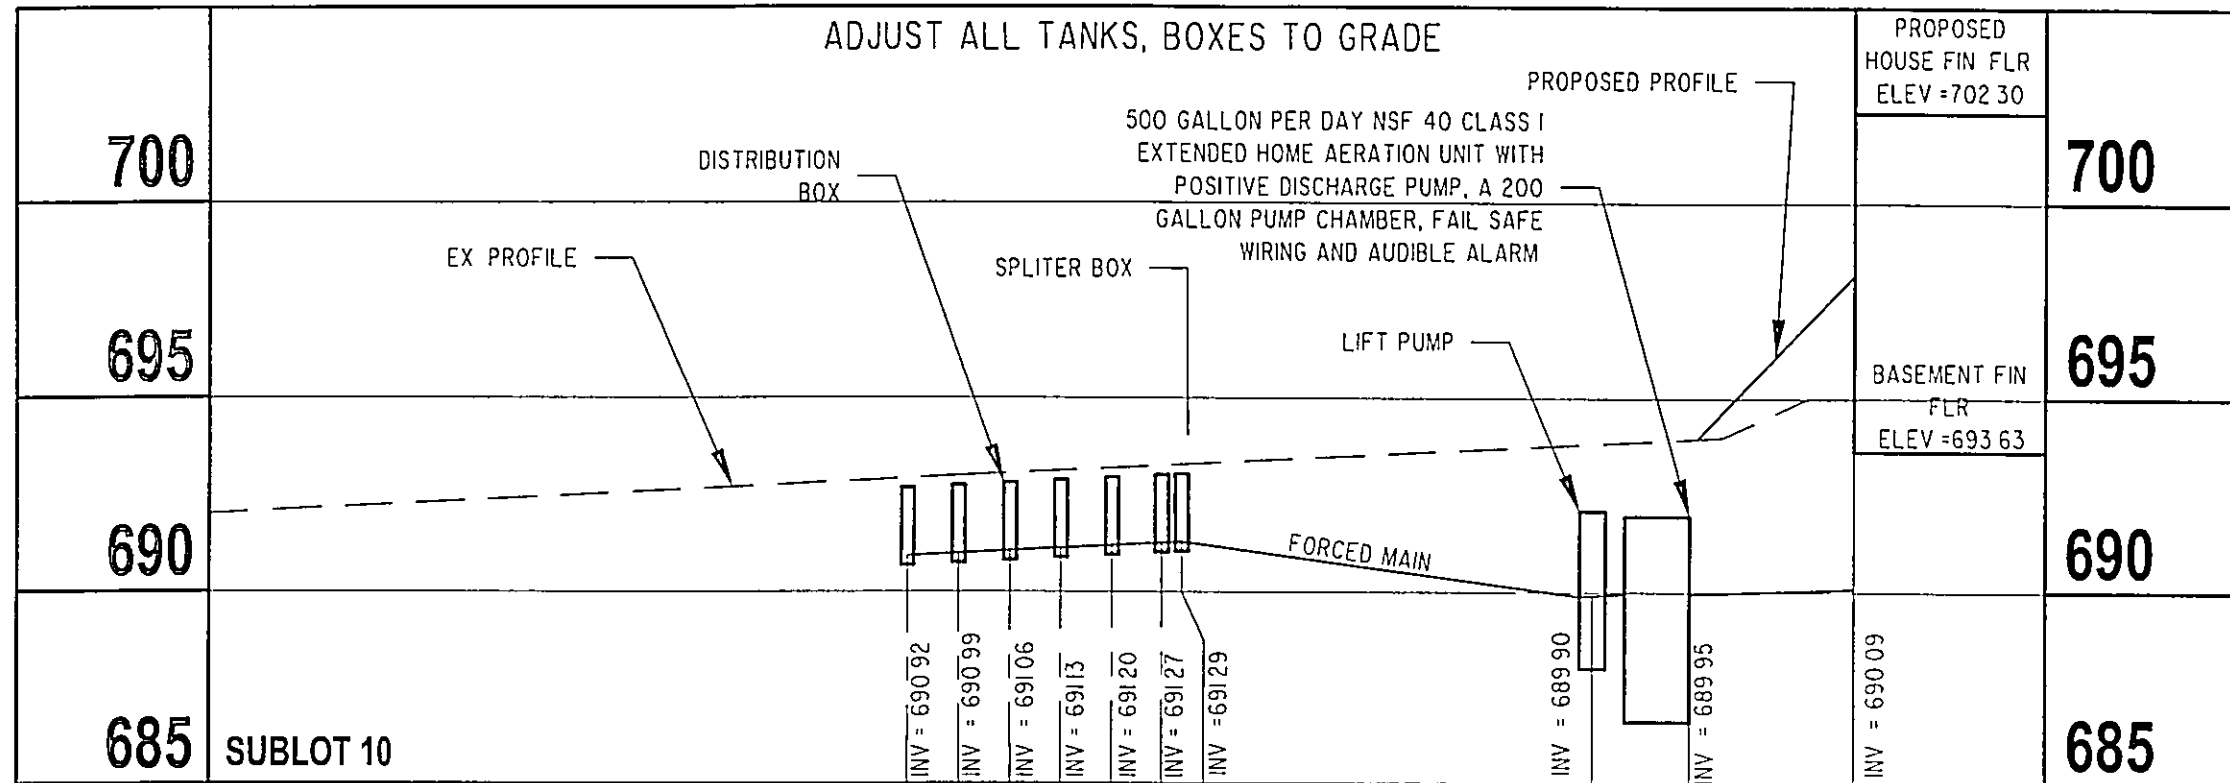

* THE STANDARD ET TRENCH IS 24 INCHES HOWEVER THE TRENCH CAN VARY BETWEEN 18 INCHES TO 30 INCHES DEEP IF NECESSARY GRAVEL REQUIREMENT IS STANDARD - AMOUNT OF BACKFILL WOULD VARY

4" 3- HOLE PERFORATED ABS OR PVC PIPE

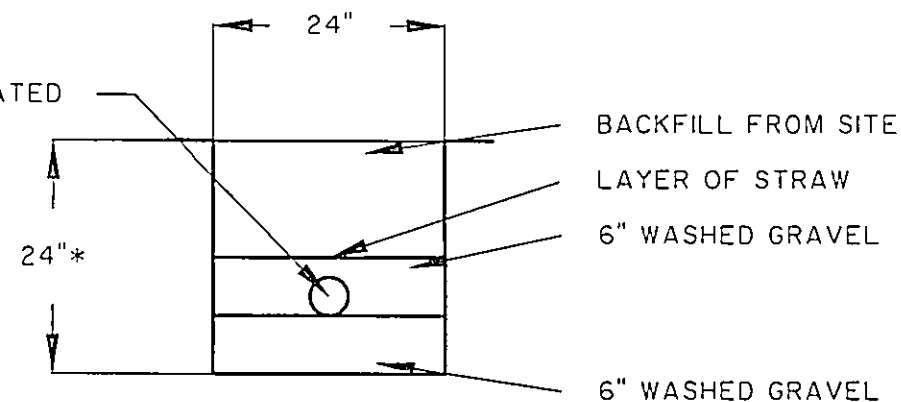

TYPICAL LEACHING TRENCH CROSS SECTION

REVISIONS	BY

Barrington
CONSULTING GROUP, INC.
38342 WESTERN PARKWAY, SUITE 10
WILLOUGHBY, OHIO 44094
PHONE 440.946.1761 FAX 440.918.0486



PROFILE/DETAIL
SUBLOT 10, BELLMORE ROAD, PAINESVILLE TWP.
BELLMORE SUBDIVISION
LITTLE MOUNTAIN HOMES, INC.

DRAWN	WSO
CHECKED	DWN
DATE	JUNE 30, 2004
SCALE	1" = 30'
JOB NO	02007-10
SHEET	3/3