



W:\2002\02007\02007-12.dwg, 02/23/04 04:45:03 PM, Copyright Barrington Consulting Group

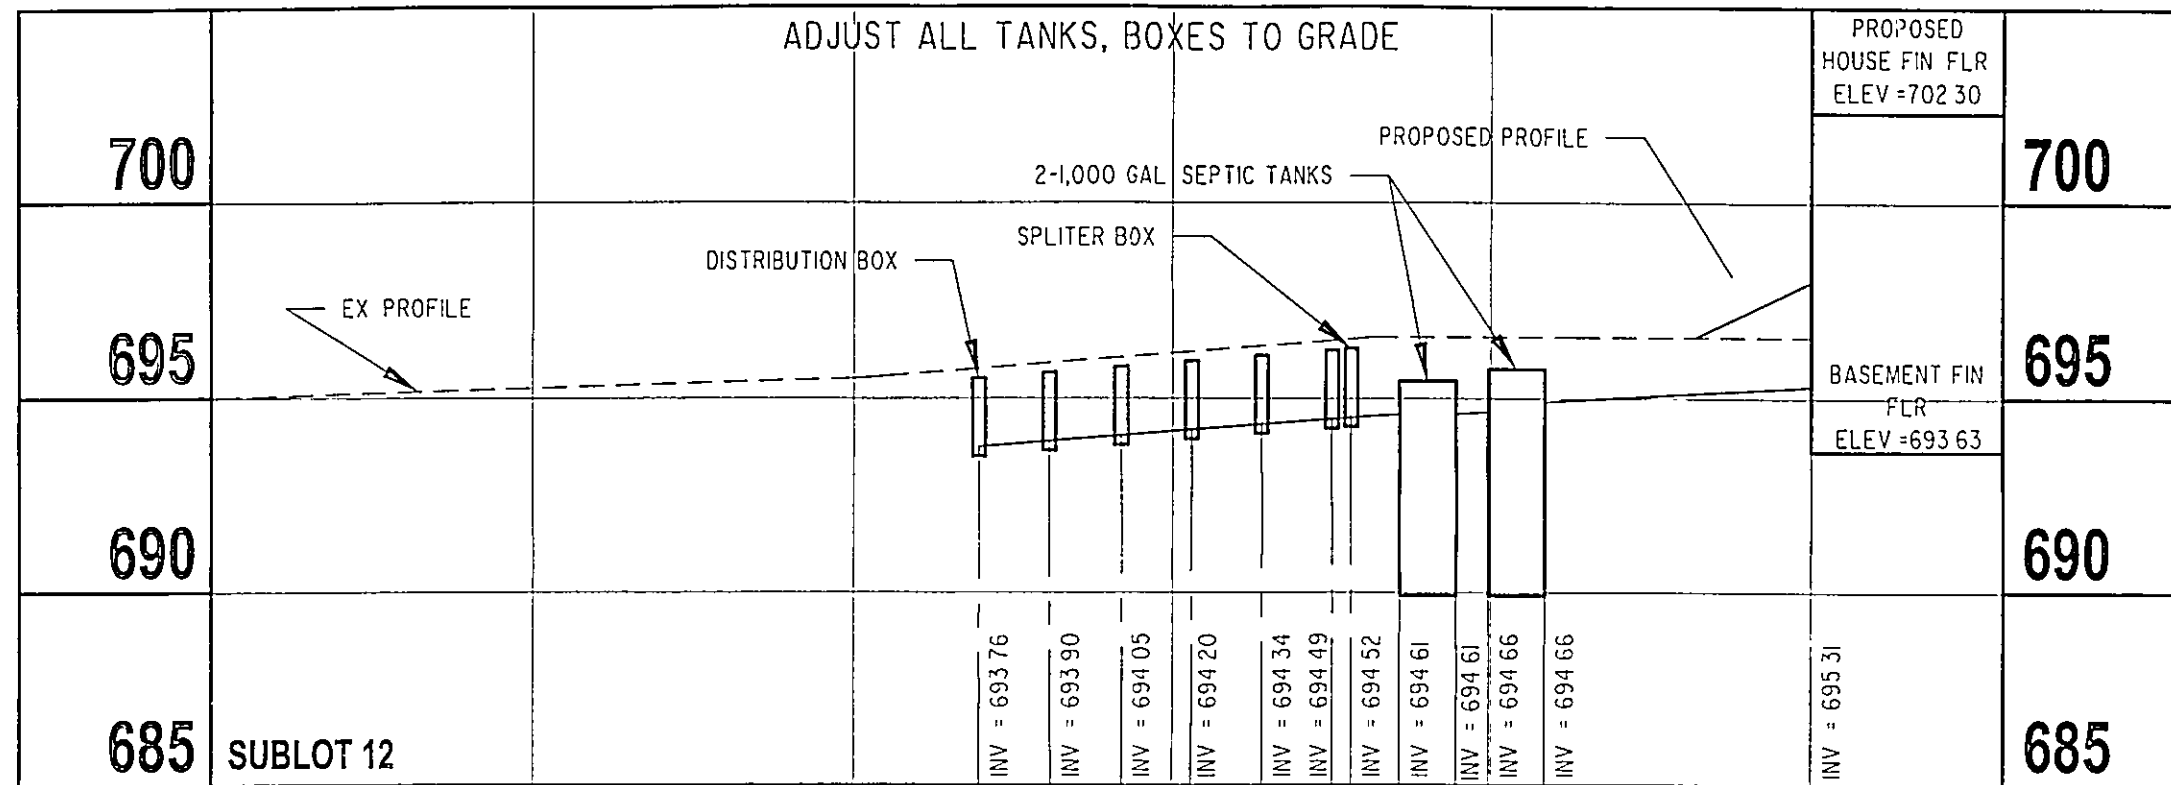

* THE STANDARD ET TRENCH IS 24 INCHES
HOWEVER THE TRENCH CAN VARY BETWEEN
18 INCHES TO 30 INCHES DEEP IF NECESSARY
GRAVEL REQUIREMENT IS STANDARD
- AMOUNT OF BACKFILL WOULD VARY

4" 3- HOLE PERFORATED
ABS OR PVC PIPE

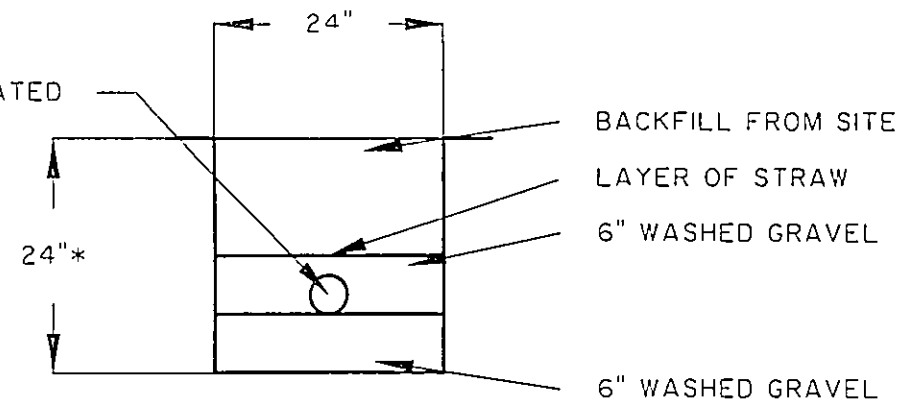

TYPICAL LEACHING TRENCH CROSS SECTION

REVISIONS	BY

Barrington
CONSULTING GROUP, INC.
38342 WESTERN PARKWAY, SUITE 10
WILLOUGHBY, OHIO 44094
PHONE 440.946.1761 FAX 440.918.0486



PROFILE
SUBLOT 12, BELLMORE ROAD, PAINESVILLE TWP.
BELLMORE SUBDIVISION
LITTLE MOUNTAIN HOMES, INC.

DRAWN WSO
CHECKED DWN
DATE FEB 23, 2004
SCALE NONE
JOB NO. 02007-12
SHEET 3/3