

REVISIONS	BY


Barrington
CONSULTING GROUP, INC.
9114 TYLER BLVD., MENTOR, OHIO 44060
PHONE 440.205.1260 FAX 440.205.1262
BCG@BarringtonCGI.com




DETAILS
SIL 5 BELLMORE DR. PAINESVILLE TWP. OH. 44077
BELLMORE SUBDIVISION VOL. 44 PG. 21
LITTLE MOUNTAIN HOMES, INC.

DRAWN
WSO
CHECKED
DWN
DATE
JULY 26, 2005
SCALE
NONE
JOB NO
02007-05
SHEET
4/5

OF
SHEETS

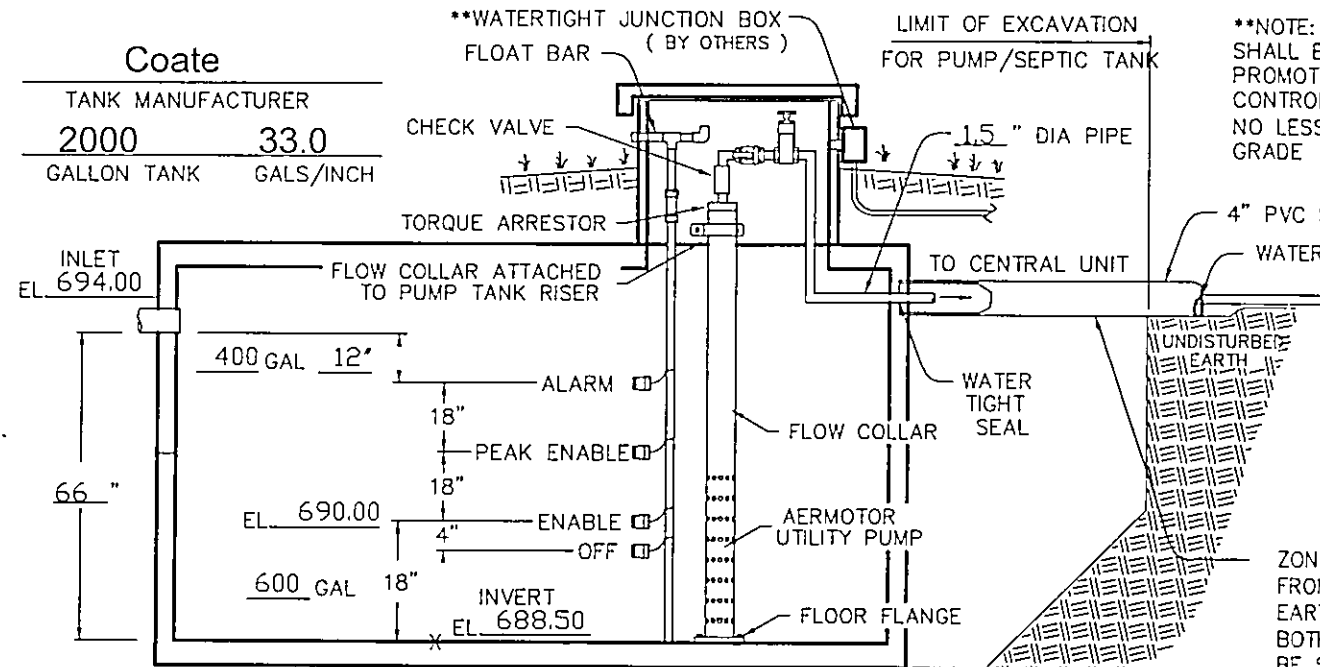


DRIP PUMP TANK DETAIL
NTS

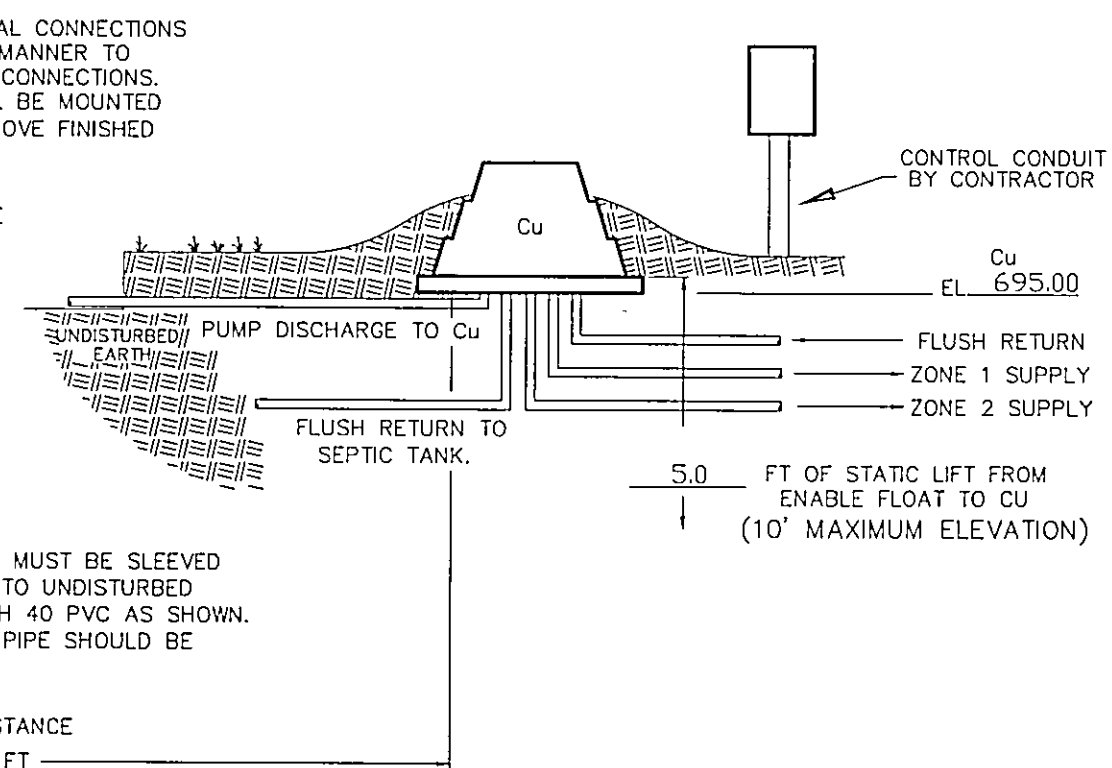


****NOTE: ALL ELECTRICAL CONNECTIONS SHALL BE MADE IN A MANNER TO PROMOTE WATERTIGHT CONNECTIONS. CONTROL PANEL SHALL BE MOUNTED NO LESS THAN 48" ABOVE FINISHED GRADE**

ZONE SUPPLY PIPE MUST BE SLEEVED FROM PUMP TANK TO UNDISTURBED EARTH WITH 4" SCH 40 PVC AS SHOWN. BOTH ENDS OF 4" PIPE SHOULD BE BE SEALED.

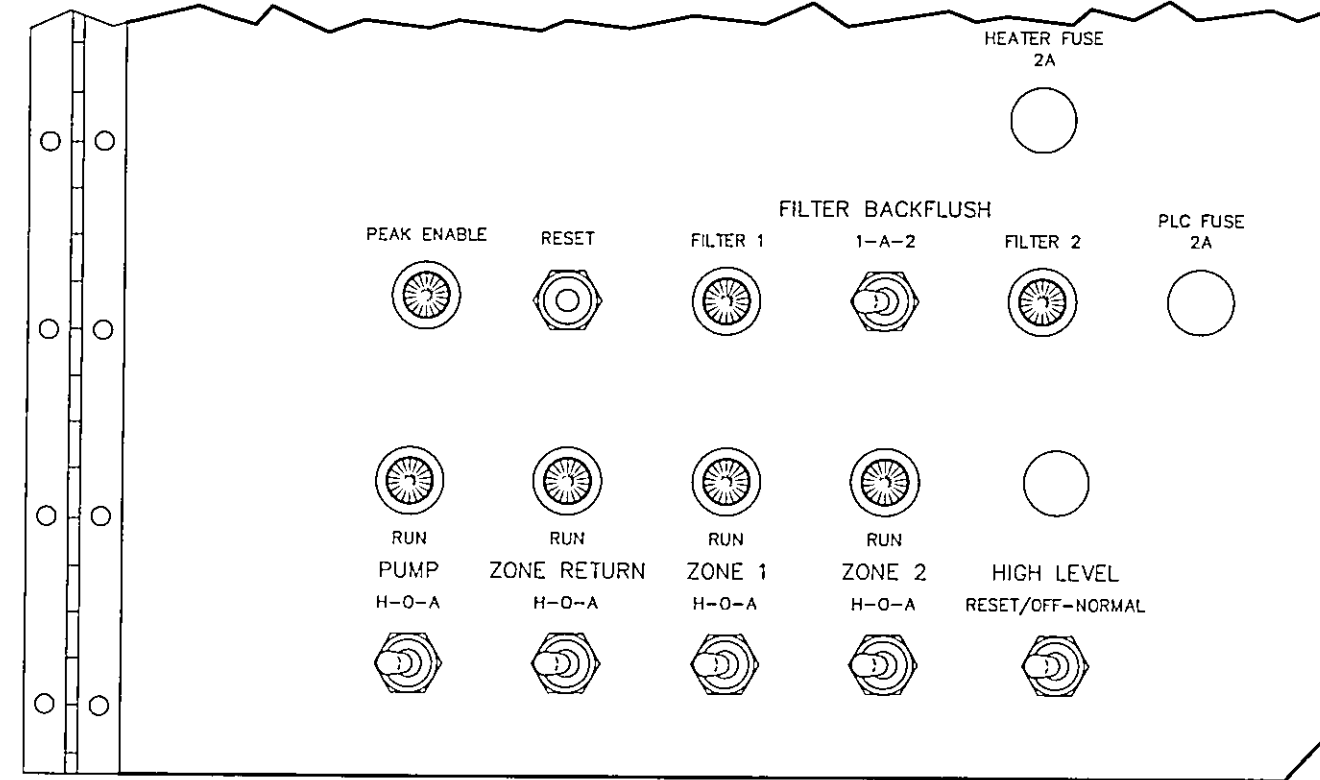

INNER DOOR LAYOUT
NTS

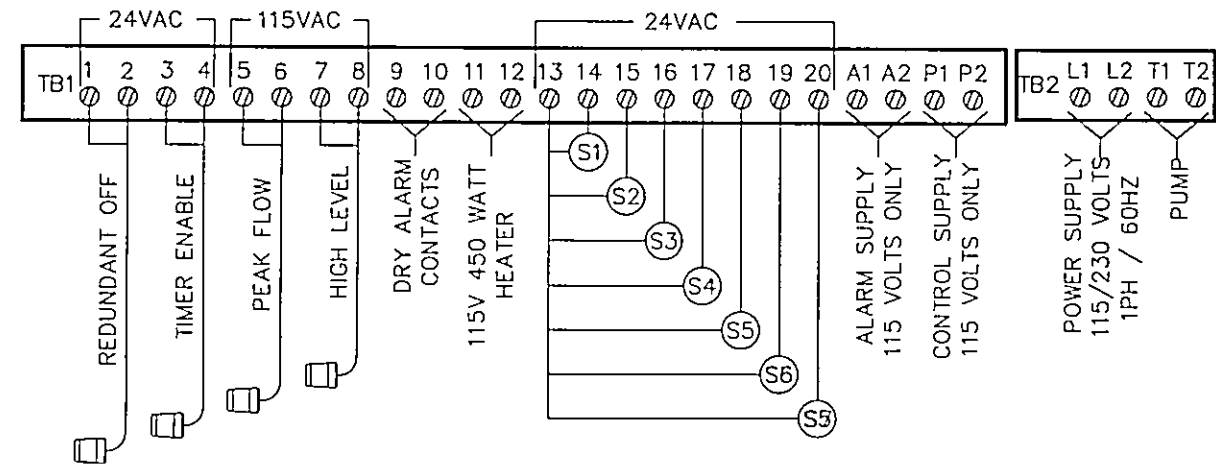

PUMP & CONTROL DETAIL