



\\2002\02007\02007-19.dwg, 07/22/04 07:28:08 AM, Copyright Barrington Consulting Group

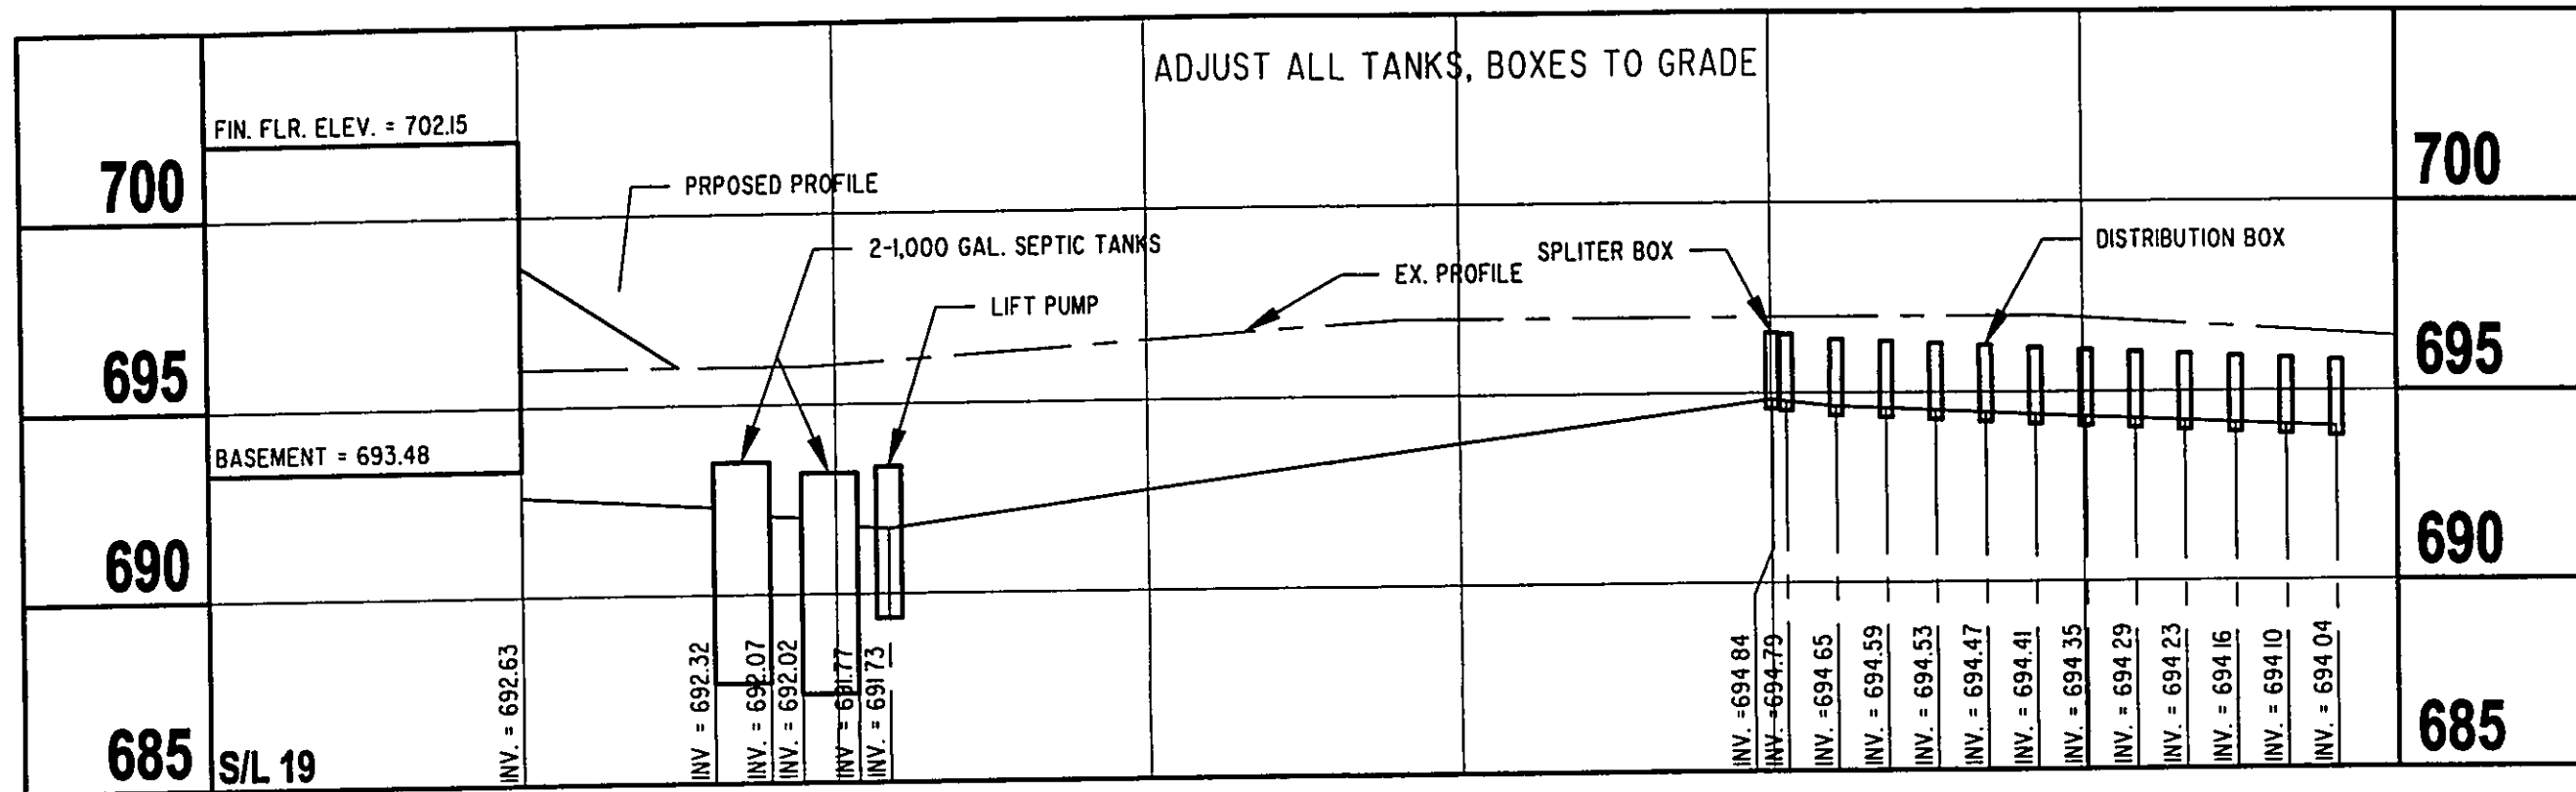

* THE STANDARD ET TRENCH IS 24 INCHES
HOWEVER THE TRENCH CAN VARY BETWEEN
18 INCHES TO 30 INCHES DEEP IF NECESSARY.
GRAVEL REQUIREMENT IS STANDARD
- AMOUNT OF BACKFILL WOULD VARY.

4" 3- HOLE PERFORATED
ABS OR PVC PIPE

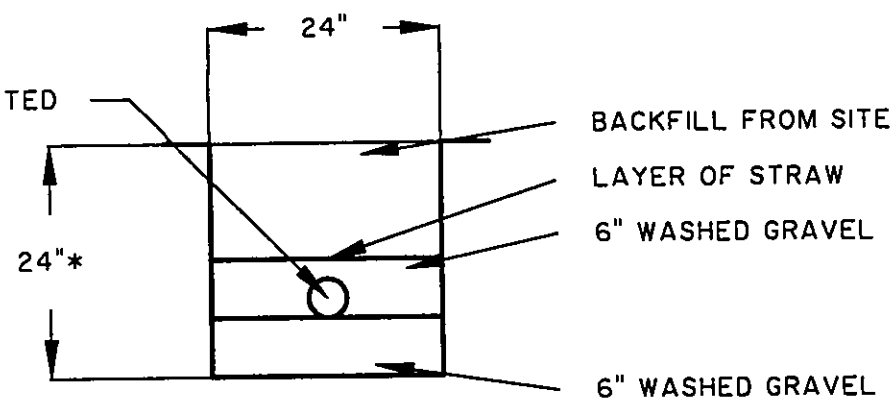

TYPICAL LEACHING TRENCH CROSS SECTION

Barrington
CONSULTING GROUP, INC.
38342 WESTERN PARKWAY, SUITE 10
WILLOUGHBY, OHIO 44094
PHONE 440.946.1761 FAX 440.918.0486



PROFILE/DETAIL
SUBLOT 19, BELLMORE ROAD, PAINESVILLE TWP.
BELLMORE SUBDIVISION
LITTLE MOUNTAIN HOMES, INC.

DRAWN	WSO
CHECKED	DWN
DATE	JULY 21, 2004
SCALE	1" = 30'
JOB NO	02007-19
SHEET	3/3