



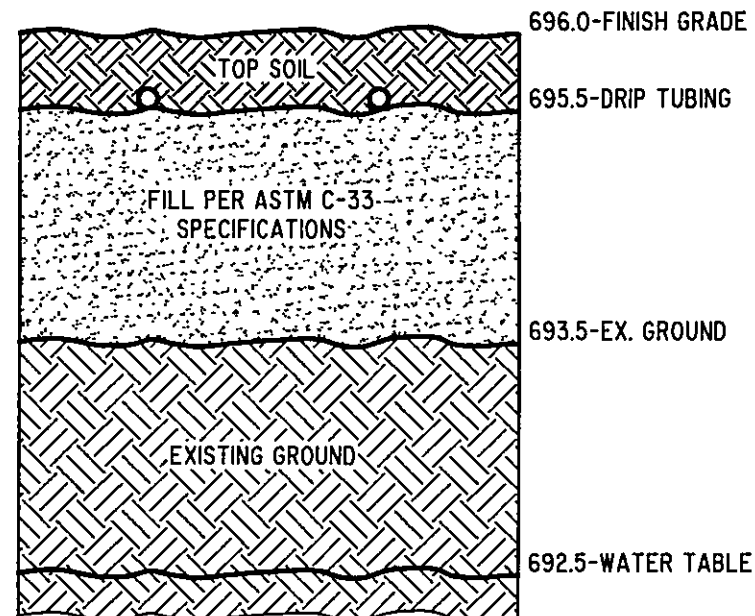

**TYPICAL SECTION**

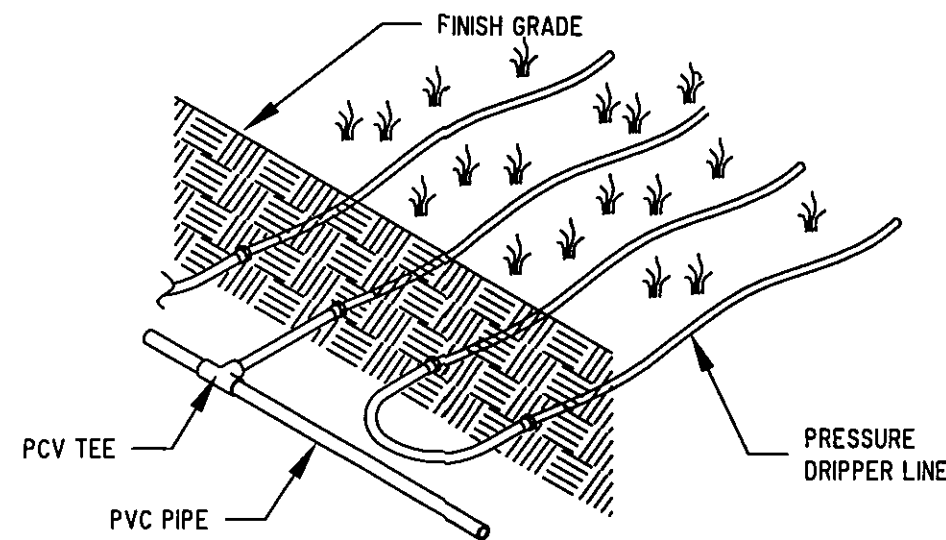


DRIPPER LINE TO FOLLOW CONTOURS WITH PVC MANIFOLD PERPENDICULAR TO GRADE. PVC MANIFOLD TO BE FREEZE PROTECTED.

**SUBSURFACE DISTRIBUTION SYSTEM**

SCOPE: DOMESTIC SEWAGE WILL FLOW BY GRAVITY THROUGH THE SEPTIC TANK THEN INTO A FINAL DOSING TANK. THE CENTRAL UNIT WILL DISPOSE OF THE EFFLUENT BY ALTERNATELY DOSING MULTIPLE ZONES IN THE ABSORPTION AREA.

THE CENTRAL UNIT COMPRISES BOTH THE CONTROLS AND THE HYDRAULIC UNIT.

**DRIP DETAIL SCHEMATICS**

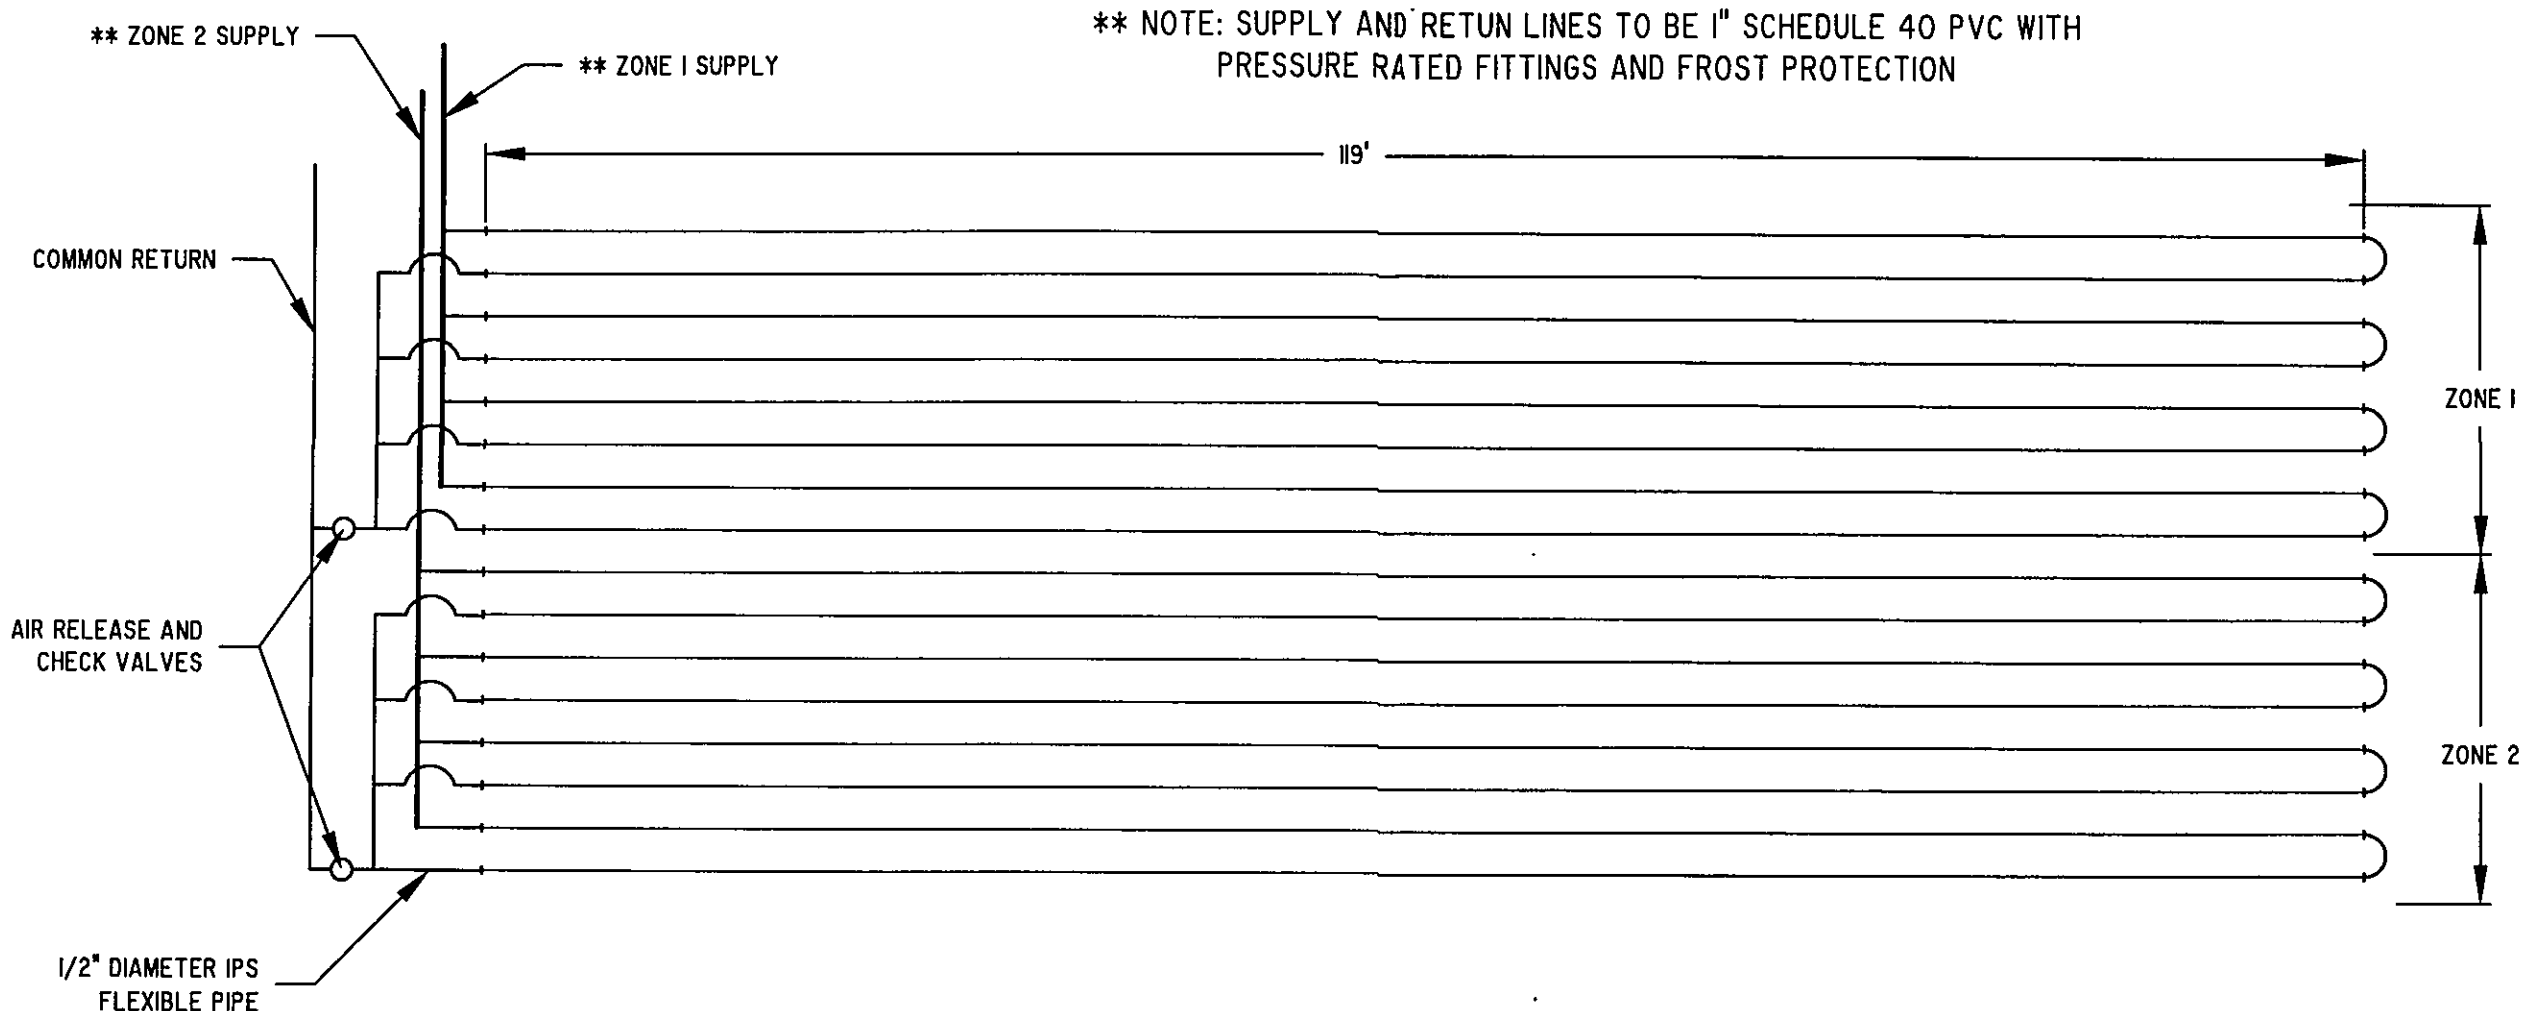

\*\* NOTE: SUPPLY AND RETURN LINES TO BE 1" SCHEDULE 40 PVC WITH PRESSURE RATED FITTINGS AND FROST PROTECTION

**MANIFOLD DETAIL AND ZONE LAYOUT**

| REVISIONS                   | BY  |
|-----------------------------|-----|
| REVISED SEPTIC MAY 18, 2005 | WSO |
| REVISED SEPTIC JUNE 1, 2005 | WSO |
|                             |     |
|                             |     |
|                             |     |
|                             |     |

**Barrington**  
CONSULTING GROUP, INC.  
9114 TYLER BLVD., MENTOR, OHIO 44060  
PHONE 440.285.1260 FAX 440.285.1262  
BCG@BarringtonCGI.com



**DETAILS**  
S/L 7 BELLMORE DR. PAINESVILLE TWP. OH. 44077  
BELLMORE SUBDIVISION VOL. 4 PG. 21  
**LITTLE MOUNTAIN HOMES, INC.**

|              |
|--------------|
| WASH         |
| CHECKED      |
| OWN          |
| DATE         |
| MAY 18, 2005 |
| SCALE        |
| NONE         |
| JOB NO.      |
| 02007-07     |
| SHEET        |
| 5/5          |
| OF SHEETS    |