



W:\2004\04092\04092-3.dwg, 01/12/2005 03:55:00 PM, Copyright Barrington Consulting Group

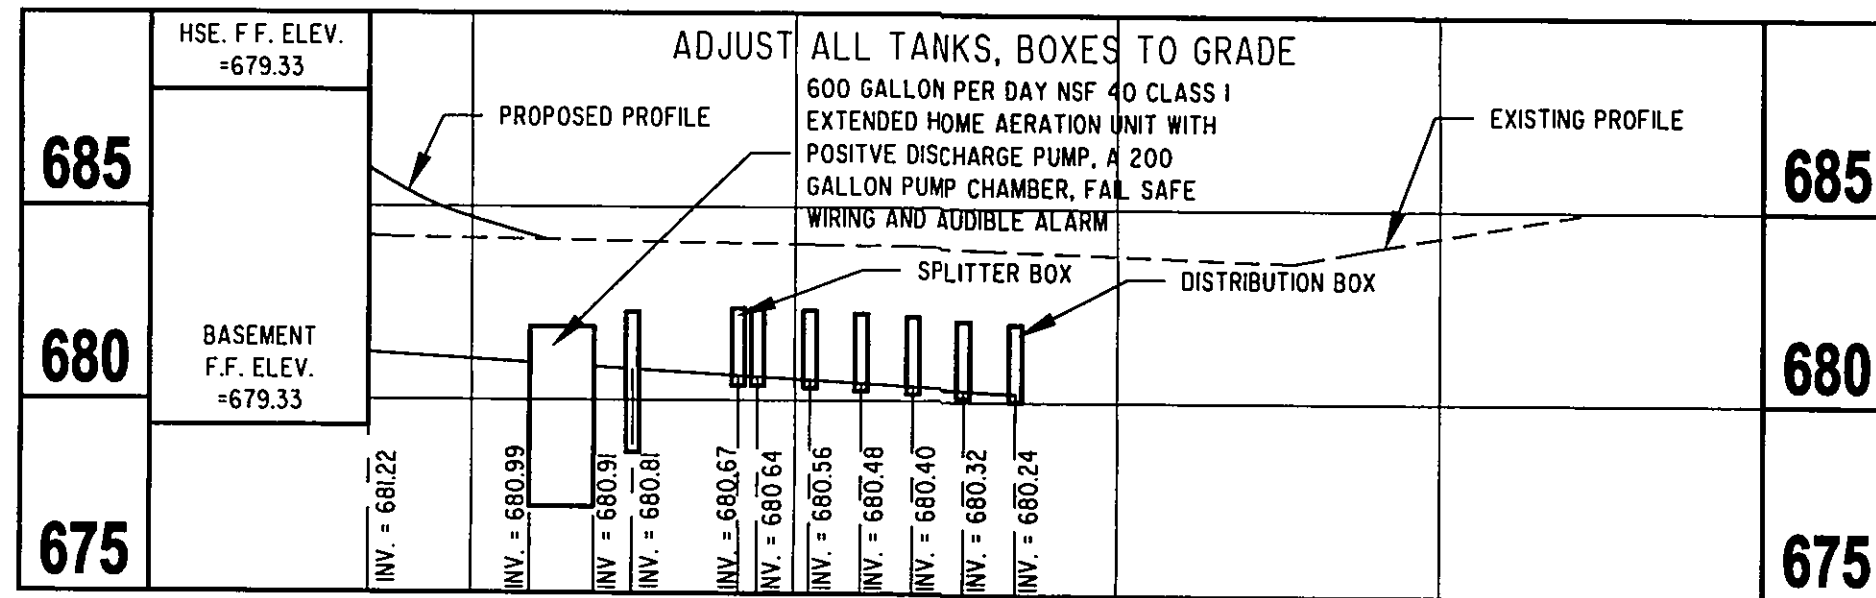

* THE STANDARD ET TRENCH IS 24 INCHES
HOWEVER THE TRENCH CAN VARY BETWEEN
18 INCHES TO 30 INCHES DEEP IF NECESSARY.
GRAVEL REQUIREMENT IS STANDARD
- AMOUNT OF BACKFILL WOULD VARY.

4" 3- HOLE PERFORATED
ABS OR PVC PIPE

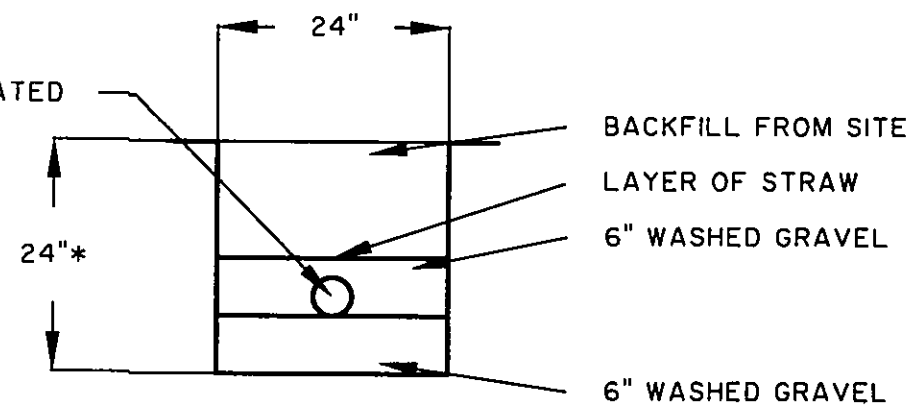

TYPICAL LEACHING TRENCH CROSS SECTION

REVISIONS		BY
REVISED SEPTIC	DEC. 28, 2004	WSO
REMOVED CERTAIN	JAN. 12, 2005	WSO

Barrington
CONSULTING GROUP, INC.
38342 WESTERN PARKWAY, SUITE 10
WILLOUGHBY, OHIO 44094
PHONE 440.946.1761 FAX 440.918.8486



PROFILE / DETAIL
S/L 3 BRANCH AVENUE
PAINESVILLE, OH, 44077
MICHELLE HRIBAR

DRAWN	WSO
CHECKED	DWN
DATE	JAN. 12, 2005
SCALE	1" = 30'
JOB NO.	04092
SHEET	213
OF	SHEETS