


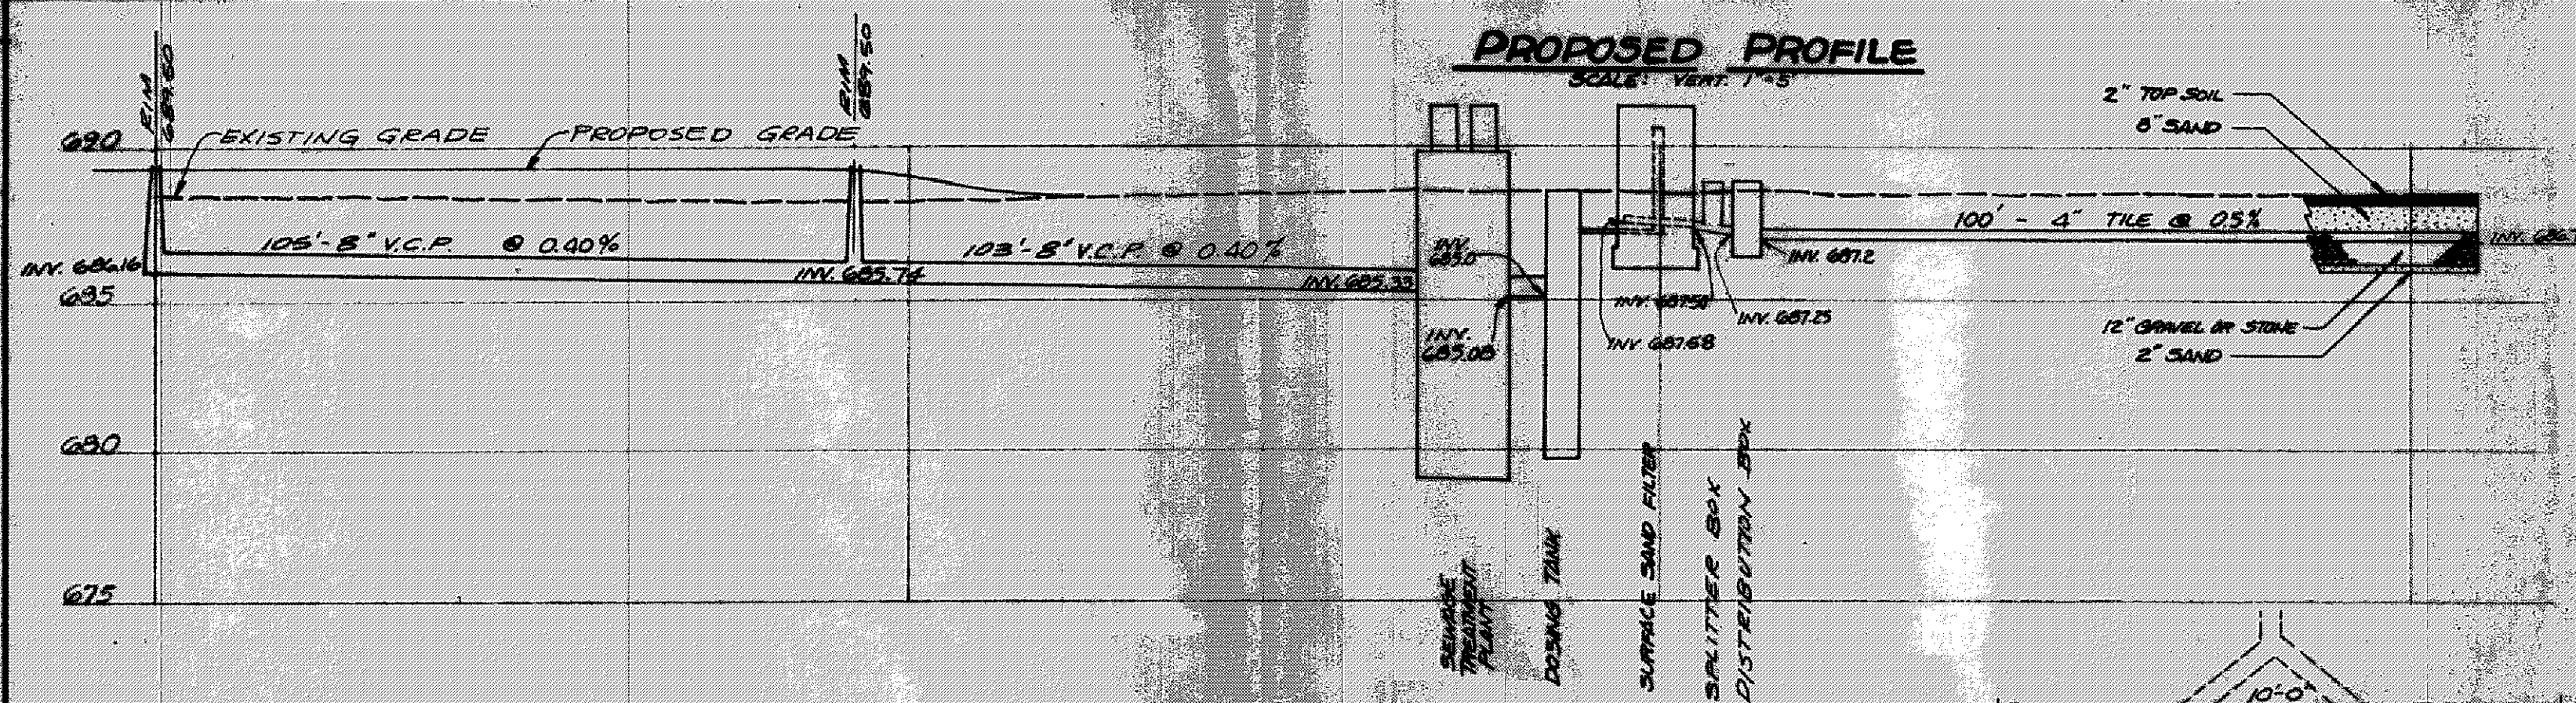
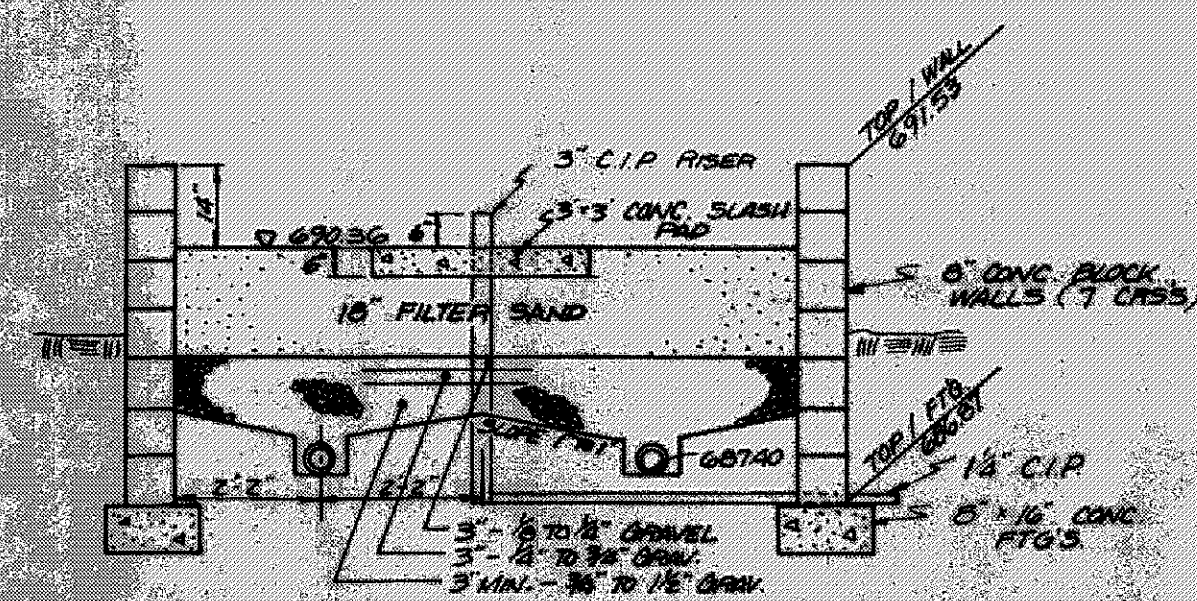


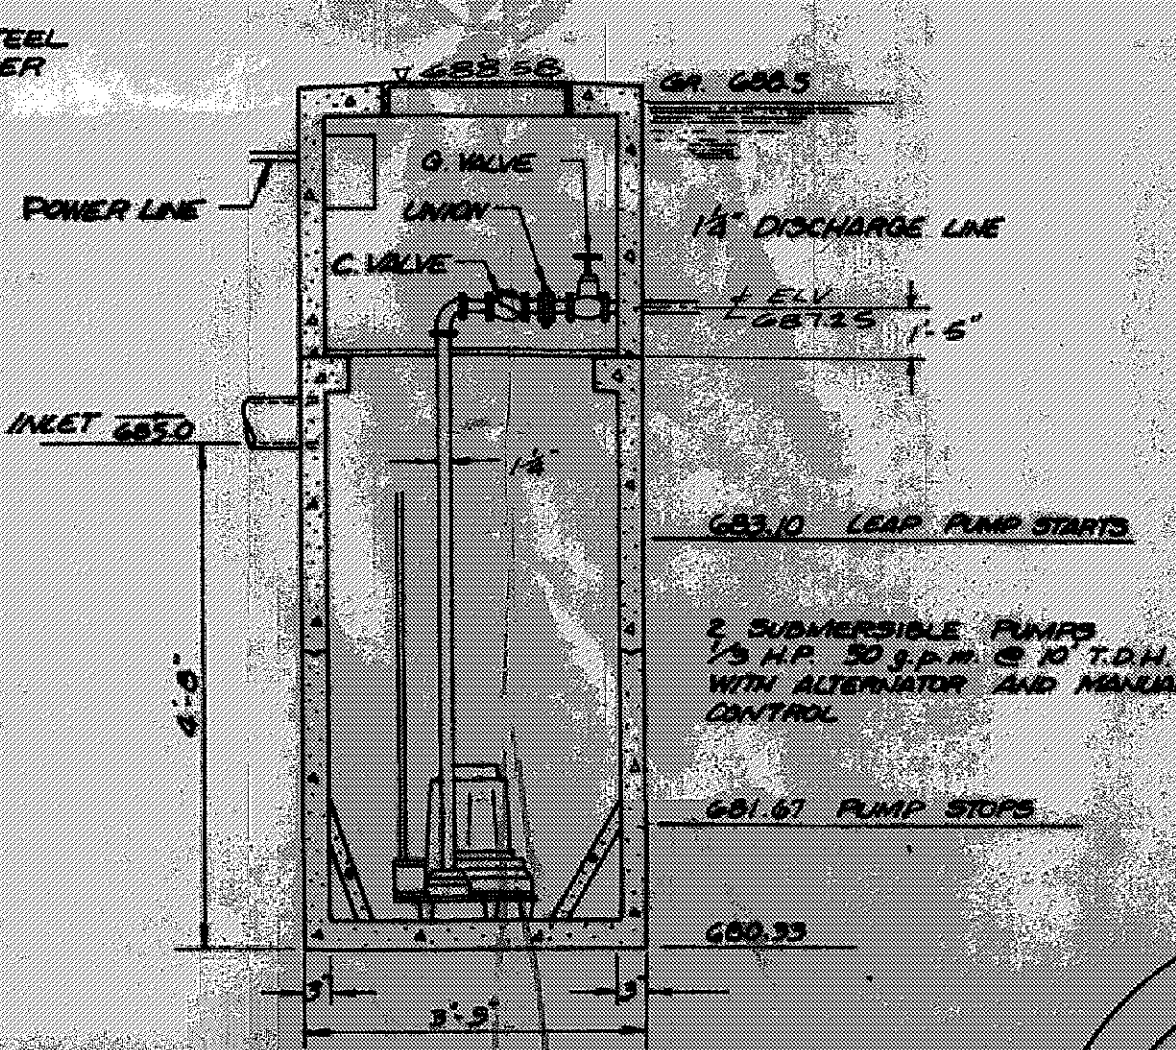



EVAPO-TRANSPIRATION FIELD
CROSS-SECTION
SCALE: 1/4"=1'-0"

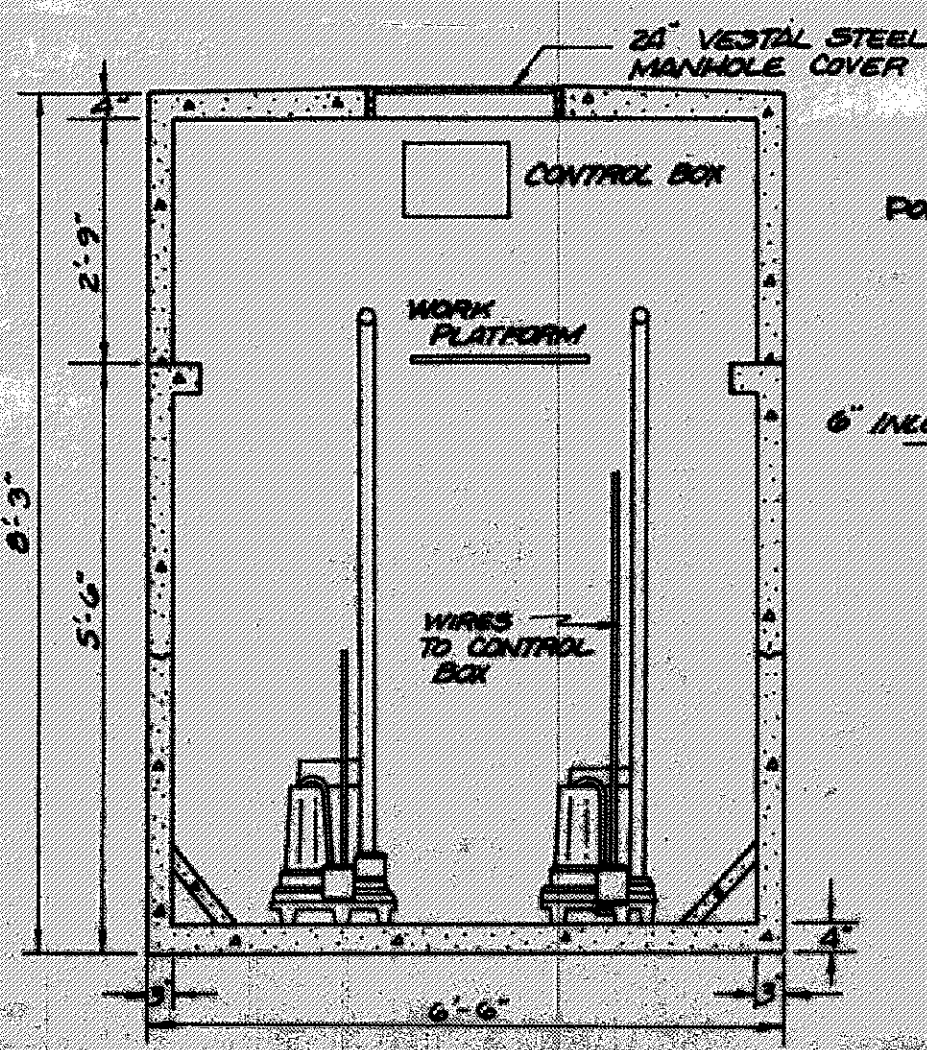



SECTION "A-A"
SCALE: 3/8"=1'-0"

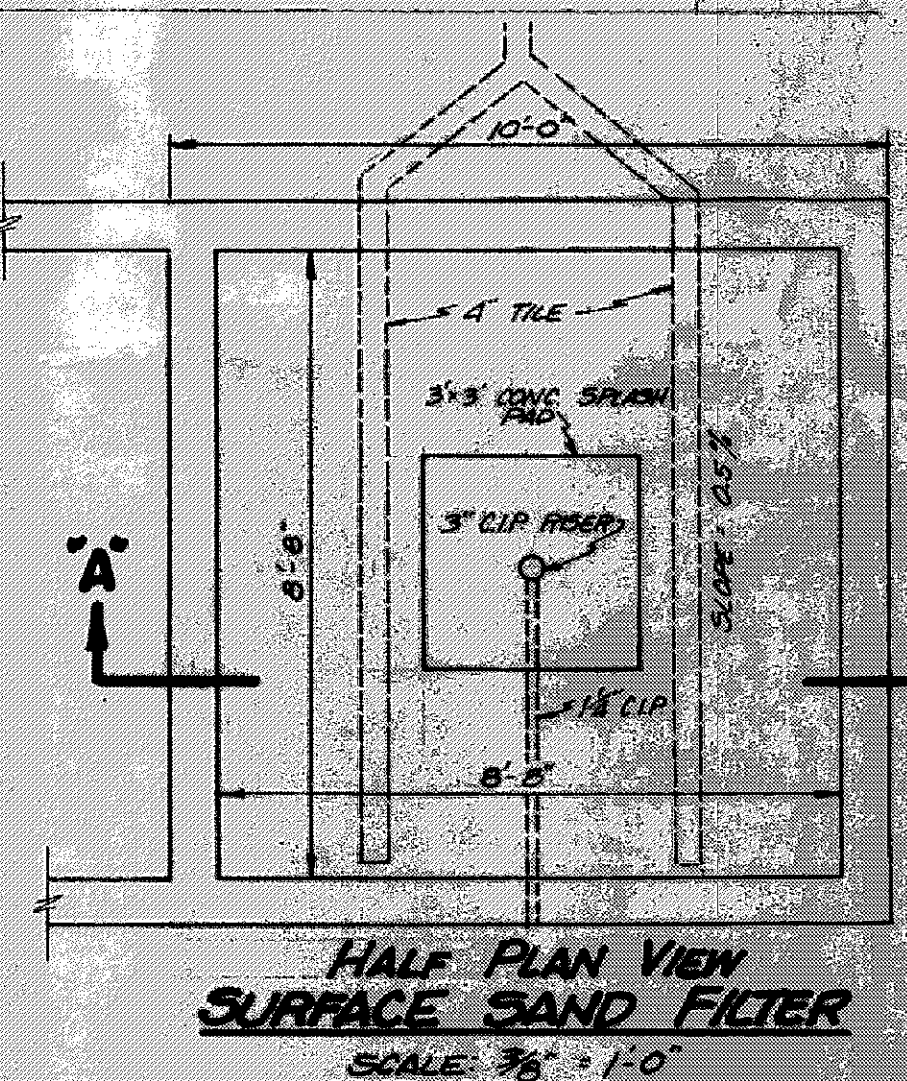

DOSING TANK
DETAILS
SCALE: 1/2"=1'-0"

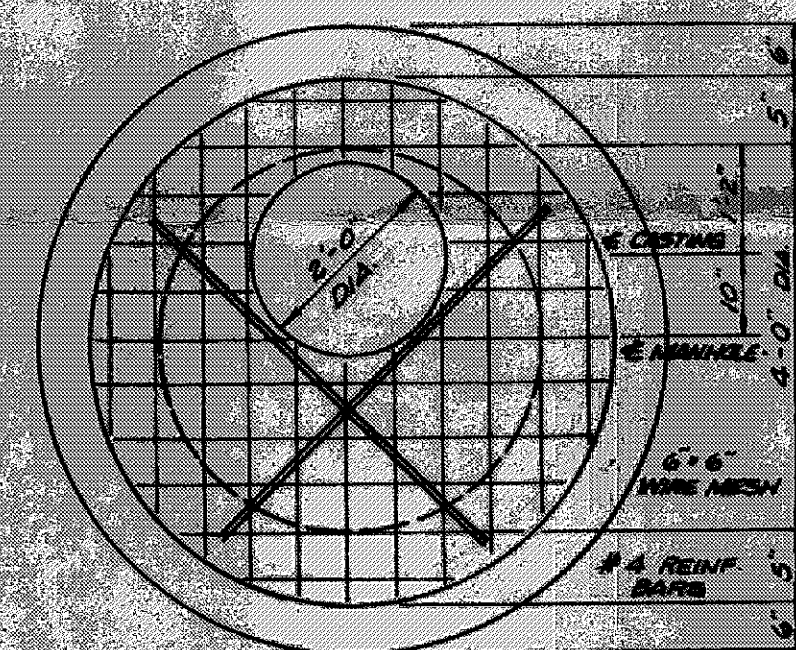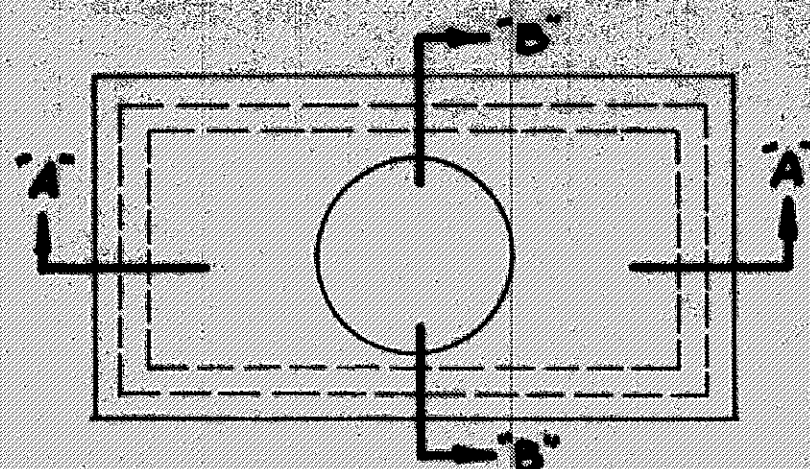

MANHOLE COVER
DETAILS

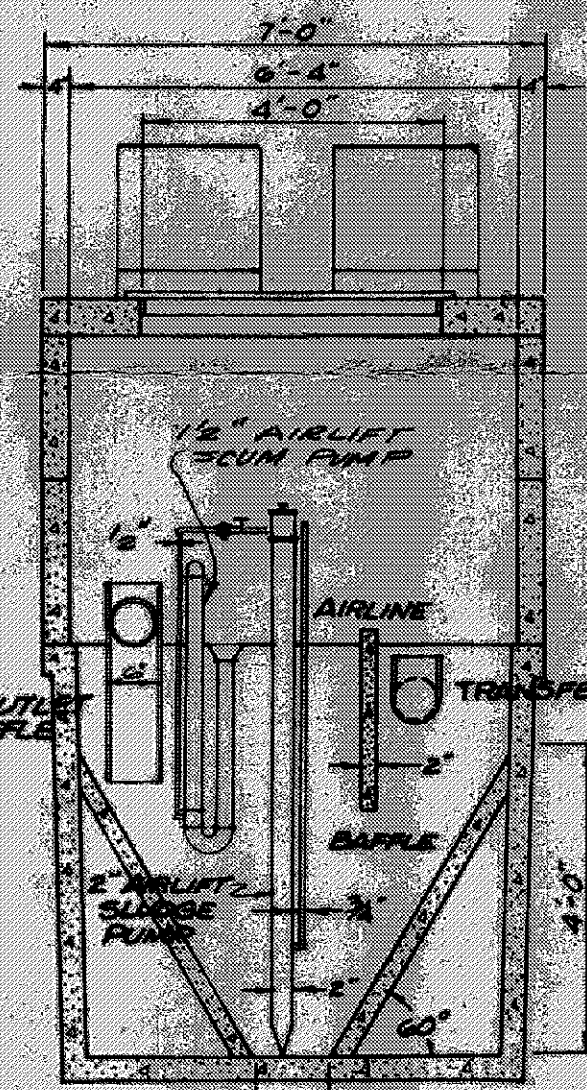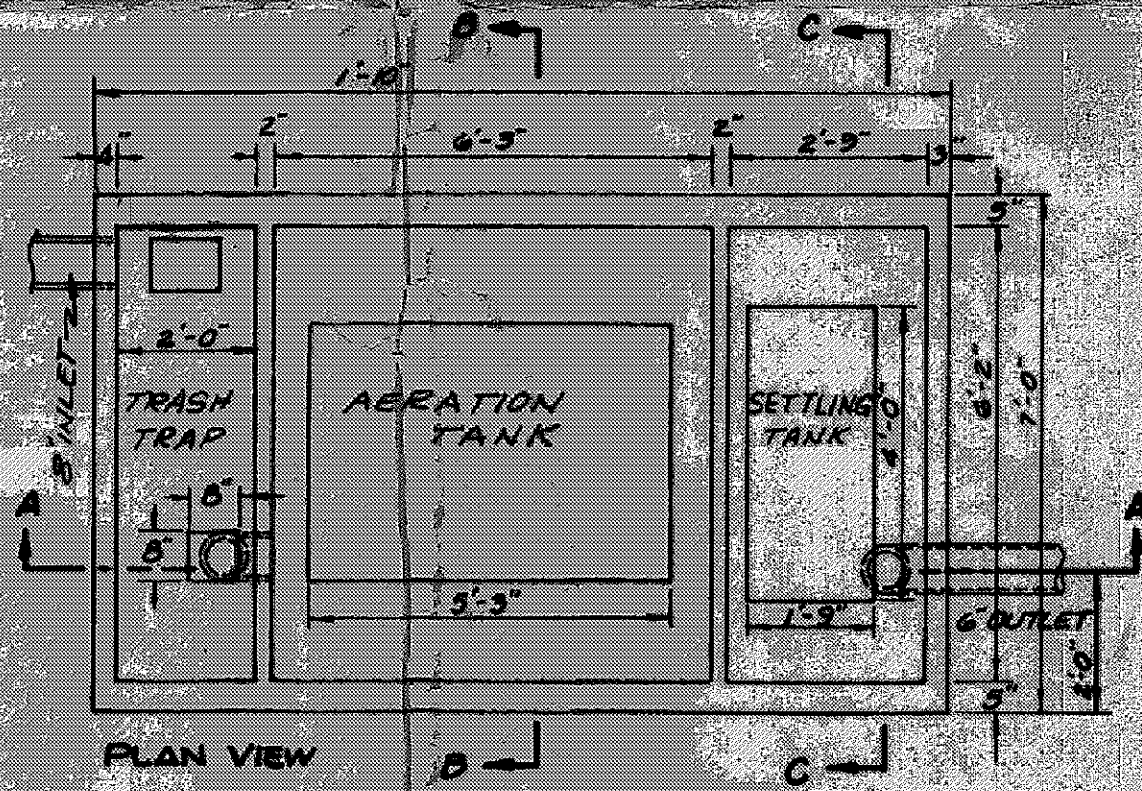


INLET - DRY WELL
DETAILS
SCALE: 1/2"=1'-0"

DISTRIBUTION BOX
DETAILS
SCALE: 1/2"=1'-0"


- GENERAL PROVISIONS**
- All work contemplated under this proposed contract shall be governed by the rules and regulations as set forth by local and State Department of Health.
 - The contractor shall conform and comply with all Federal, State and local laws, ordinances, rules and regulations which apply to the work.
 - The Contractor shall assume full responsibility for claims for bodily injury, death or property damage which may arise from operations under the proposed contract.
 - Any discrepancies found between the Construction Plans, Specifications and Site Conditions or errors or omissions in the Construction Plans or Specifications shall be immediately reported in writing to the Engineer, Debevec, Salo & Associates, Inc., who shall promptly correct such errors or omissions in writing. Any work or material that may have been omitted accidentally in the description of the work, but which is clearly implied shall be furnished and installed by the contractor as if it had been specifically stated.
 - All sanitary sewers shall have premium joints.
 - Connection sewers shall have a minimum slope of 1/8 inch per ft. of pipe.
 - A suitable base shall be provided for all manhole tanks or structures to prevent settlement of these structures. This may be done by any of the following methods depending upon the soil conditions encountered: (a) excavate to solid ground and place a sand or gravel leveling course before pouring base of settling tanks. (b) If sticky soil is encountered excavate one foot (1 ft.) deeper and fill with stone or gravel. (c) In unstable conditions as in (b) above, excavate 6" deeper and place a concrete slab at the desired grade.
 - Backfill around structures shall be sand or fine gravel with sufficient binder and shall be thoroughly compacted. In rock or hard clay, a sand bedding shall be placed under the sewer pipe not less than 4" thick. Sand or fine gravel shall be placed and thoroughly compacted under and over all pipe to a depth of 12" over the top of pipe. Machine backfill may be used above this depth under the direction of the Inspector.
 - ALL SANITARY SEWER WORK SHALL BE GOVERNED BY THE RULES, REGULATIONS AND SPECIFICATIONS OF THE HANCOCK COUNTY SANITARY ENGINEER OR HIS AUTHORIZED REPRESENTATIVE.
 - ALL WATER LINE WORK SHALL BE GOVERNED BY THE RULES, REGULATIONS AND SPECIFICATIONS OF THE CITY OF PAINESVILLE WATER DEPT.

DEBEVEC, SALO & ASSOCIATES, INC.
CIVIL ENGINEERS
130 EAST JACKSON ST. PAINESVILLE, OHIO
SCALE: 1"=20'
DATE: 11-20-73
APPROVED BY: [Signature]
DRAWN BY: TP
REVISED:
ELEANOR RIDGE APARTMENTS
DRAWING NO. 3949-2

SANITARY MANHOLE
DETAILS
SCALE: 1/2"=1'-0"

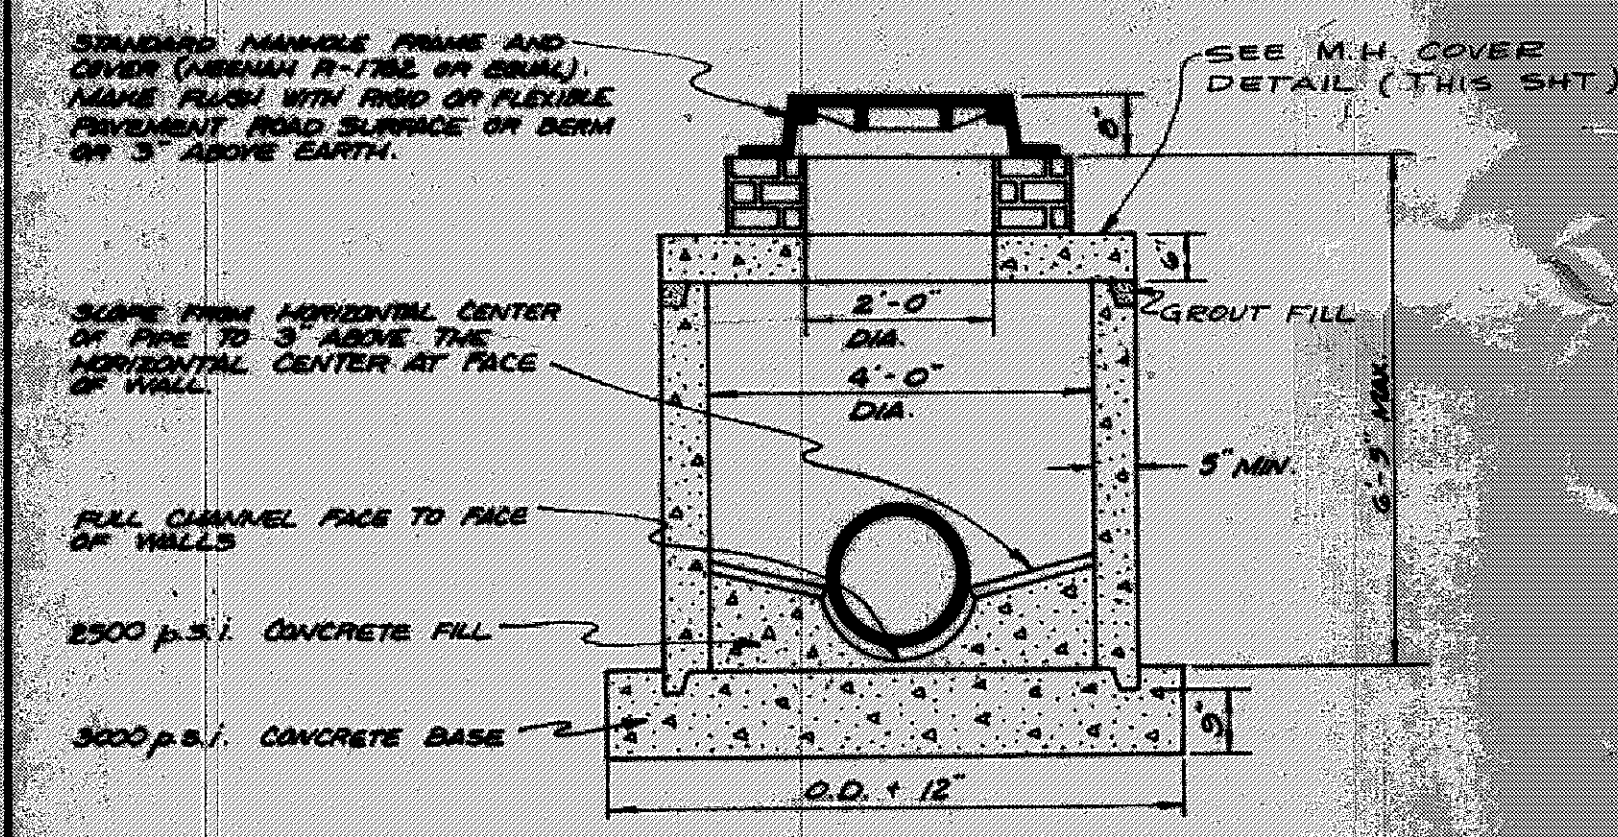

TRENCH AND BEDDING
DETAILS
NO SCALE

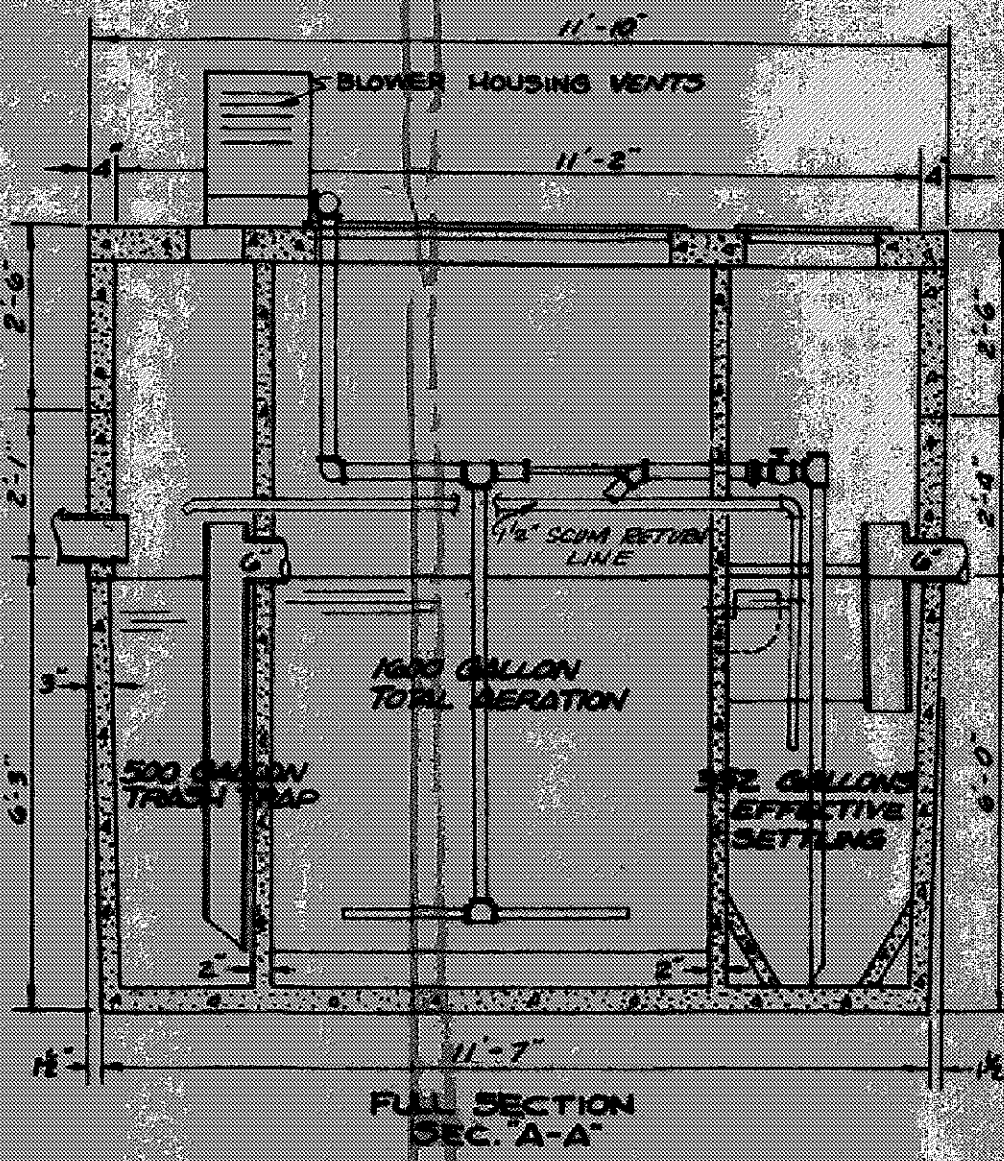

SEWAGE TREATMENT PLANT
DETAILS
SCALE: 3/8"=1'-0"