

1) ALL SANITARY SEWER CONNECTION INSTALLATION SHALL BE PERFORMED AS PER THE LAKE COUNTY


4) ALL WATER CONNECTION WORK SHALL BE IN ACCORDANCE WITH STANDARDS AND SPECIFICATIONS OF

5) SEE ARCHITECTURAL PLANS FOR FINAL DIMENSIONS & DETAILS BUILDING DIMENSIONS ARE SHOWN FOR

- AT THE SITE IN THE LOCATIONS SHOWN ON THE SITE PLAN AS WELL AS
- DISTURBED AREAS OF THE SITE THAT ARE TO REMAIN IDLE FOR MORE THAN TWENTY-ONE (21) DAYS SHALL BE PROPERLY SEEDED AND STRAW MULCHED WITHIN SEVEN (7) DAYS OF COMPLETION OF INITIAL GRADING TEMPORARY
- 4 STABILIZATION OF CRITICAL AREAS WITHIN FIFTY (50) FEET OF ANY STREAM
- 5. STRAW-MULCH SHALL BE APPLIED AT A RATE OF 1 BALE PER EVERY TEN SPREAD A MINIMUM DEPTH OF FOUR (4) INCHES OVER THE THIRTY-FOOT WIDTH AND MUST BE ACCOMPANIED BY A PROPERLY INSTALLED SILT FENCE

SEEDING DATES	SPECIES	LB./1,000 FT.	PER ACR
MARCH 1 TO AUGUST 15	OATS	3	4 BUSHEL
	TALL FESCUE	1	40 LB
	ANNUAL RYEGRASS	1	40 LB
	PERENNIAL RYEGRASS	1	40 LB.
	TALL FESCUE	1	40 LB
	ANNUAL RYEGRASS	1	40 LB
AUGUST 16 TO NOVEMBER 1	RYE	3	2 BUSHEL
	TALL FESCUE	1	40 LB
	ANNUAL RYEGRASS	1	40 LB
	WHEAT	3	2 BUSHEL
	TALL FESCUE	1	40 LB
	ANNUAL RYEGRASS	t	40 LB
	PERENNIAL RYEGRASS	1	40 LB
	TALL FESCUE	1	40 LB
	ANNUAL RYEGRASS	1	40 LB

- 3) TEMPORARY SEEDING IS REQUIRED WITHIN 2 DAYS OF LAST DISTURBANCE FOR ANY AREA WITHIN 50 FEET OF A STREAM AND NOT AT FINAL GRADE

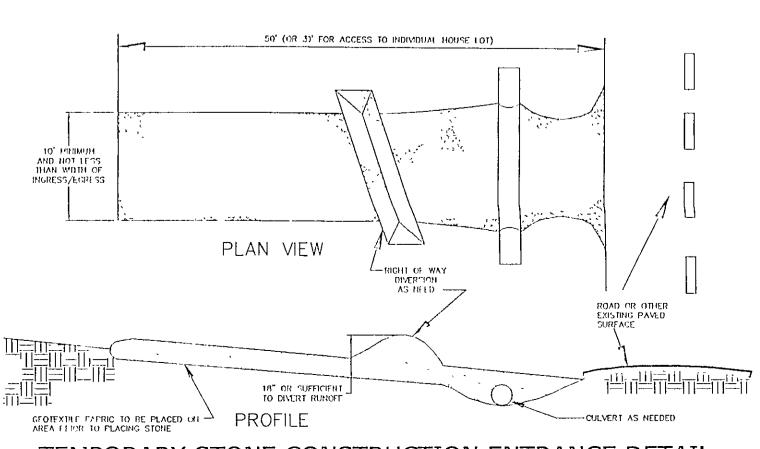

ubdivision Ĩnc Builder Shor

20.

 ∞

URBANICK E-66506

Drawn By: JAS Checked By:

Approved By:

Date: 03/09/06

onsulti enland

> Horiz. 1"= 10' Vert. 1"= N/A

Sheet No.

Filename: 06-010\db