



W:\2004\04024\04024.dwg, 05/02/2004 08:31:05 AM, Copy, 1/24 Barrington Consulting Group

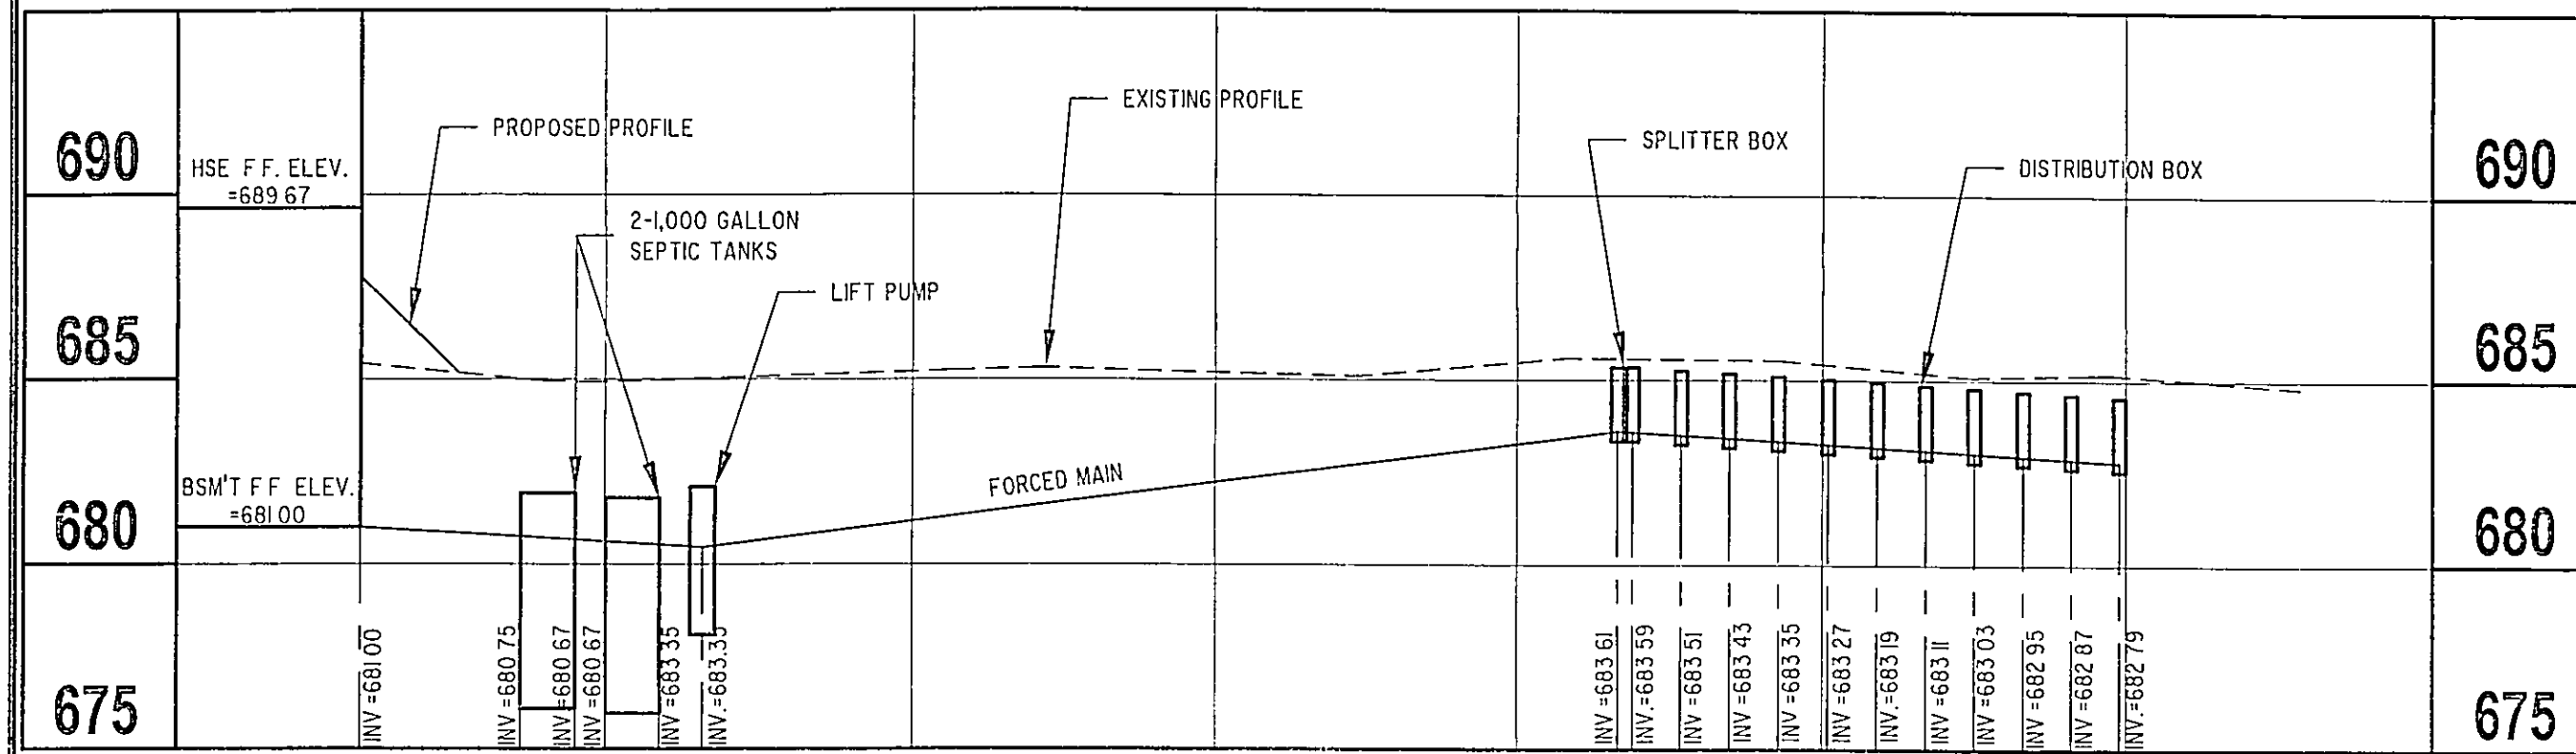

4" 3- HOLE PERFORATED ABS OR PVC PIPE

* THE STANDARD ET TRENCH IS 24 INCHES HOWEVER THE TRENCH CAN VARY BETWEEN 18 INCHES TO 30 INCHES DEEP IF NECESSARY GRAVEL REQUIREMENT IS STANDARD - AMOUNT OF BACKFILL WOULD VARY.

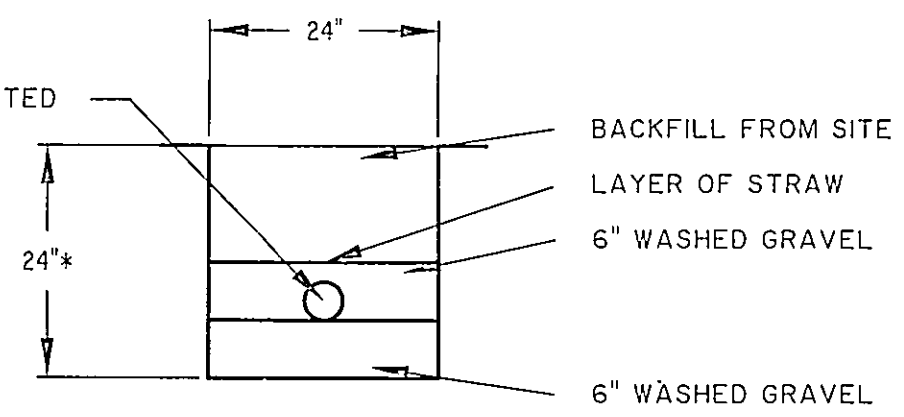

TYPICAL LEACHING TRENCH CROSS SECTION

REVISIONS	BY

Barrington
CONSULTING GROUP, INC.
38342 WESTERN PARKWAY, SUITE 10
WILLOUGHBY, OHIO 44094
PHONE 440.946.1761 FAX 440.918.0486



PROFILE/DETAIL
P.P. No. 11B-035B-015 NORTH RIDGE RD.
PAINESVILLE TWP. OHIO 44077

LITTLE MOUNTAIN HOMES, INC.

DRAWN
W.S.O.
CHECKED
D.W.N.
DATE
JUNE 08, 2004
SCALE
1" = 30'
JOB NO.
04024
SHEET
3/3

OF SHEETS