
## PERMANENT SEEDING SPECIFICATIONS Erosion and Sediment Control Schedule Seed Mix lb./ac. lb. / 1000sqft General Use A stone access drive complete with under lying geo-textile fabric (20 feet wide and 50 feet long) for ingress and egress at Creeping Red Fescue the site shall be installed. This drive shall be the only entrance Domestic Ryegrass 10-20 1/4-1/2 and exit to the site. 1/4-1/2 Kentucky Bluegrass Tall Fescue Dwarf Fescue 10-20 All silt fence shall be installed prior to any earthwork activities at the site in the locations shown on the site plan as well as Steep Banks or Cut Slopes along the front of any lot that slopes towards the street. Temporary Seeding Disturbed areas of the site that are to remain idle for more than Tall Fescue Do not seed later than August. twenty-one (21) days shall be properly seeded and straw mulched Tall Fescue within seven (7) days of completion of initial grading. Do not seed later than August. Temporary seeding and mulching of a thirty (30) foot strip of the entire front of the lot shall be maintained on the site once Tall Fescue Road Ditches and Swales initial grading is complete. Stabilization of critical areas within fifty (50) feet of any stream 2 1/4 or wetland shall be complete within two (2) days of the Kentucky Bluegrass disturbance if the site is to remain inactive for longer than fourteen (14) days. Straw—mulch shall be applied at a rate of 1 bale per every ten Kentucky Bluegrass 1 1/2 (10) feet of curb, at a width of thirty (30) feet of the entire Perennial Ryegrass 1 1/2 For Shaded areas. length of the lot. Wood chips may also be used but must be Kentucky Bluegrass spread at a minimum depth of four inches over the thirty-foot Creeping Red Fescue 1 1/2 width and must be accompanied by a properly installed silt Note: other approved seed species may be substituted. Erosion and sediment controls shall be inspected every seven (7) days or within 24 hours of a 0.5" or greater rainfall event. Necessary repairs shall be made at this time. Straw mulch shall be unrotted small-grain straw applied at the rate of 2 tons/ac. or 90 lb./1,000 sq. ft. (two to three bales). The mulch shall be spread uniformly by hand or mechanically so the soil All erosion and sediment control specifications, applications, and surface is covered. For uniform distribution of hand—spread mulch, divide area into approximately timetables are based on the descriptions and standards of The 1,000 sq. ft. sections and spread two 45-lb. bales of straw in each section. Ohio Department of Natural Resources "Rainwater and Land Development Manual" and can be found in the Lake County Erosion and Sediment Control Rules as adopted December 21, The specified erosion and sediment control standards are the general guidelines and shall not limit the right of the county to impose, at any time, additional, more stringent requirements. Nor shall the standards limit the right of the county to waive, in writing, individual requirements. September 19, 2003 STONE ACCESS DRIVE NO SCALE \_50'L X 20'W X 12" TH ODOT #2 STONE

SILT FENCE DETAIL

NO SCALE

DECEMBER 19, 1997

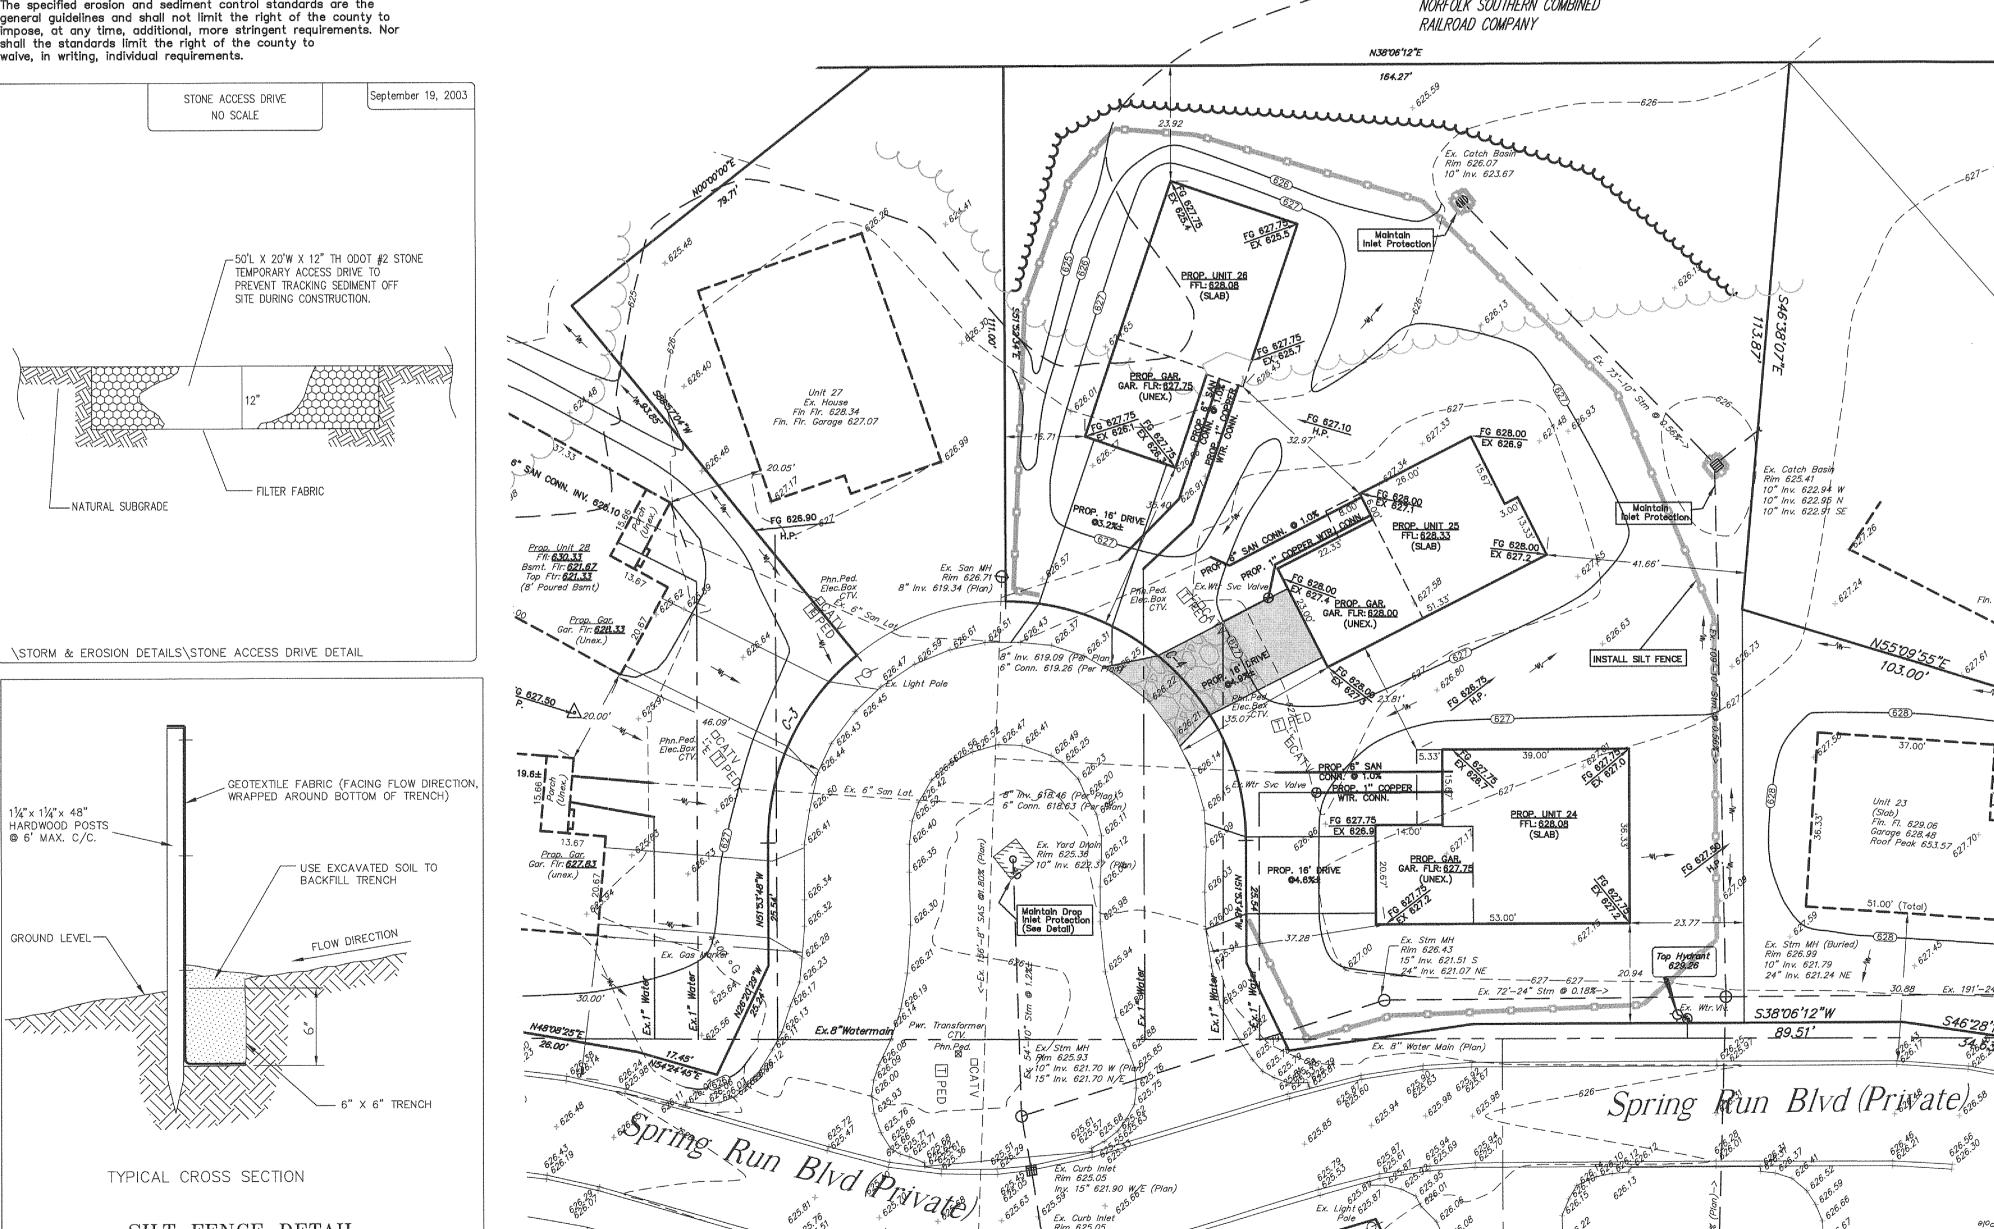

Temporary Seeding Specifications

Species

Tall Fescue

Tall Fescue

Tall Fescue

Tall Fescue

Tall Fescue

Note: other approved seed species may be substituted.

Annual Ryegrass

Perennial Ryegrass

Annual Ryegrass

Annual Ryegrass

Annual Ryegrass

Perennial Ryegrass

Annual Ryegrass

November 1 to Spring Seeding Use mulch only, sodding practices or dormant seeding

Seeding Dates

March 1 to August 15

August 16 to November 1

Lb. / 1000sqft

GRAPHIC SCALE

Per Acre

4 bushel

40 lb.

40 lb.

40 lb.

2 bushel

40 lb.

40 lb.

40 lb.

40 lb.

40 lb.


40 lb.


## NOTES -See Architect Plans for Complete House -Utility Connections Per Plan; Contractor To Verify Location and Depth of All laterals. Verify Depth of Sanitary Connection to Verify Gravity Basement Service (Where Basements Are Constructed) -For Slab Units, Contractor Shall Provide 22.5°Vertical Bends to Raise Sanitary Lateral

to Proposed Grade @ Building (Approx. 4'-6" Below Finished Floor.)

-Verify Downspout Locations with Owner. Downspouts to Splashblock.

-Footer Drains (where req) to Splashblock; Minimum 10' Away From House.

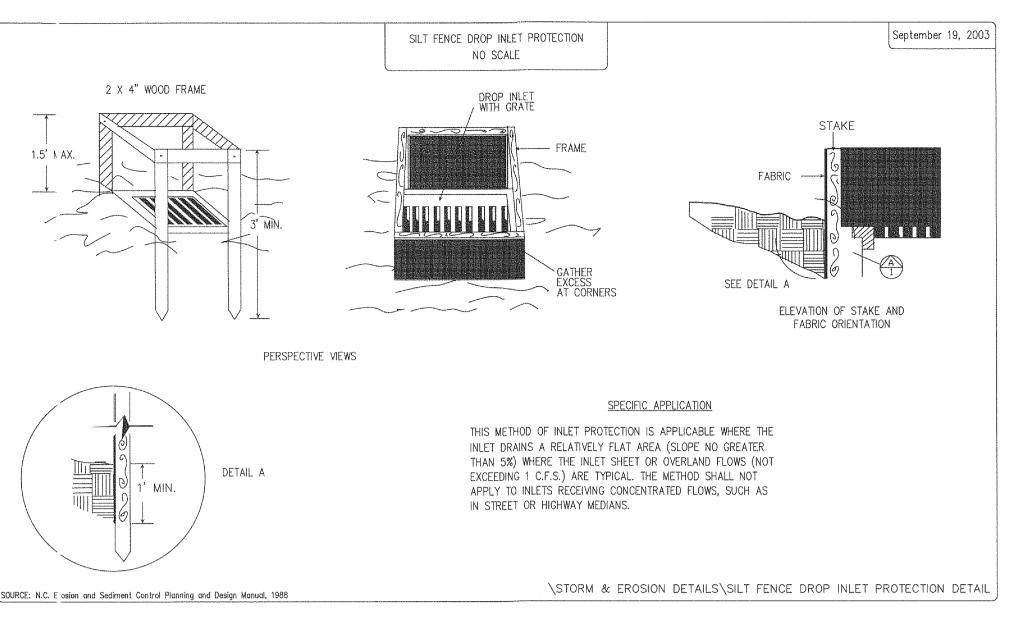

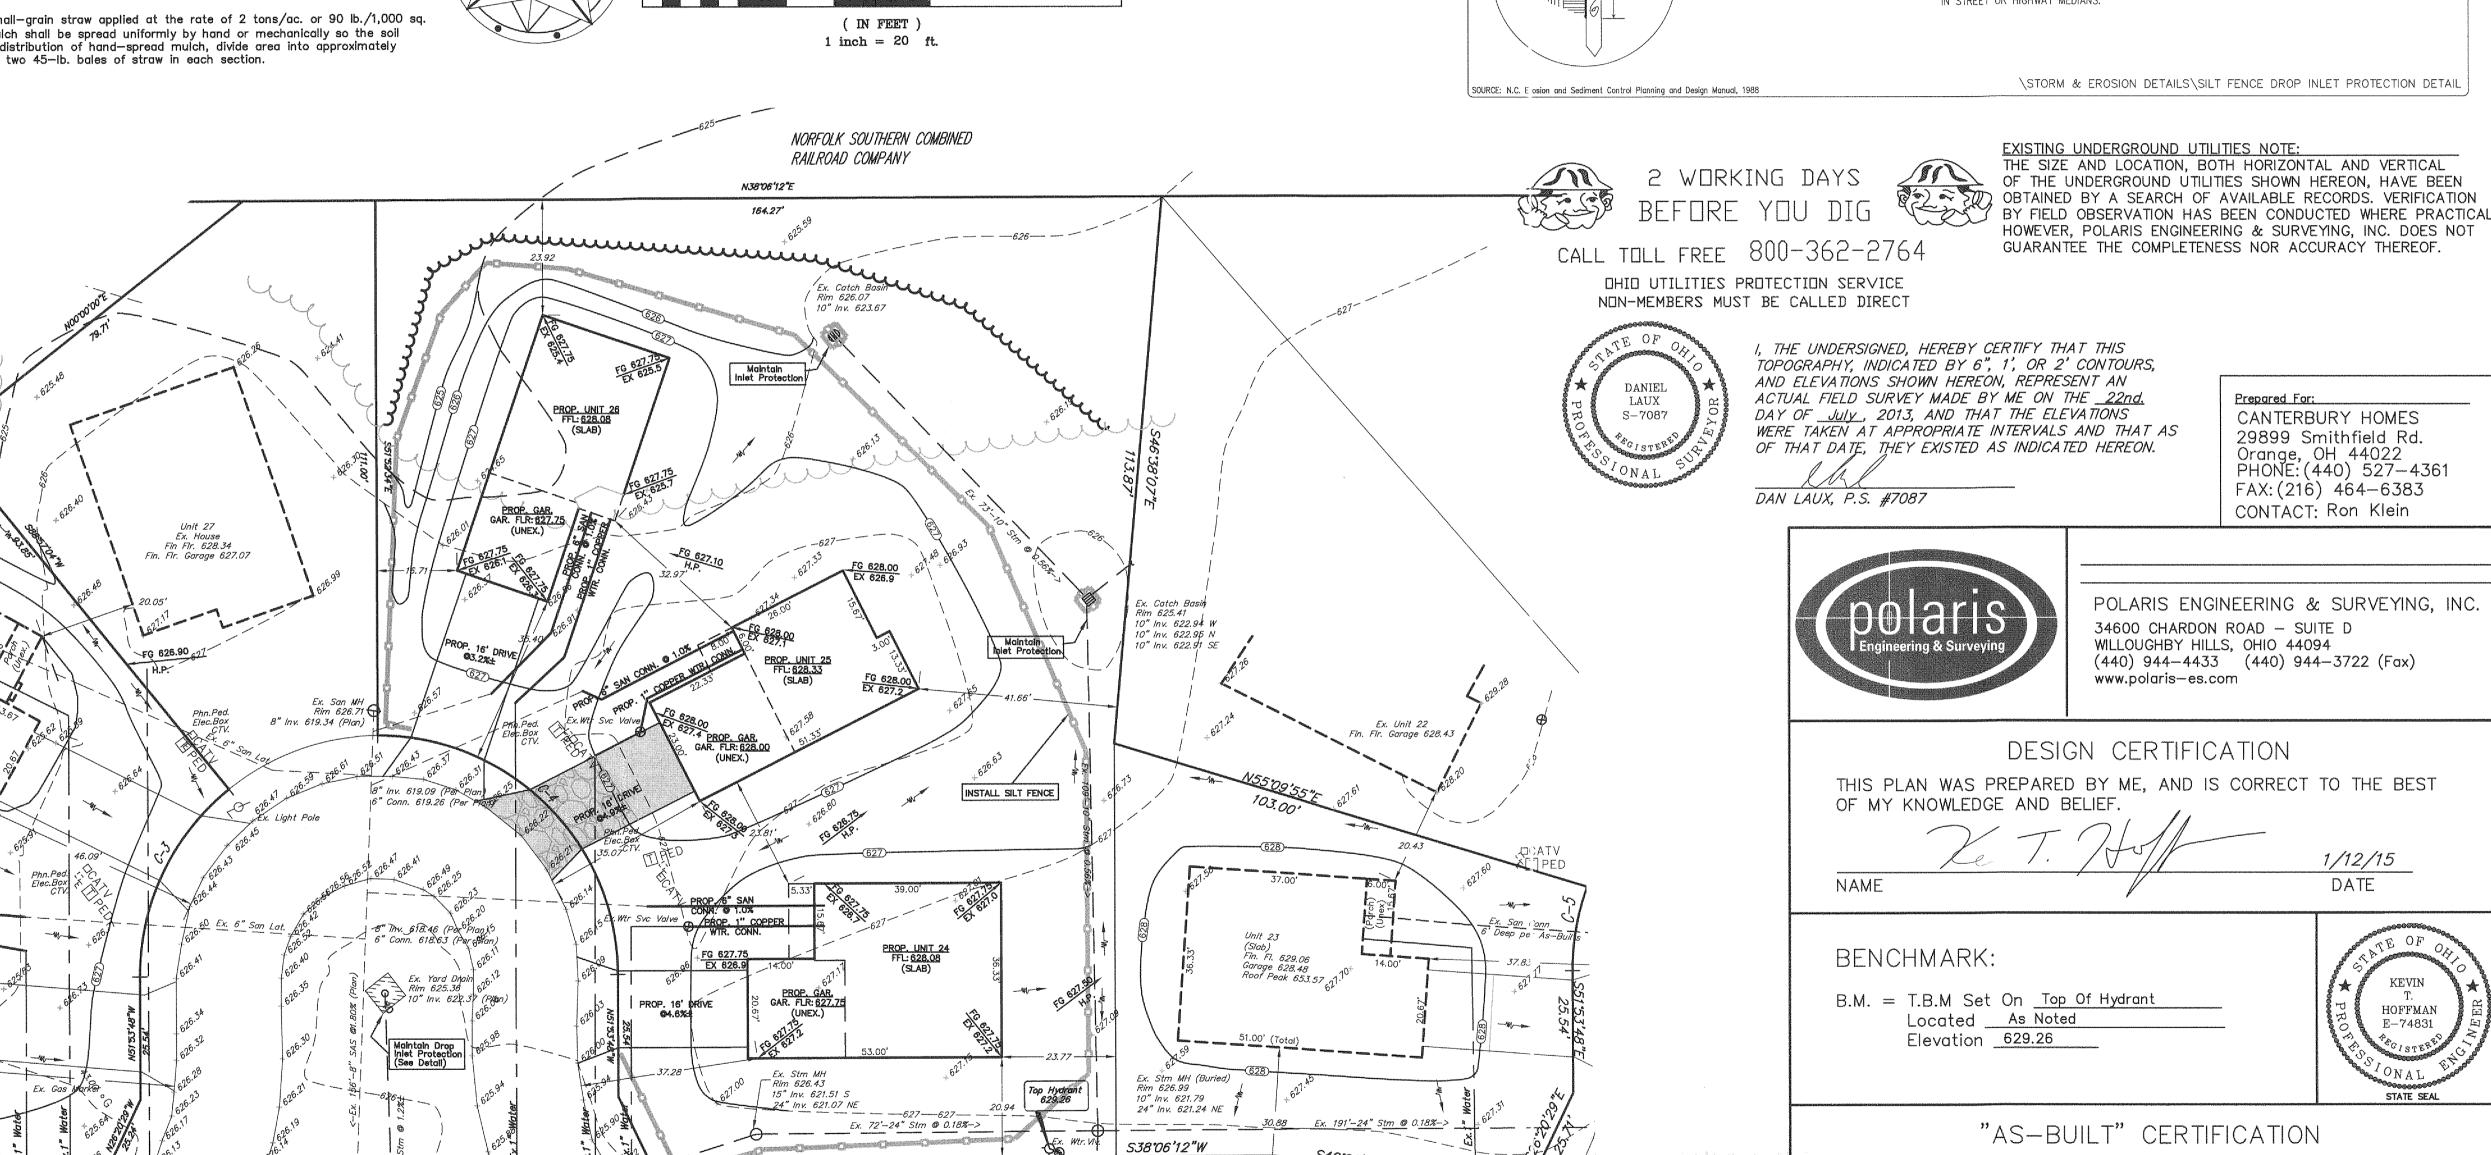

Ex. San. MH Rim 626.77 8" Inv. 618.18 SE

1/12/15 DATE



I HEREBY CERTIFY THAT THE CIRCLED INFORMATION IS EXISTING AS OBTAINED ON THE SITE \_\_\_\_\_ AND IS CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF.

DATE NAME

THE BROOKS CONDOMINIUMS

wed as shown a

JAMES R. GILLS

County Drainage En

Painesville Twp. — Lake County — Ohio

CONTRACT No. 11014 DATE: 1/12/15 SCALE: HOR. 1"=20' FILENAME: Siteplan 24,25,26