
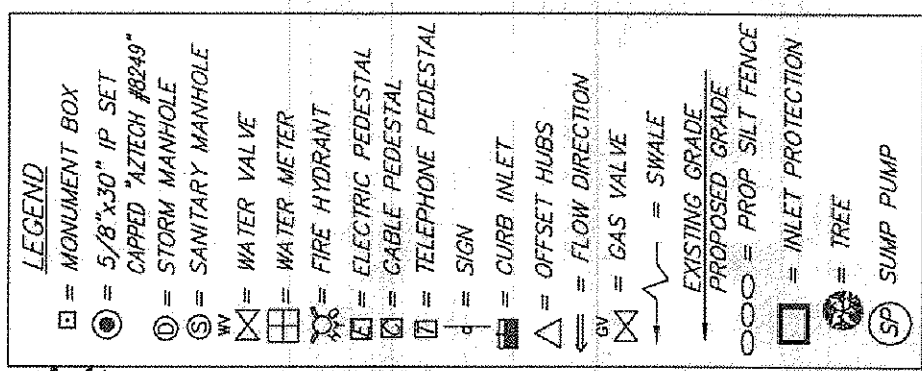


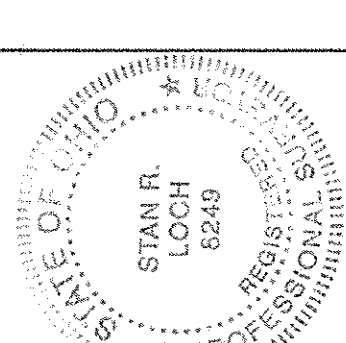

48 HOURS
BEFORE YOU DIG
Call...800-362-2764
TOLL FREE
OHIO UTILITIES PROTECTION SERVICE

CERTIFICATION
I CERTIFY THAT THE CIRCLED INFORMATION
WAS OBTAINED ON THE SITE
IN ACCORDANCE WITH THE BEST OF MY KNOWLEDGE

"I, THE UNDERSIGNED HEREBY CERTIFY THAT THIS TOPOGRAPHY, INDICATED BY 1 OR 2' CONTOURS, AND ELEVATIONS SHOWN HEREON REPRESENT AN ACTUAL FIELD SURVEY MADE BY ME ON THE 20TH DAY OF FEBRUARY, 20 13 AND THAT THE ELEVATIONS WERE TAKEN AT APPROPRIATE INTERVALS AND THAT AS OF THAT DATE THEY EXISTED AS INDICATED HEREON."

STAN R. LOCH

[illegible]

4425 WARNER ROAD - SUITE 12
VALLEY VIEW, OHIO 44125

440-602-9071

FAX 216-369-0259


AZZTECH

ENGINEERING + SURVEYING
Civil Engineering + Land Surveying

AZTECH
ENGINEERING + SURVEYING
Civil Engineering + Land

CURVE TABLE						
CURVE	LENGTH	RADIUS	TANGENT	CHORD	BEARING	DELTA
C1	15.23'	50.00'	7.68'	15.18'	S11°57'08"E	17°27'26"
C2	88.55'	120.00'	46.40'	86.56'	S17°55'00"W	42°16'50"
C3	110.69'	150.00'	58.00'	108.20'	S17°55'00"W	42°16'50"

HORIZ. SCALE: 1" = 30'	VERT. SCALE:
DRAWN BY: CL	DATE: 2-28-2013
CHECKED BY: SRL	DRAWING NO.: 2012532
JOB NO.: 2012532	SHEET: 1 OF 2

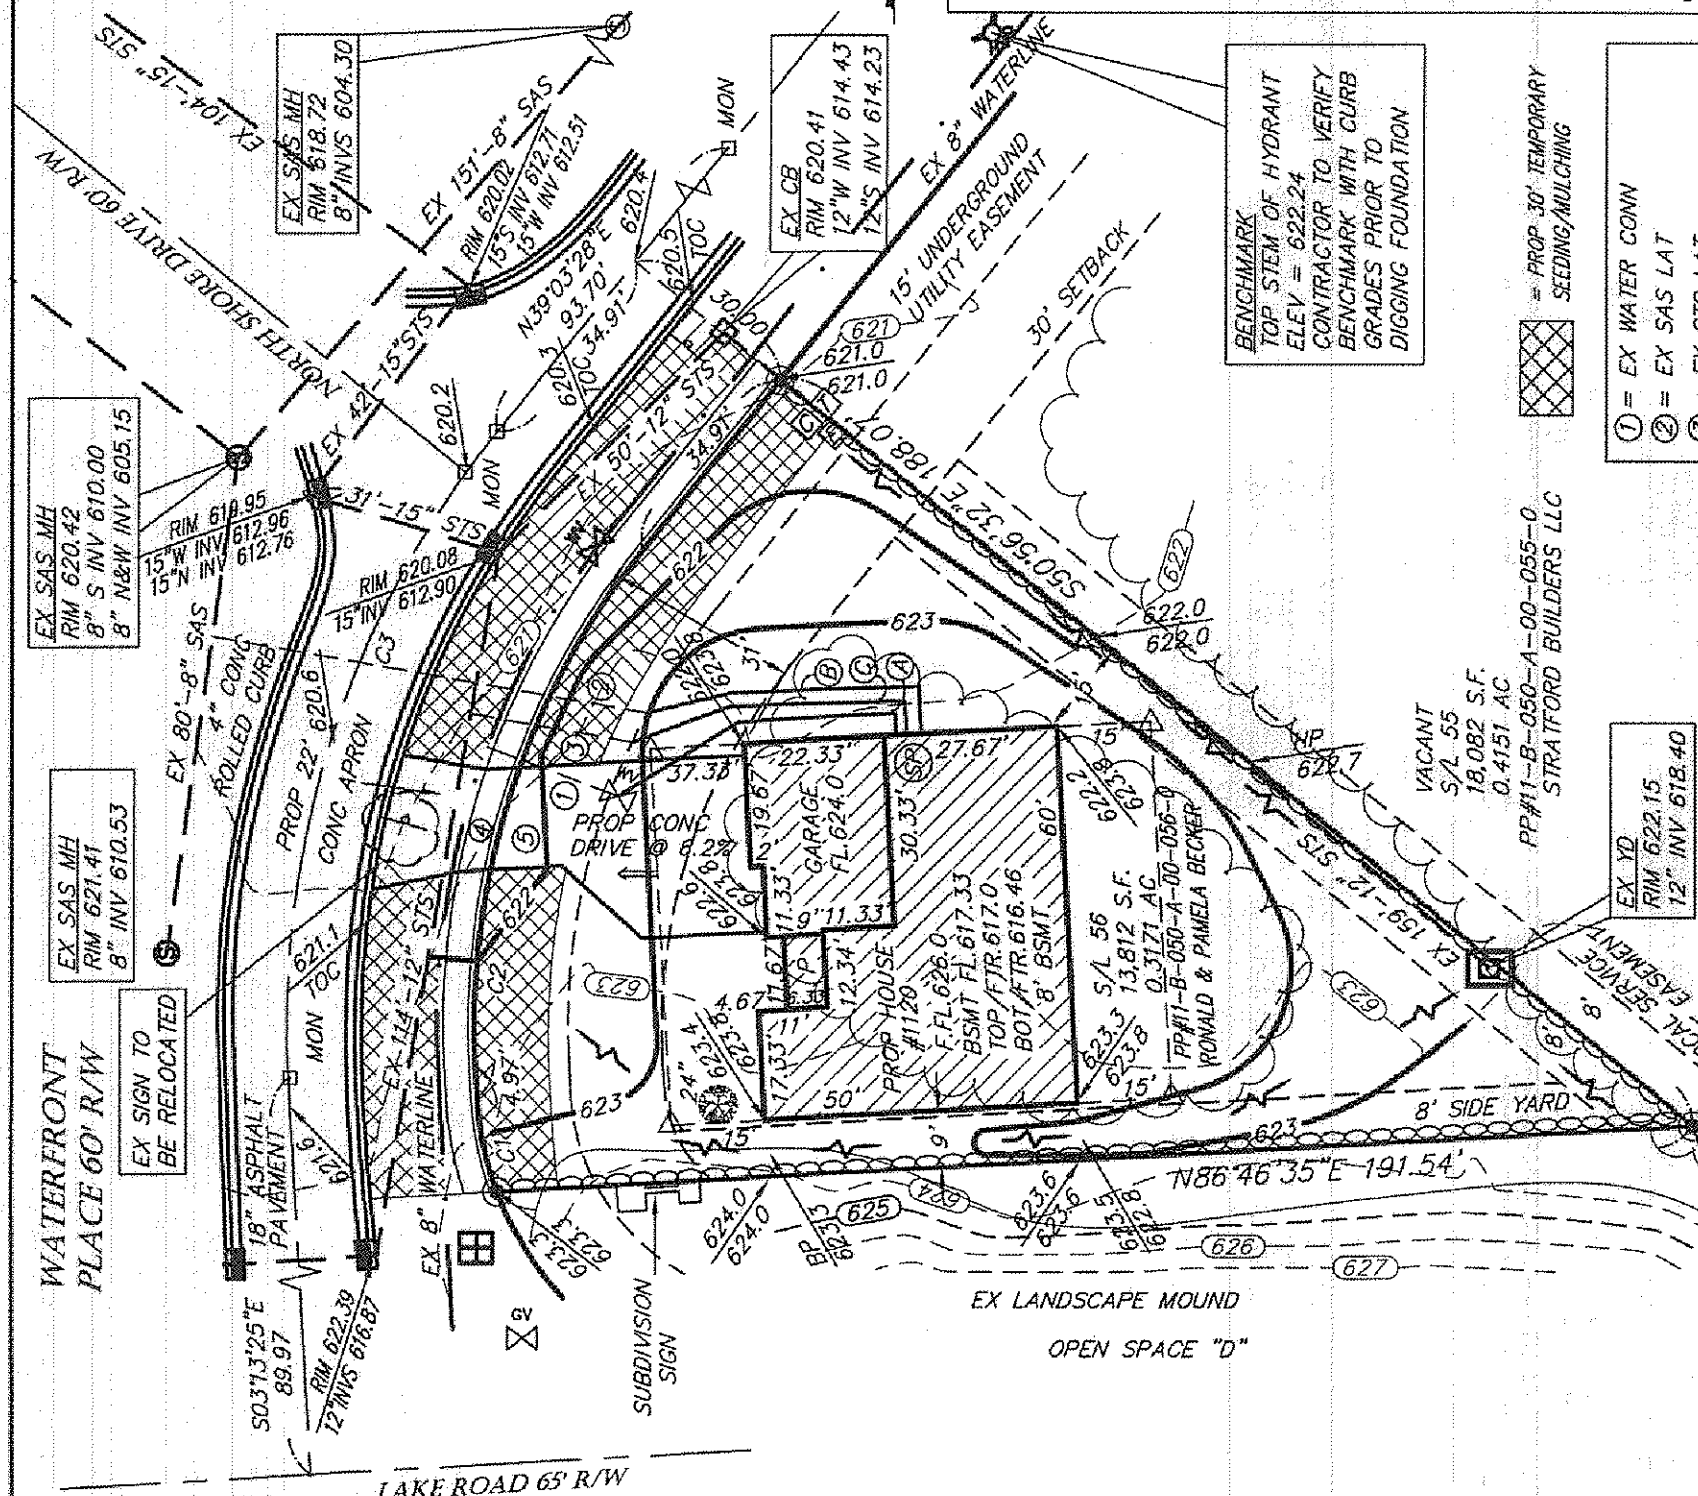

GRAPHIC SCALE
(IN FEET)
1 inch = 30 ft.

Stormwater Management Plan
approved as shown and/or noted
JAMES R. GILLS, P.E.
County Drainage Engineer
L.S. Date 4/22/11
Erosion and Sediment Notes

Ingress—Egress
A stone access drive for ingress and egress at the site shall be installed. This drive shall be the only entrance and exit to the site. The stone shall be underlain by

All slit fence shall be installed prior to any earthwork activities at the site in the locations shown on the plan. Slit fence shall be installed along the front of any lot that slopes towards the street. On sites where a perimeter of temporary seeding (or pre-existing vegetation) cannot be maintained due to limited space, a complete perimeter of slit fence shall be established.

Disturbed areas of the site that are to remain idle for more than twenty-one (21) days shall be seeded and straw mulched (or similar) within seven (7) days of completion of initial grading; this includes soil stockpiles. Temporary seeding and mulching of a thirty (30) foot strip of the entire front side and any other down-gradient side of the lot shall be maintained on the site once initial grading is complete.¹⁴

Stabilization of critical areas within fifty (50) feet of any stream or wetland shall be complete within two (2) days of the disturbance if the site is to remain inactive for longer than fourteen (14) days. Following completion of the construction activities, and the contractor leaving the site, the site soils must be fully stabilized by temporary seeding and/or mulching (or other acceptable process).

Mulching. Straw-mulch shall be applied at a rate of 1 bale per every ten (10) feet of curb, at a width of thirty (30) feet (or 1 bale/300 sq/ft). Wood chips may also be used but must be spread at a minimum depth of four inches over the thirty-foot width and must be accompanied by a properly installed silt fence.