


VILLAGE SURVEYING CO.
THOMAS M. COFFMAN, P.S.
202 THIRD STREET, FAIRPORT HARBOR, OH. 44077
(216) 357-1359

SCALE: 1" = 20'

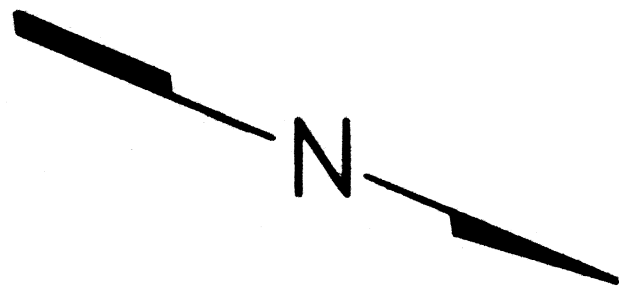

SITE PLAN

-- FOR --


JOE KRAVITS

Grading Plan Approved
as shown and/or noted
THOMAS P. GILLES, P.E.
Lake County Engineer

Date 10-10-87 By JFM

BEING A PART OF LOTS 48 & 49,
(OAKBROOK VILLAGE SUBDIVISION)
IN THE TOWNSHIP OF PERRY, COUNTY
OF LAKE, AND STATE OF OHIO.

BENCHMARK-687.31
INVERT STRM. SEWER MANHOLE

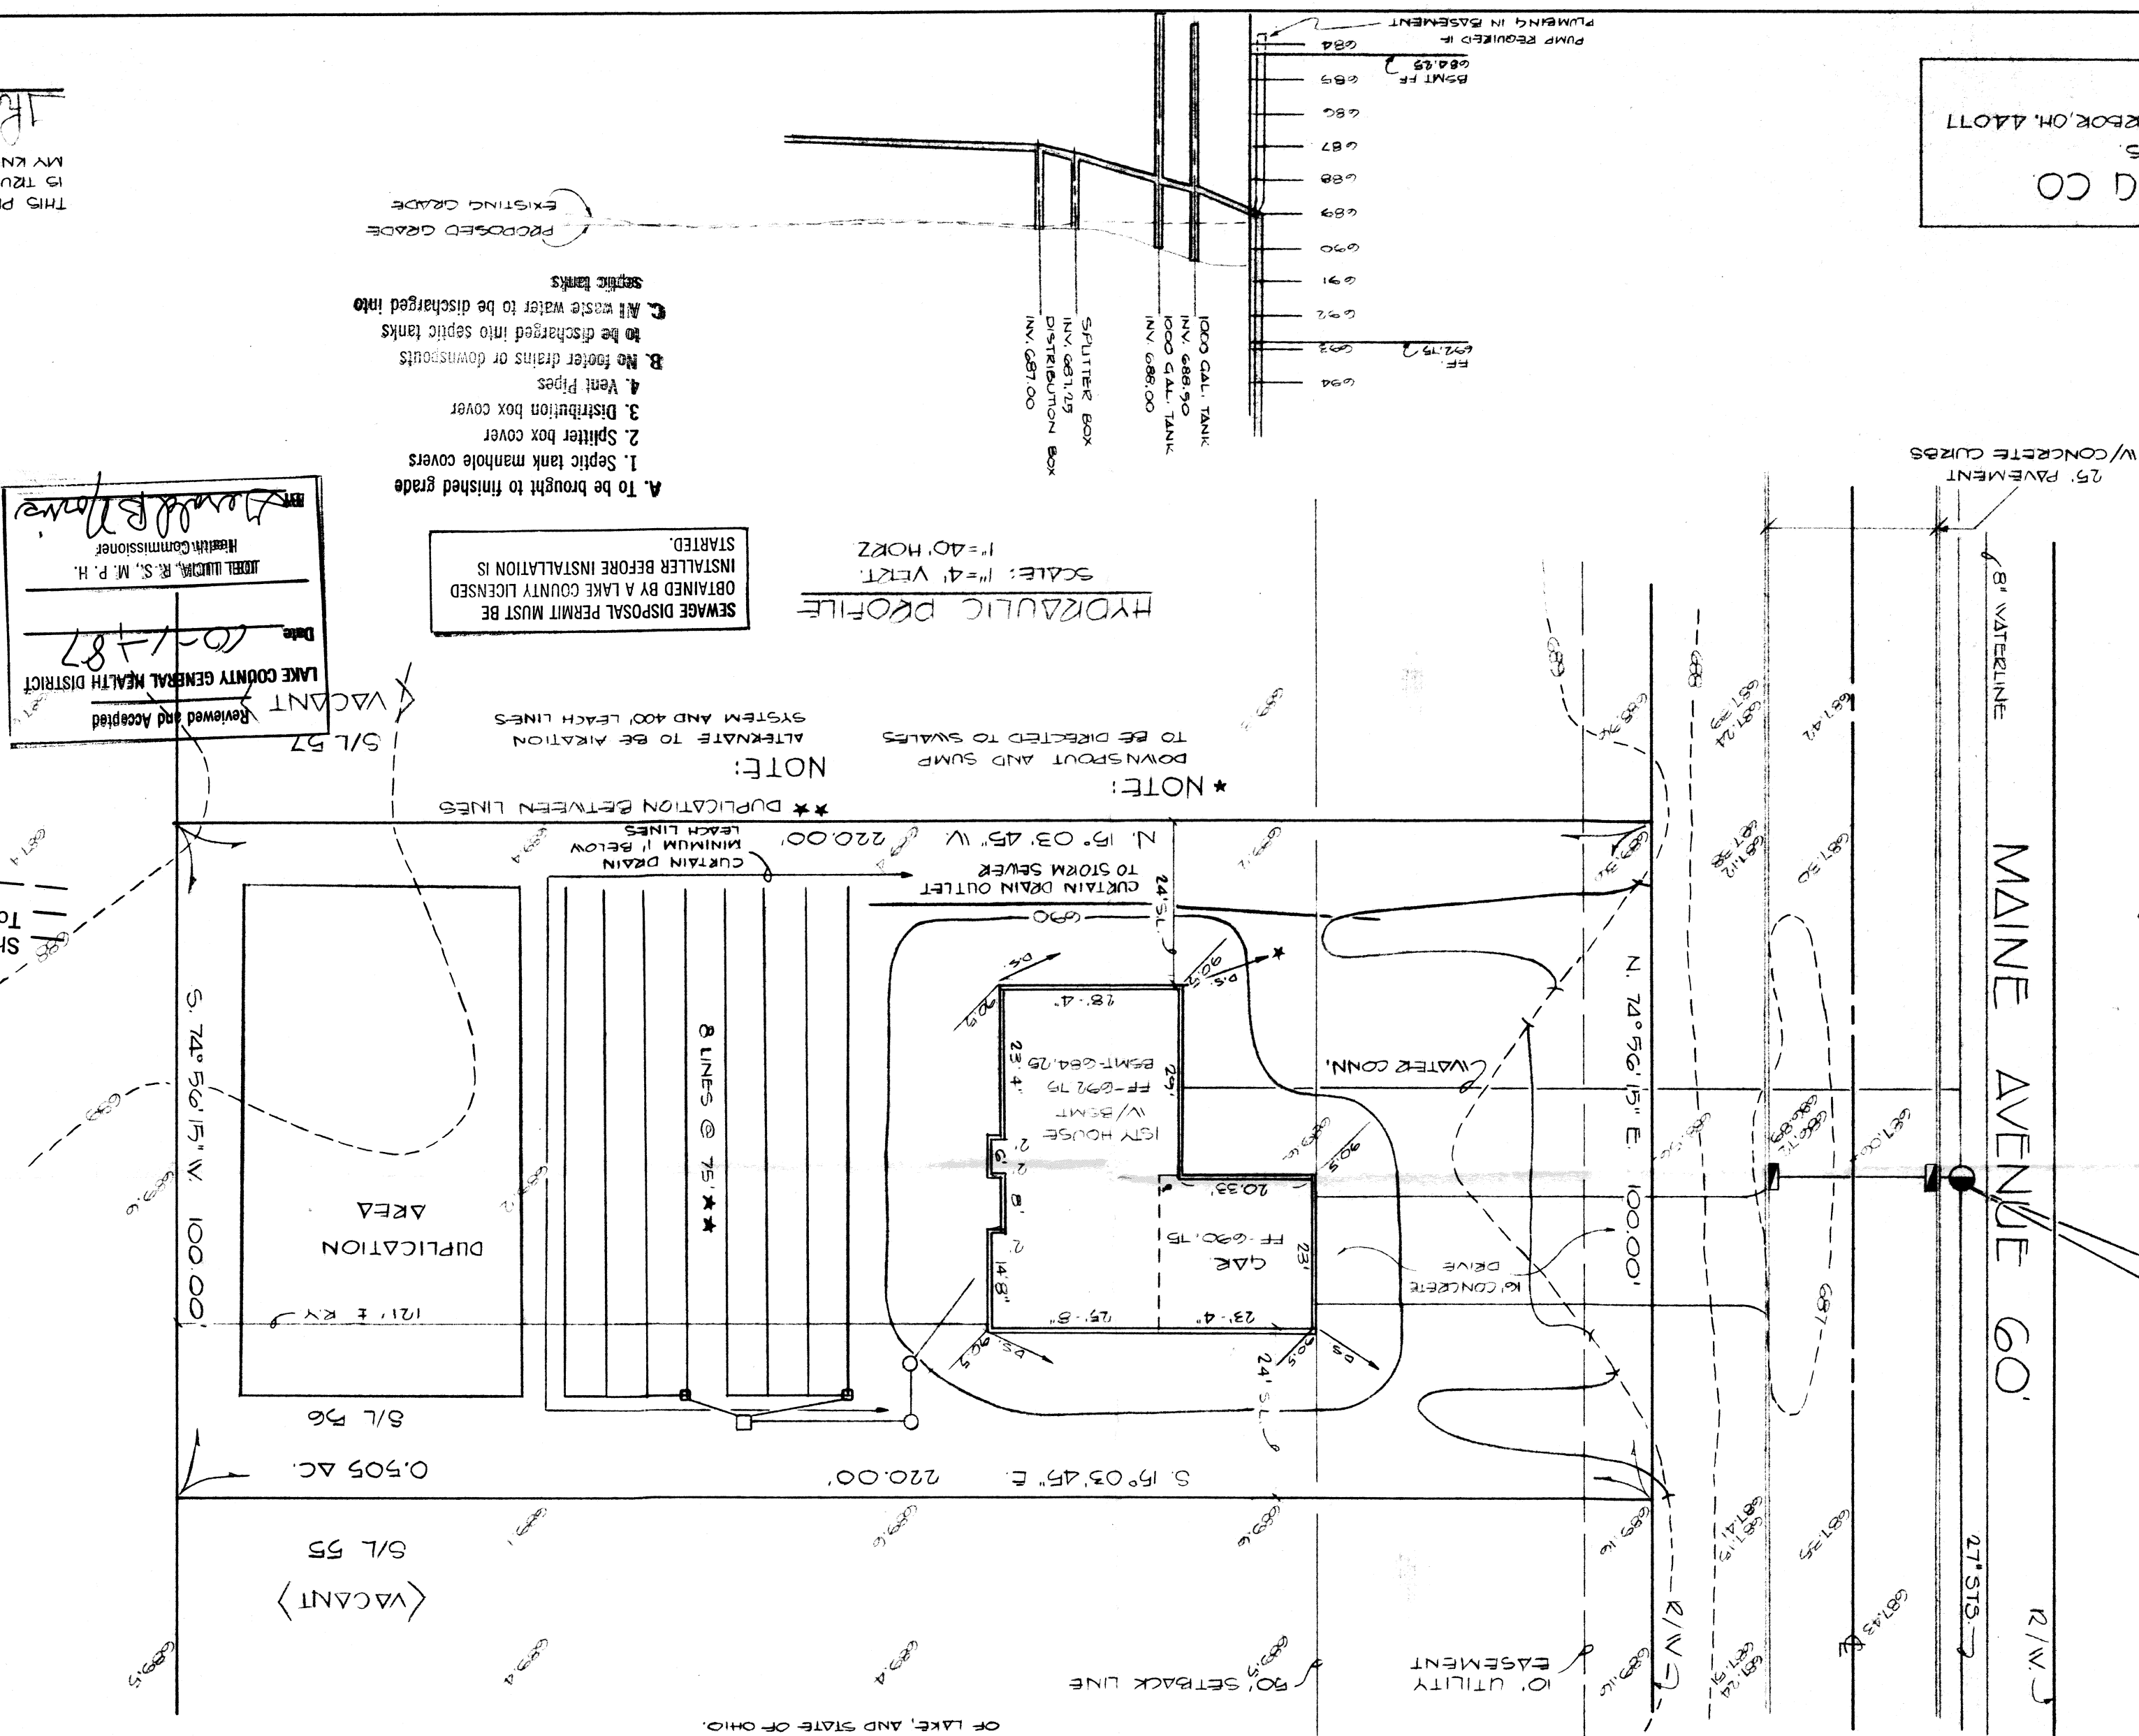

- A. to be brought to finished grade
1. Septic tank manhole covers
2. Splitter box cover
3. Distribution box cover
4. Vent Pipes
- B. No footer drains or downspouts
- C. All waste water to be discharged into septic tanks


SEWAGE DISPOSAL PERMIT MUST BE
OBTAINED BY A LAKE COUNTY LICENSED
INSTALLER BEFORE INSTALLATION IS
STARTED.

HYDRAULIC PROFILE

NOTE: DOWNSPOUT AND SUMP TO BE DIRECTED TO SWALES

NOTE: ** DUPLICATION BETWEEN LINE ALTERNATE TO BE AIRATION SYSTEM AND 400' LEACH LINES

LOW YIELD WATER
FIXTURES REQUIRED
ON ALL:
Power Head
Jilet

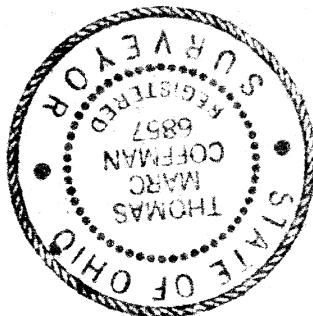

100-1787
 LAKE COUNTY GENERAL HEALTH DISTRICT
 Reviewed and Accepted
 Date: 10-17-87
 JOSEPH LUDWIG, R. S., M. P. H.
 Health Commissioner
 [Signature]

THIS PLAT WAS PREPARED BY ME AND
IS TRUE AND ACCURATE TO THE BEST OF
MY KNOWLEDGE AND BELIEF

THOMAS W. COFFMAN W. 6571