

Grading Plan Approved
as shown and/or noted
THOMAS P. GILLES, P.E.
Lake County Engineer

By GJH Date 3/23/93

* PER AGREEMENT w/ VILLAGE OF PERRY
DATED OCT. 27, 1992


SITE PLAN

FOR

JOHN CHESNIC

BEING S/L 38, RUSTIC VILLAGE
SUB'D., IN THE VILLAGE OF PERRY,
LAKE COUNTY, OHIO.

HYDRAULIC PROFILE
VERT. 1" = 3' HORIZ. 1" = 30'

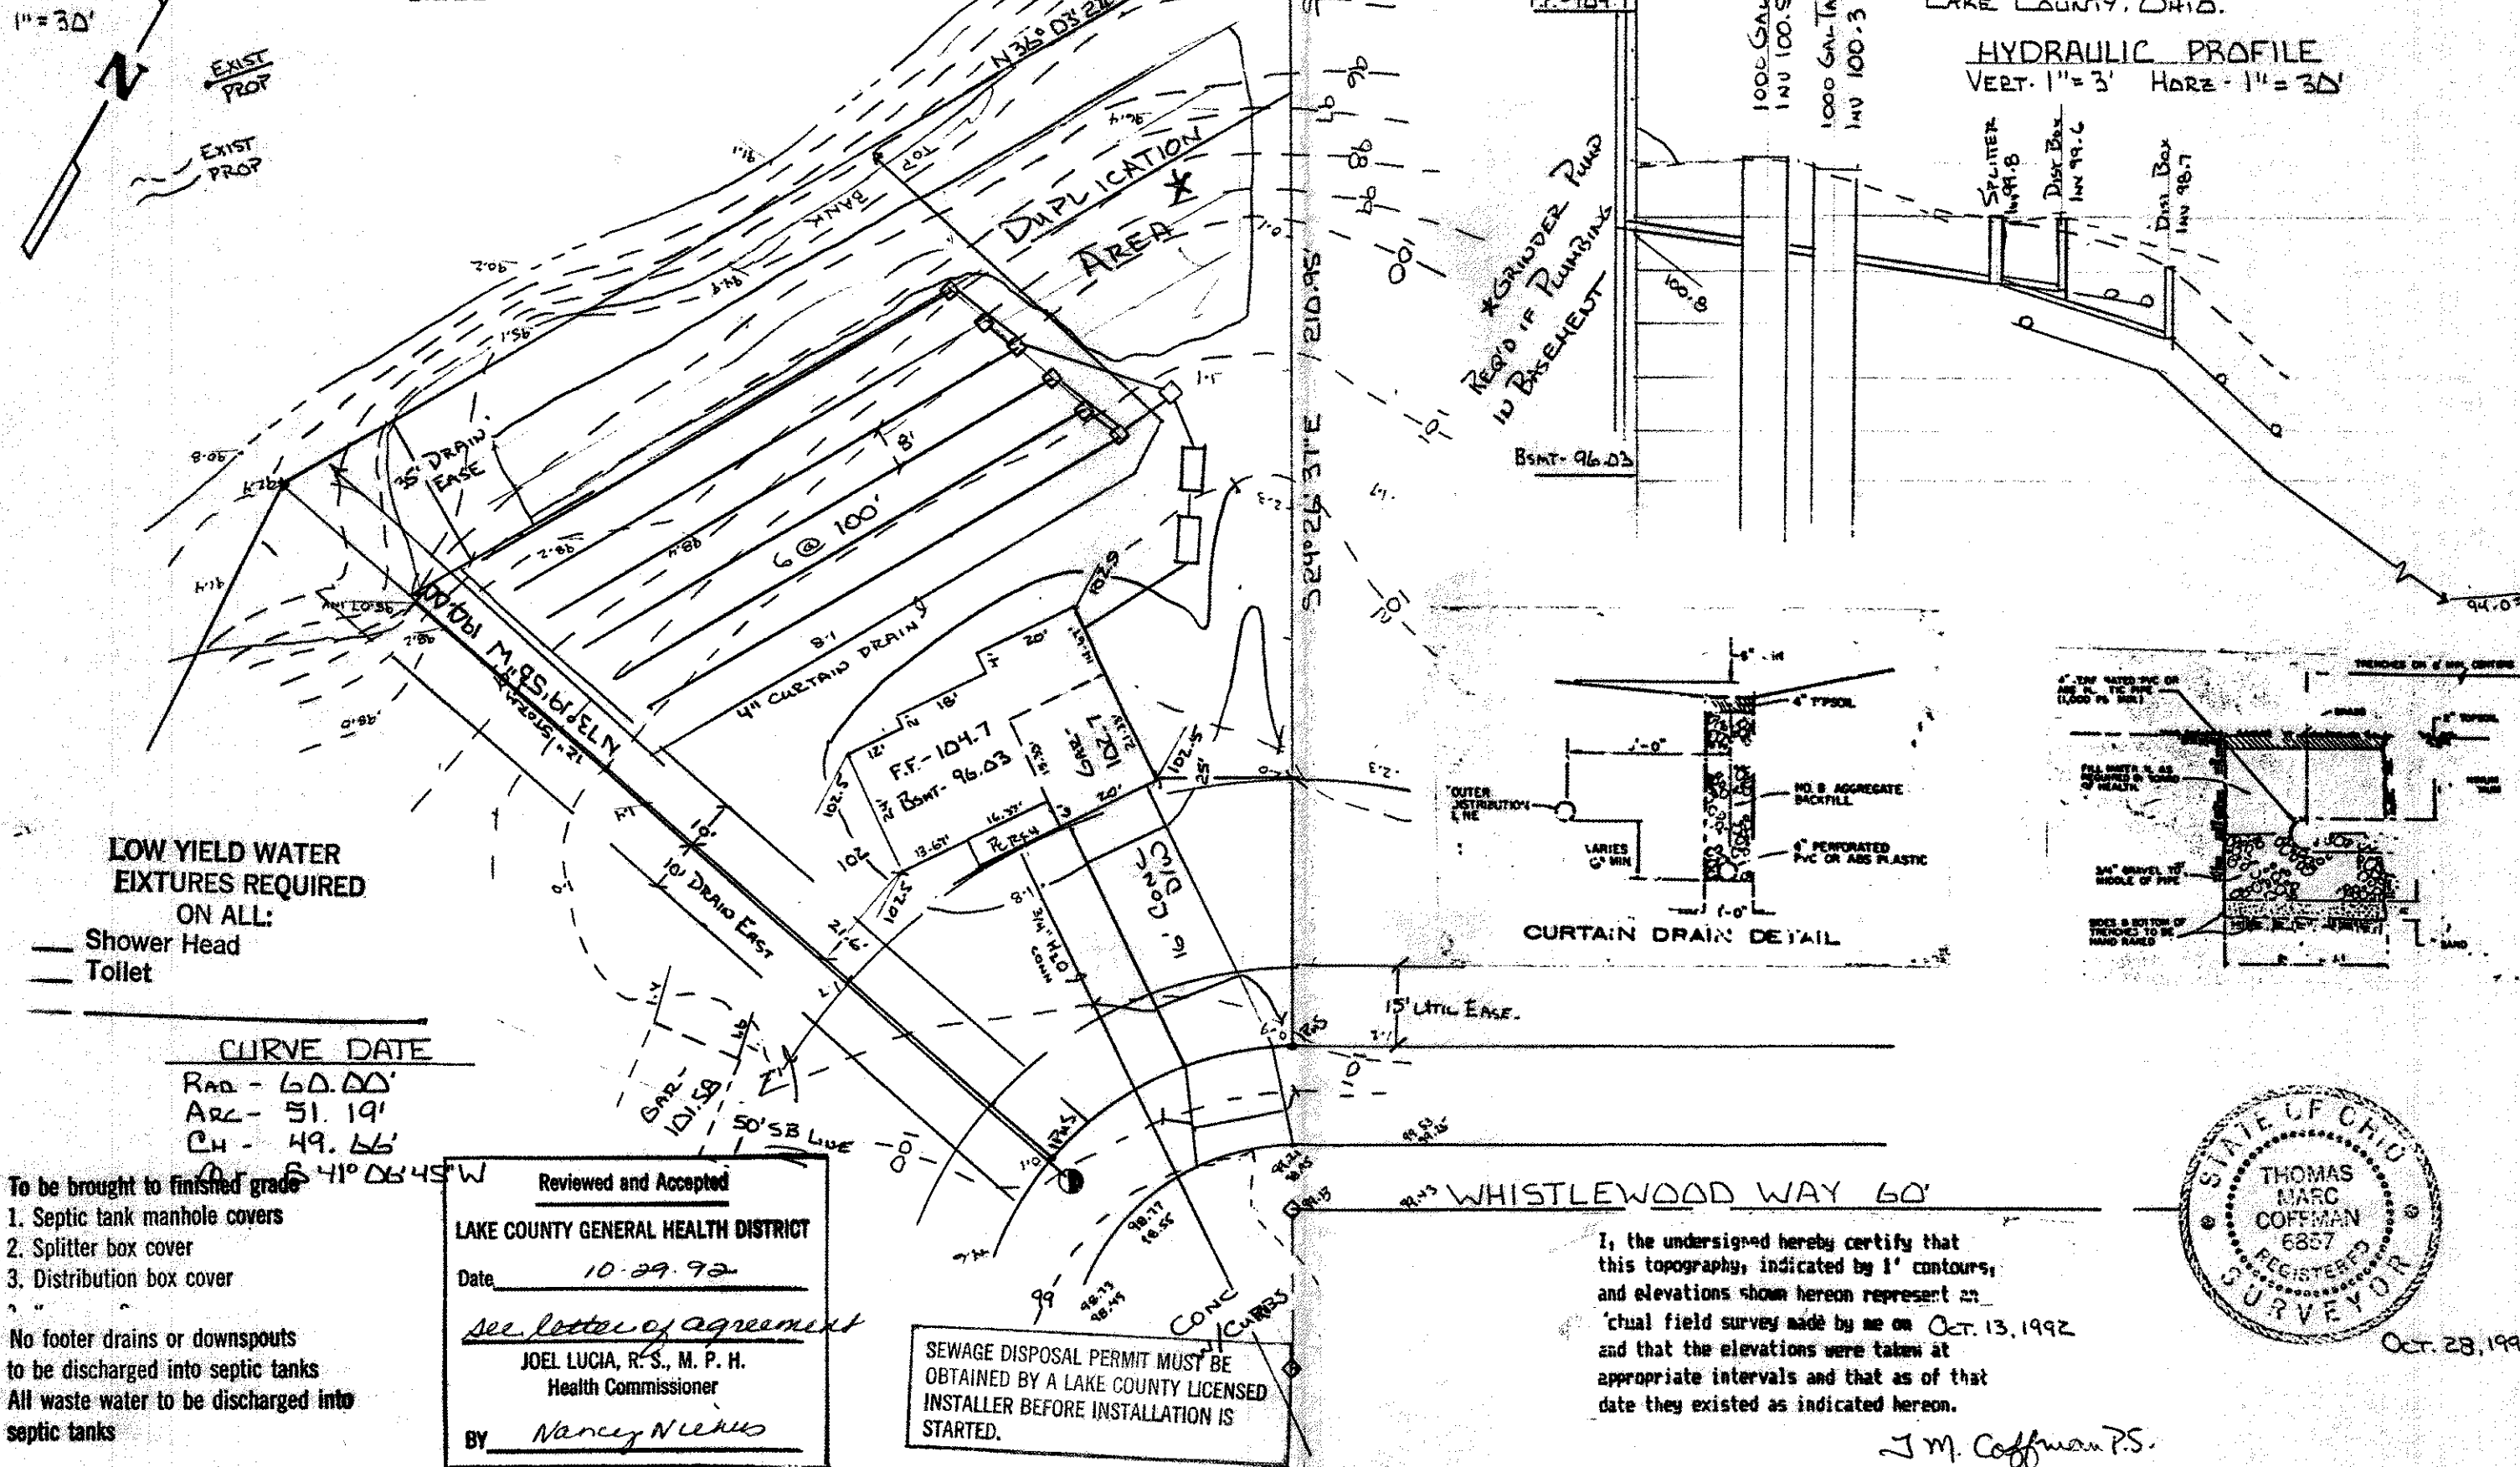

LOW YIELD WATER
FIXTURES REQUIRED
ON ALL:

- Shower Head
- Toilet

CURVE DATA

RAO - 60.00'
ARC - 51.19'
CH - 49.66'

A. To be brought to finished grade

1. Septic tank manhole covers
2. Splitter box cover
3. Distribution box cover

B. No footer drains or downspouts

to be discharged into septic tanks

C. All waste water to be discharged into
septic tanks

Reviewed and Accepted

LAKE COUNTY GENERAL HEALTH DISTRICT

Date 10-29-92



See Letter of Agreement

JOEL LUCIA, R.S., M. P. H.
Health Commissioner

BY Nancy Niekus


SEWAGE DISPOSAL PERMIT MUST BE
OBTAINED BY A LAKE COUNTY LICENSED
INSTALLER BEFORE INSTALLATION IS
STARTED.

CURTAIN DRAIN DETAIL

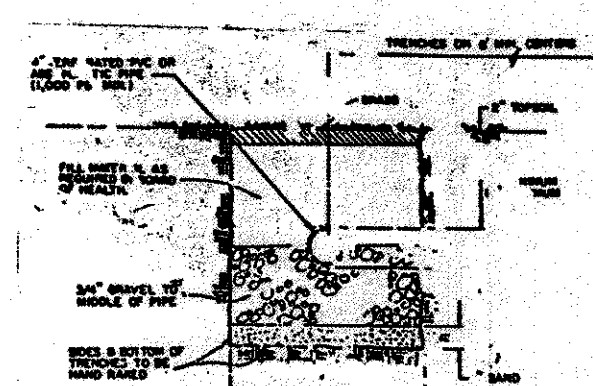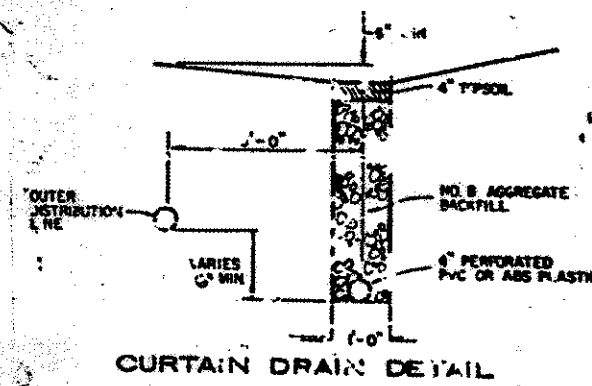

I, the undersigned hereby certify that
this topography, indicated by 1' contours,
and elevations shown hereon represent an
actual field survey made by me on Oct. 13, 1992
and that the elevations were taken at
appropriate intervals and that as of that
date they existed as indicated hereon.

J.M. Coffman P.S.

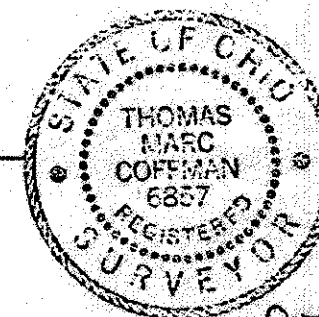

Oct. 28, 1992