



GRAPHIC SCALE



(IN FEET)
1 inch = 30 ft.

REVIEWED BY:
Polaris Engineering & Surveying, Inc.
Charles W. Szyz 2/3/09
Name Date
This Review is for general plan & scope only and does not relieve the author of these documents from professional responsibility for accuracy of design or omissions.

Stormwater Management Plan
Approved as shown and/or noted
JAMES R. GILLS, P.E.
County Drainage Engineer
By L.S. Date 5/26/09

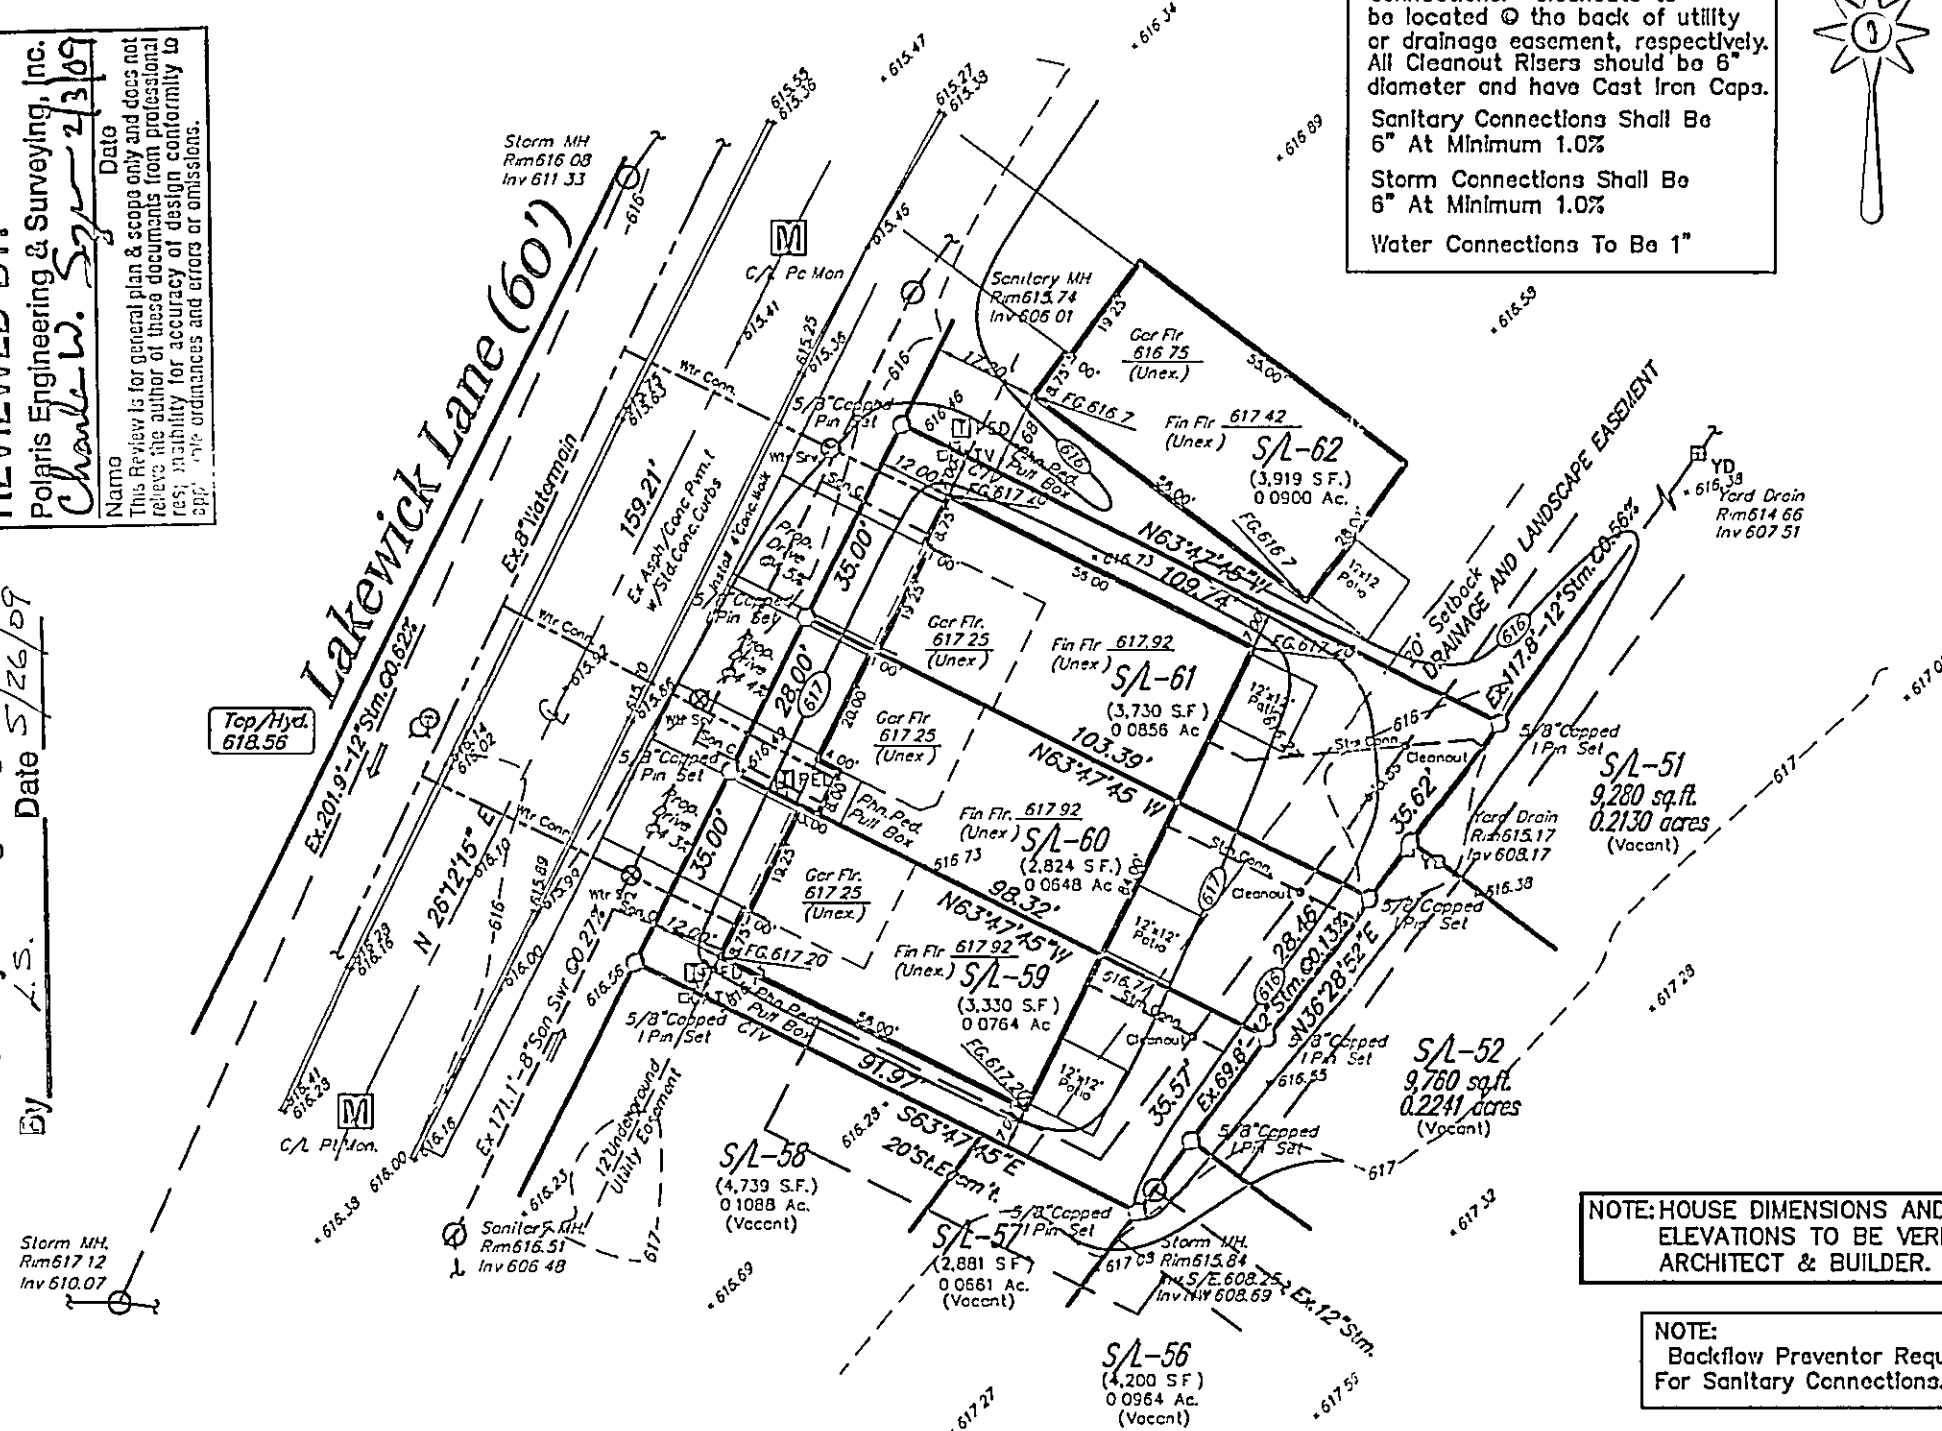

NOTES:
Backflow Preventor Required For Sanitary Connections.
Cleanouts shall be provided for sanitary & storm connections. Cleanouts to be located @ the back of utility or drainage easement, respectively. All Cleanout Risers should be 6" diameter and have Cast Iron Caps.
Sanitary Connections Shall Be 6" At Minimum 1.0%
Storm Connections Shall Be 6" At Minimum 1.0%
Water Connections To Be 1"




SITE PLAN FOR:
SUBLOT No's. 59, 60, 61, Add. #313, 315, 317
PPN: 28-A-041-N-00-059, 060, 061-0
SHORELAND CROSSINGS No. 2
CITY OF WILLOWICK - LAKE COUNTY - OHIO

SURVEYOR CERTIFICATION


I HEREBY CERTIFY THAT I HAVE SURVEYED THE PREMISES AND PREPARED THE ATTACHED PLAT IN ACCORDANCE WITH THE PROVISIONS OF CHAPTER 4733-37 OF THE OHIO ADMINISTRATIVE CODE AND THE DIMENSIONS OF THE LOTS AND ROAD ARE IN FEET AND DECIMAL PARTS THEREOF, ALL OF WHICH ARE CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF, IRON MONUMENTS OR PINS AS INDICATED WERE FOUND OR SET AS SHOWN HEREON

Daniel Laux
DANIEL LAUX P.S. #7087 DATE

STATE SEAL

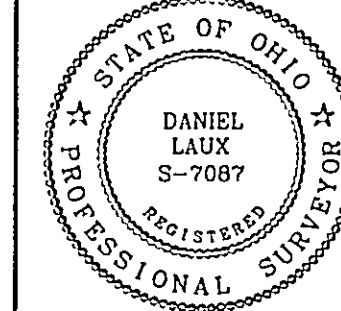

STATE SEAL

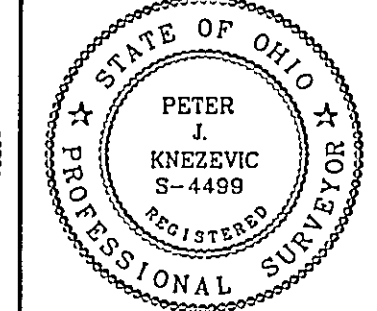

DESIGN CERTIFICATION

THIS PLAN WAS PREPARED BY ME, AND IS CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF.

Peter J. Knezevic
PETER J. KNEZEVIC, P.S. 4499 DATE

"AS-BUILT" CERTIFICATION

I HEREBY CERTIFY THAT THE CIRCLED INFORMATION IS EXISTING AS OBTAINED ON THE SITE AND IS CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF.

NAME

DATE

Prepared By:

PETER J. KNEZEVIC, P.S.
30102 Rickay Lane
Wickliffe, Ohio 44092
(440) 944-3794

Prepared For:

B.R. Knez Construction, Inc.
8023 Crillo Road
Unit 250
Concord Township, Ohio 44077
(440) 710-0711

BENCHMARK:

B.M. = T.B.M Set On Top Of Hydrant
Located As Noted
Elevation 618.56

DATE: 2/3/09

SCALE: HOR. 1"=30'

VERT. 1"=0'

FILE NAME: unit59-61.dwg

COMPUTER: S

CREW CHIEF: R.D.W.

CONTRACT No.

07067-S/L 59-61

SHEET

1

OF

1

NOTE: HOUSE DIMENSIONS AND FLOOR ELEVATIONS TO BE VERIFIED BY ARCHITECT & BUILDER.

NOTE:
Backflow Preventor Required For Sanitary Connections.

EXISTING UNDERGROUND UTILITIES NOTE:
THE SIZE AND LOCATION, BOTH HORIZONTAL AND VERTICAL OF THE UNDERGROUND UTILITIES SHOWN HEREON, HAVE BEEN OBTAINED BY A SEARCH OF AVAILABLE RECORDS. VERIFICATION BY FIELD OBSERVATION HAS BEEN CONDUCTED WHERE PRACTICAL. HOWEVER, DESIGNER DOES NOT GUARANTEE THE COMPLETENESS NOR ACCURACY THEREOF



2 WORKING DAYS
BEFORE YOU DIG



CALL TOLL FREE 800-362-2764

OHIO UTILITIES PROTECTION SERVICE
NON-MEMBERS MUST BE CALLED DIRECT