



PLAN VIEW

- ### CONCRETE REPLACEMENT NOTES
1. Cleaning shall closely precede the placing of the Class S concrete. The deck sections forming the perimeter around the removed concrete plus the exposed reinforcing steel shall be thoroughly cleaned by sandblasting followed by an air blast. It may be necessary to use hand tools to remove scale from the reinforcing steel.
  2. Deteriorated reinforcing steel shall be replaced as directed by the Engineer prior to placing the new concrete. Payment shall be made under ITEM 509 - REINFORCING STEEL.
  3. The newly placed Class S concrete surface shall not be scarified, but shall be prepared according to proposal note 111-80, dated 12-8-86. It shall be placed to meet the top of the existing deck after it has been scarified.

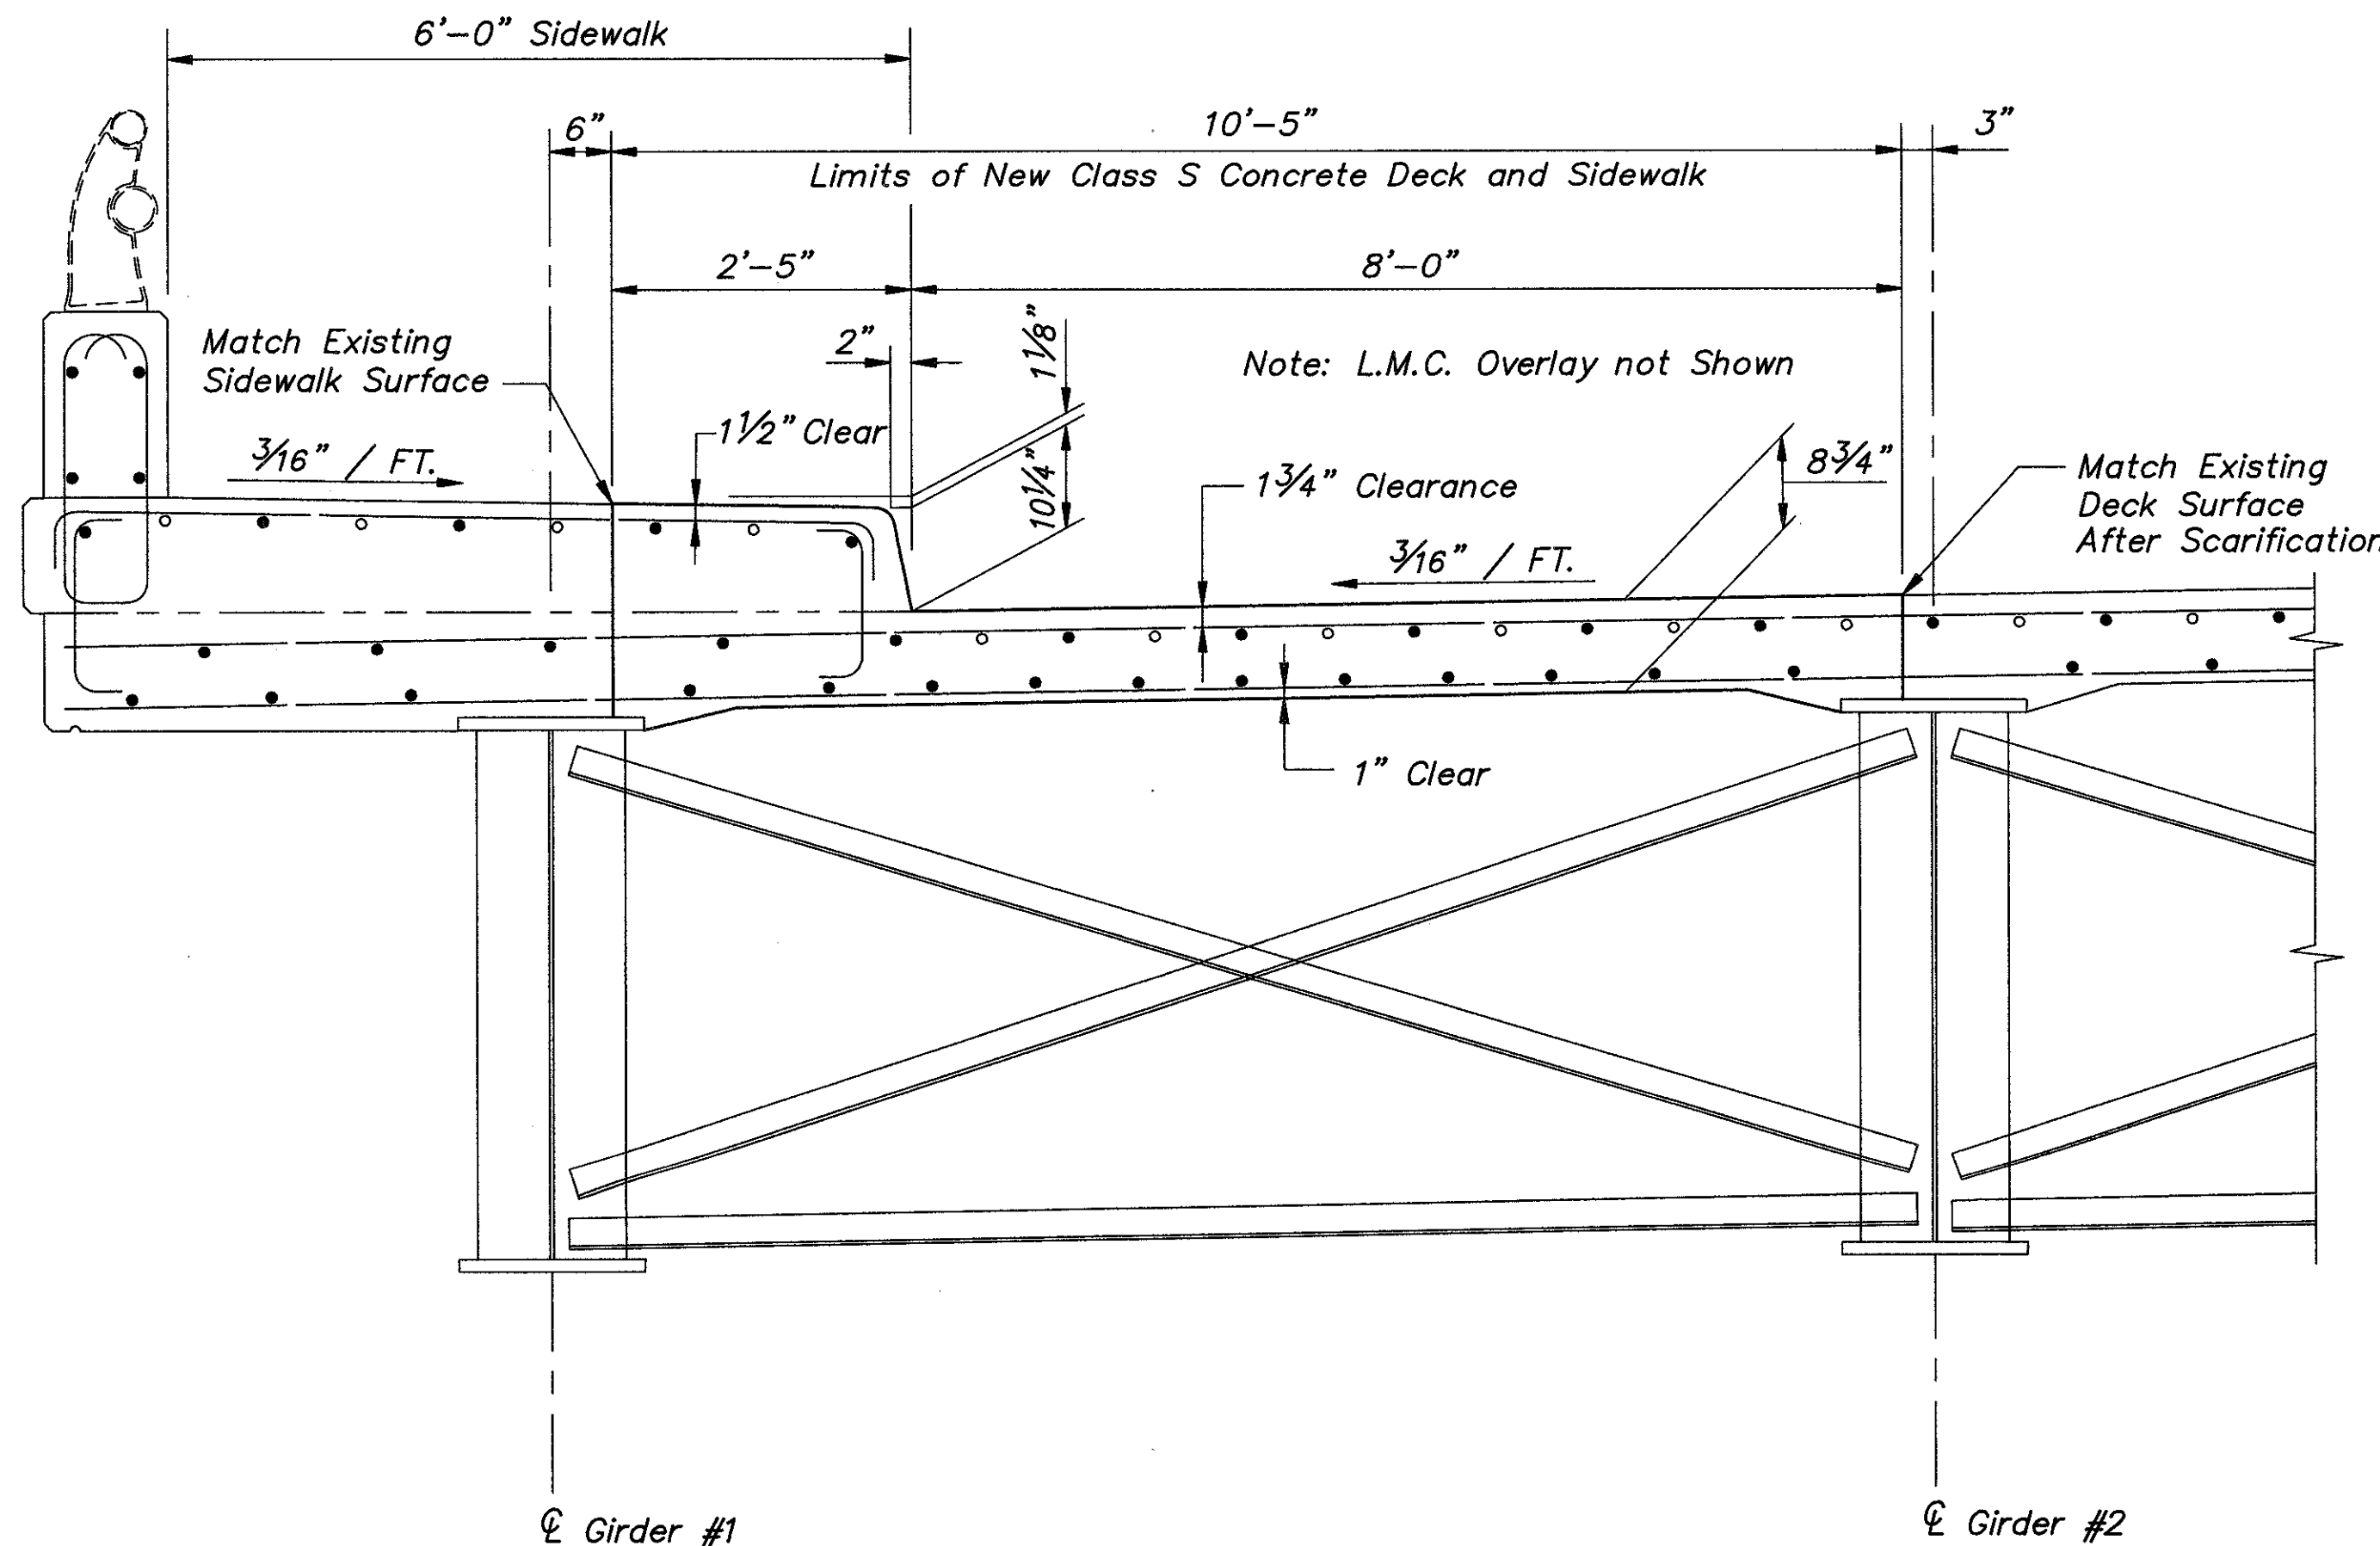

SECTION B-B

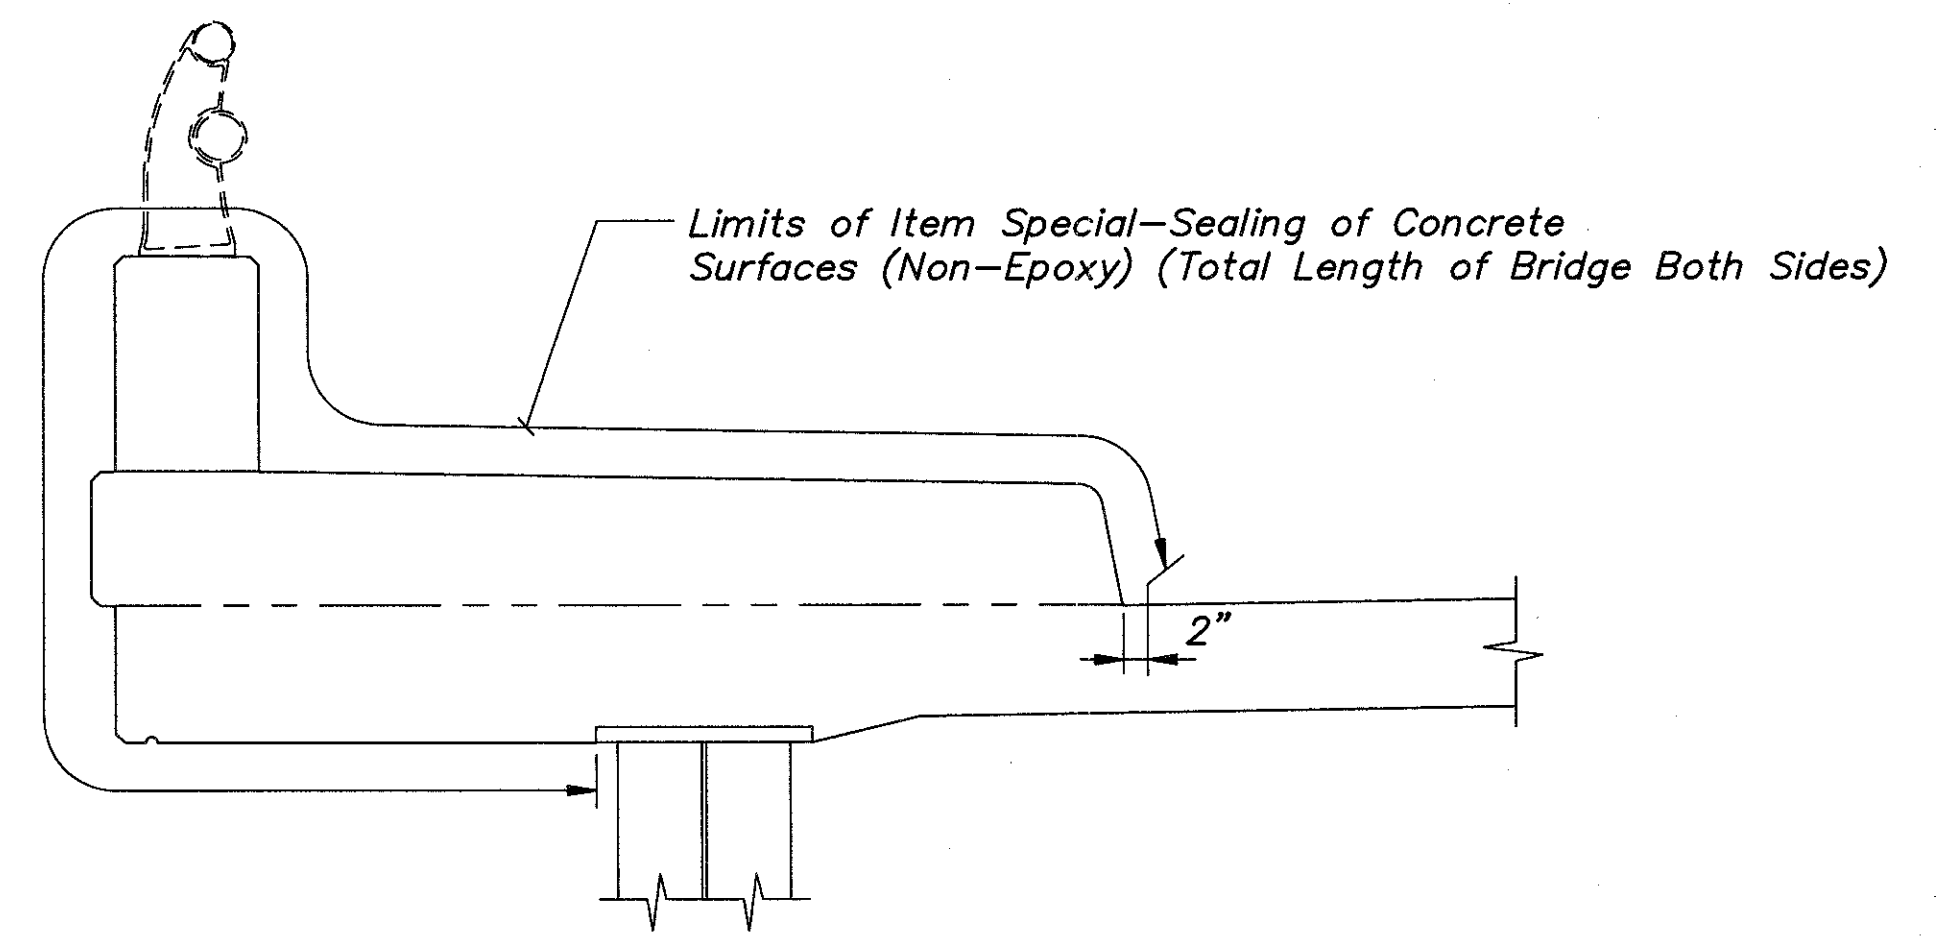

SEALANT LIMITS

		<b>COLPETZER-THOMAS, INC.</b> AN ENGINEERING GROUP <small>WILLOUGHBY • MENTOR • NORTH CANTON • STEUBENVILLE • LORAIN</small>		16 / 21		
<b>PARTIAL DECK REPLACEMENT</b> <b>LAK-615-0402</b> LAKE COUNTY						
DESIGNED	DRAWN	TRACED	CHECKED	REVIEWED	DATE	REVISED
JPR	R.L.B.	R.L.B.	RJC	JEA	9-22-88	