


FOR POLE & DUCT DETAILS
SEE SHEETS NO. 275&276

NEW SIDEWALKS TO BE CONSTRUCTED
RT. & LT.

FOR OTHER CONSTRUCTION DETAILS
SEE SHEET NO. 232

DUCT WIRING

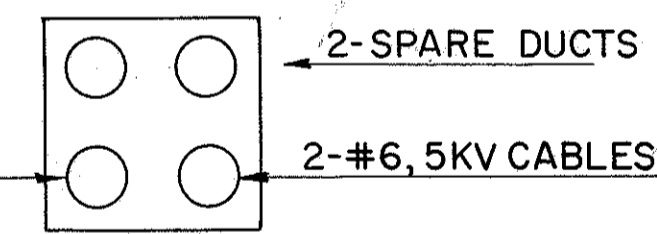

FOR DUCT CONSTRUCTION
DETAILS SEE SHEET
NO. 275

(P) POWER

REF. NO.	STATION		SIDE	POLE 40 FT. CLASS 4	CROSS ARM		ANCHOR GUY 4800 LB.	SPAN GUY 2300 LB.	FUSED CUTOUT 200 A. 5 KV	LIGHTNING ARRESTOR 2.4 KV	GROUND PLATE ASSEMBLY	INSULATOR DEAD-END 4 KV	DEAD-END BRACKET MSL
	FROM	TO			DOUBLE	SINGLE							
1-P	28+12	29+08	Rt.	1		2	1		2	2	1	4	1
3-P	30+82.5	31+30	Rt.	1	1	2	1	50	2	2	1	4	1
TOTAL				2	2	4	2	50	4	4	2	8	2

(P) POWER

REF. NO.	STATION		SIDE	PIN INSULATOR 4 KV	NO. 4 TRIPLEX L.F.	RELOCATED STREET LIGHT	#6 WP WIRE	4-WAY DUCT	ALUMINUM ELL 4"	ALUMINUM CONDUIT 4"	1/C CABLE 5 KV		REMOVE POLE
	FROM	TO									#4	#6	
1-P	28+12	29+08	Rt.	6	85		530	181	8	200	630	420	
2-P	29+08	30+82.5	Rt.	6									
3-P	30+82.5	31+30	Rt.	6									
4-P	29+28	30+29	Rt.			1							2
TOTAL				12	85	1	530	181	8	200	630	420	2

