


FRONT ELEVATION
(POST AND PANEL NOISE BARRIER)

NOTE: MAXIMUM STEP IN TOP ELEVATION WILL BE 12 INCHES FOR AESTHETIC PURPOSES.

NOTE: ALL NOISE WALL DESIGNS WILL BE REQUIRED TO HAVE A CAP ON TOP OF THE WALL FOR AESTHETIC PURPOSES.

NOTE: A NOISE WALL ALIGNMENT WHICH ENCOUNTERS AN OBSTRUCTION IN ITS PATH WILL BE REQUIRED TO VEER 30° FROM ITS ORIGINAL ALIGNMENT TO AVOID THE OBSTRUCTION. IT SHOULD CONTINUE AT LEAST 16 FEET PARALLEL TO THE ORIGINAL ALIGNMENT AND THEN RETURN 30° BACK TO THE ORIGINAL ALIGNMENT AFTER HAVING CLEARED THE OBSTRUCTION. (I.E. LIGHT POSTS, SIGN SUPPORTS ECT.)

NOTE: FOR DRAINAGE INLETS BELOW TYPE D CONCRETE BARRIER CONSULT THE STANDARD CONSTRUCTION DRAWING I-2.3 CONCRETE BARRIER (TYPE D) INLET.

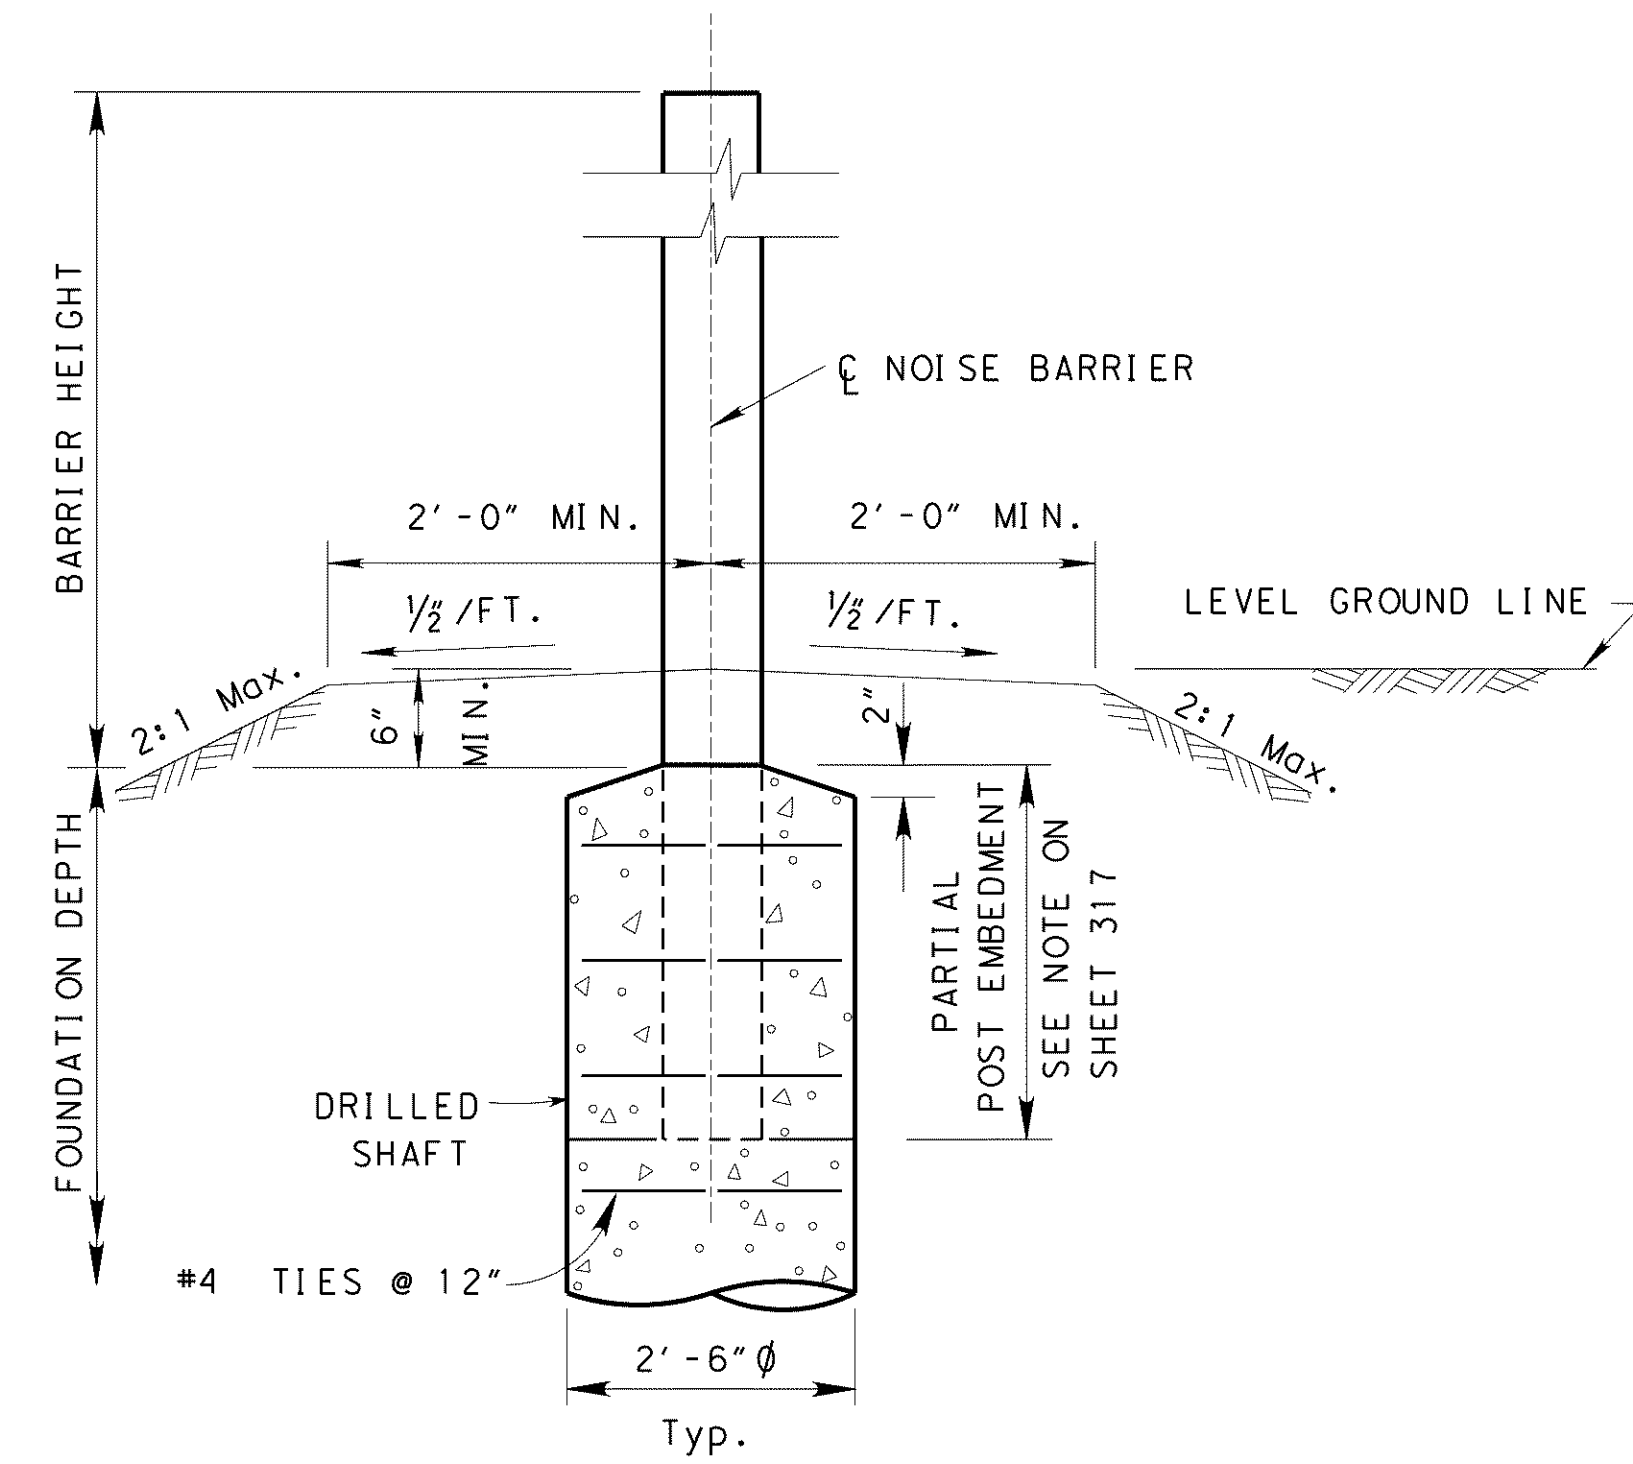

IF A FRONT MOUNTED NOISE WALL PANEL IS REQUIRED TO BE CUT OR PHYSICALLY ALTERED IN SOME OTHER MANNER THAT WILL STRUCTURALLY DAMAGE THE MANUFACTURER'S STANDARD PANEL SECTION, THE DETAILS SHALL BE SUBMITTED TO THE ENGINEER FOR APPROVAL.

THE NOISE WALL PANELS SHALL EXTEND DOWN TO THE TOP OF THE POST FOOTING OR BE EMBEDDED A MINIMUM 6 INCHES BELOW THE FINISHED GRADELINE. NO ADDITIONAL PAYMENT SHALL BE MADE TO THE CONTRACTOR FOR ANY ADDITIONAL MATERIALS OR LABOR REQUIRED TO CONSTRUCT THE OPTION.