

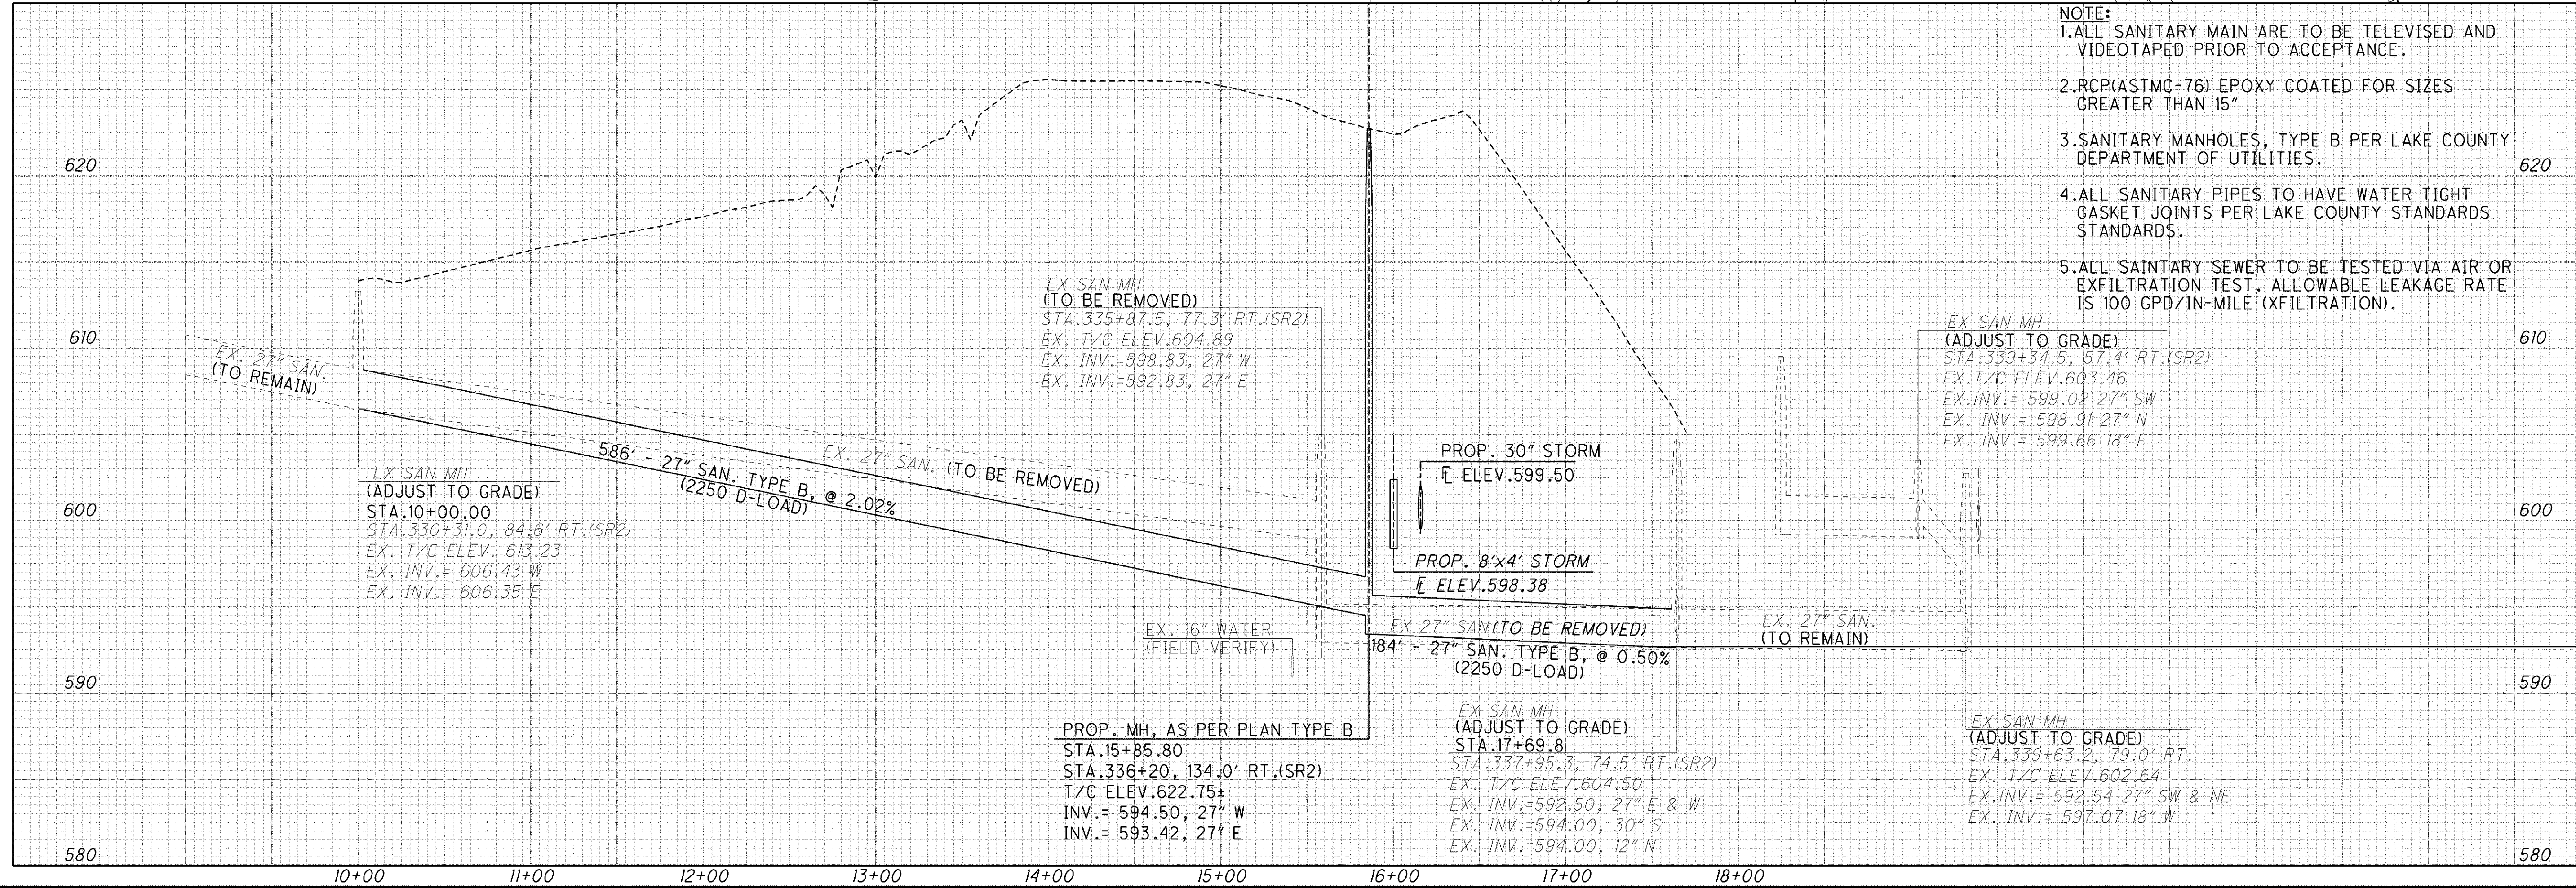


REF. NO.	LOCATION				202		603	604	SPECIAL
	STATION		ROAD	SIDE	PIPE REMOVED OVER 24"	MANHOLE REMOVED	27" CONDUIT, TYPE B 706.03	MANHOLE, ADJUST TO GRADE	MANHOLE, AS PER PLAN, TYPE B
	FROM	TO							
SS-1	10+00 (330+31)	15+85.8 (336+20)	(SR2)	☐	EACH	EACH	FEET	EACH	EACH
SS-2	15+85.8 (336+20)	17+69.8 (337+95)	(SR2)	☐	179		184	1	1
SHEET TOTAL					765	1	770	2	1

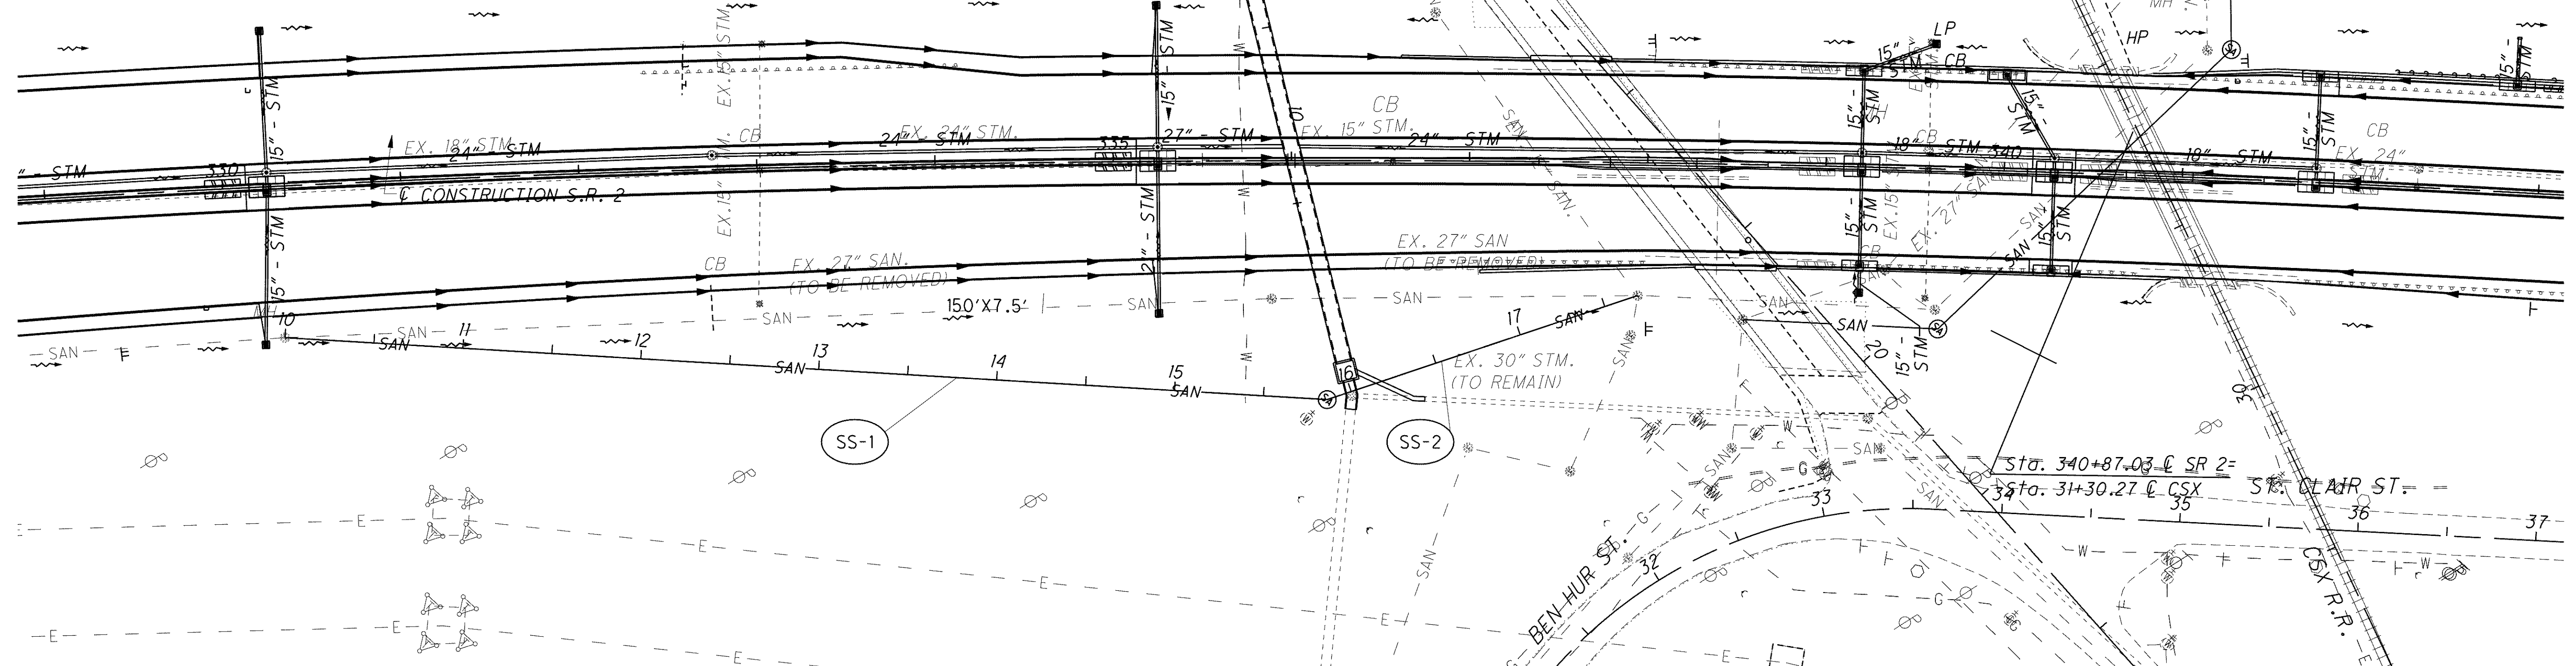

- NOTE:**
1. ALL SANITARY MAIN ARE TO BE TELEVIEWED AND VIDEOTAPED PRIOR TO ACCEPTANCE.
  2. RCP (ASTM C-76) EPOXY COATED FOR SIZES GREATER THAN 15"
  3. SANITARY MANHOLES, TYPE B PER LAKE COUNTY DEPARTMENT OF UTILITIES.
  4. ALL SANITARY PIPES TO HAVE WATER TIGHT GASKET JOINTS PER LAKE COUNTY STANDARDS.
  5. ALL SAINTARY SEWER TO BE TESTED VIA AIR OR EXFILTRATION TEST. ALLOWABLE LEAKAGE RATE IS 100 GPD/IN-MILE (XFILTRATION).

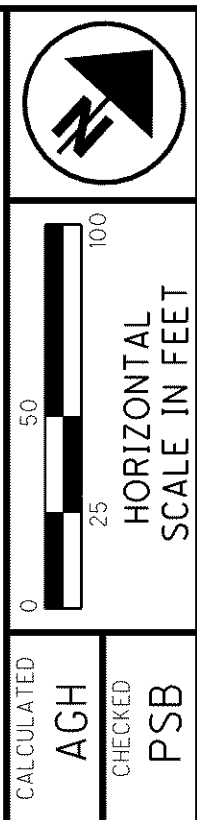

**SANITARY SEWER PLAN AND PROFILE  
STA. 00+00 TO STA. 00+00**

**LAK-2-3.32**

c:\Project\lak\utilities\sheets\13486\005.dgn 6/26/2008 3:42:09 PM djozly