


g:\project\lak\13486\lighting\sheets\13486LP009.dgn 7/11/2008 8:49:38 AM cshoner

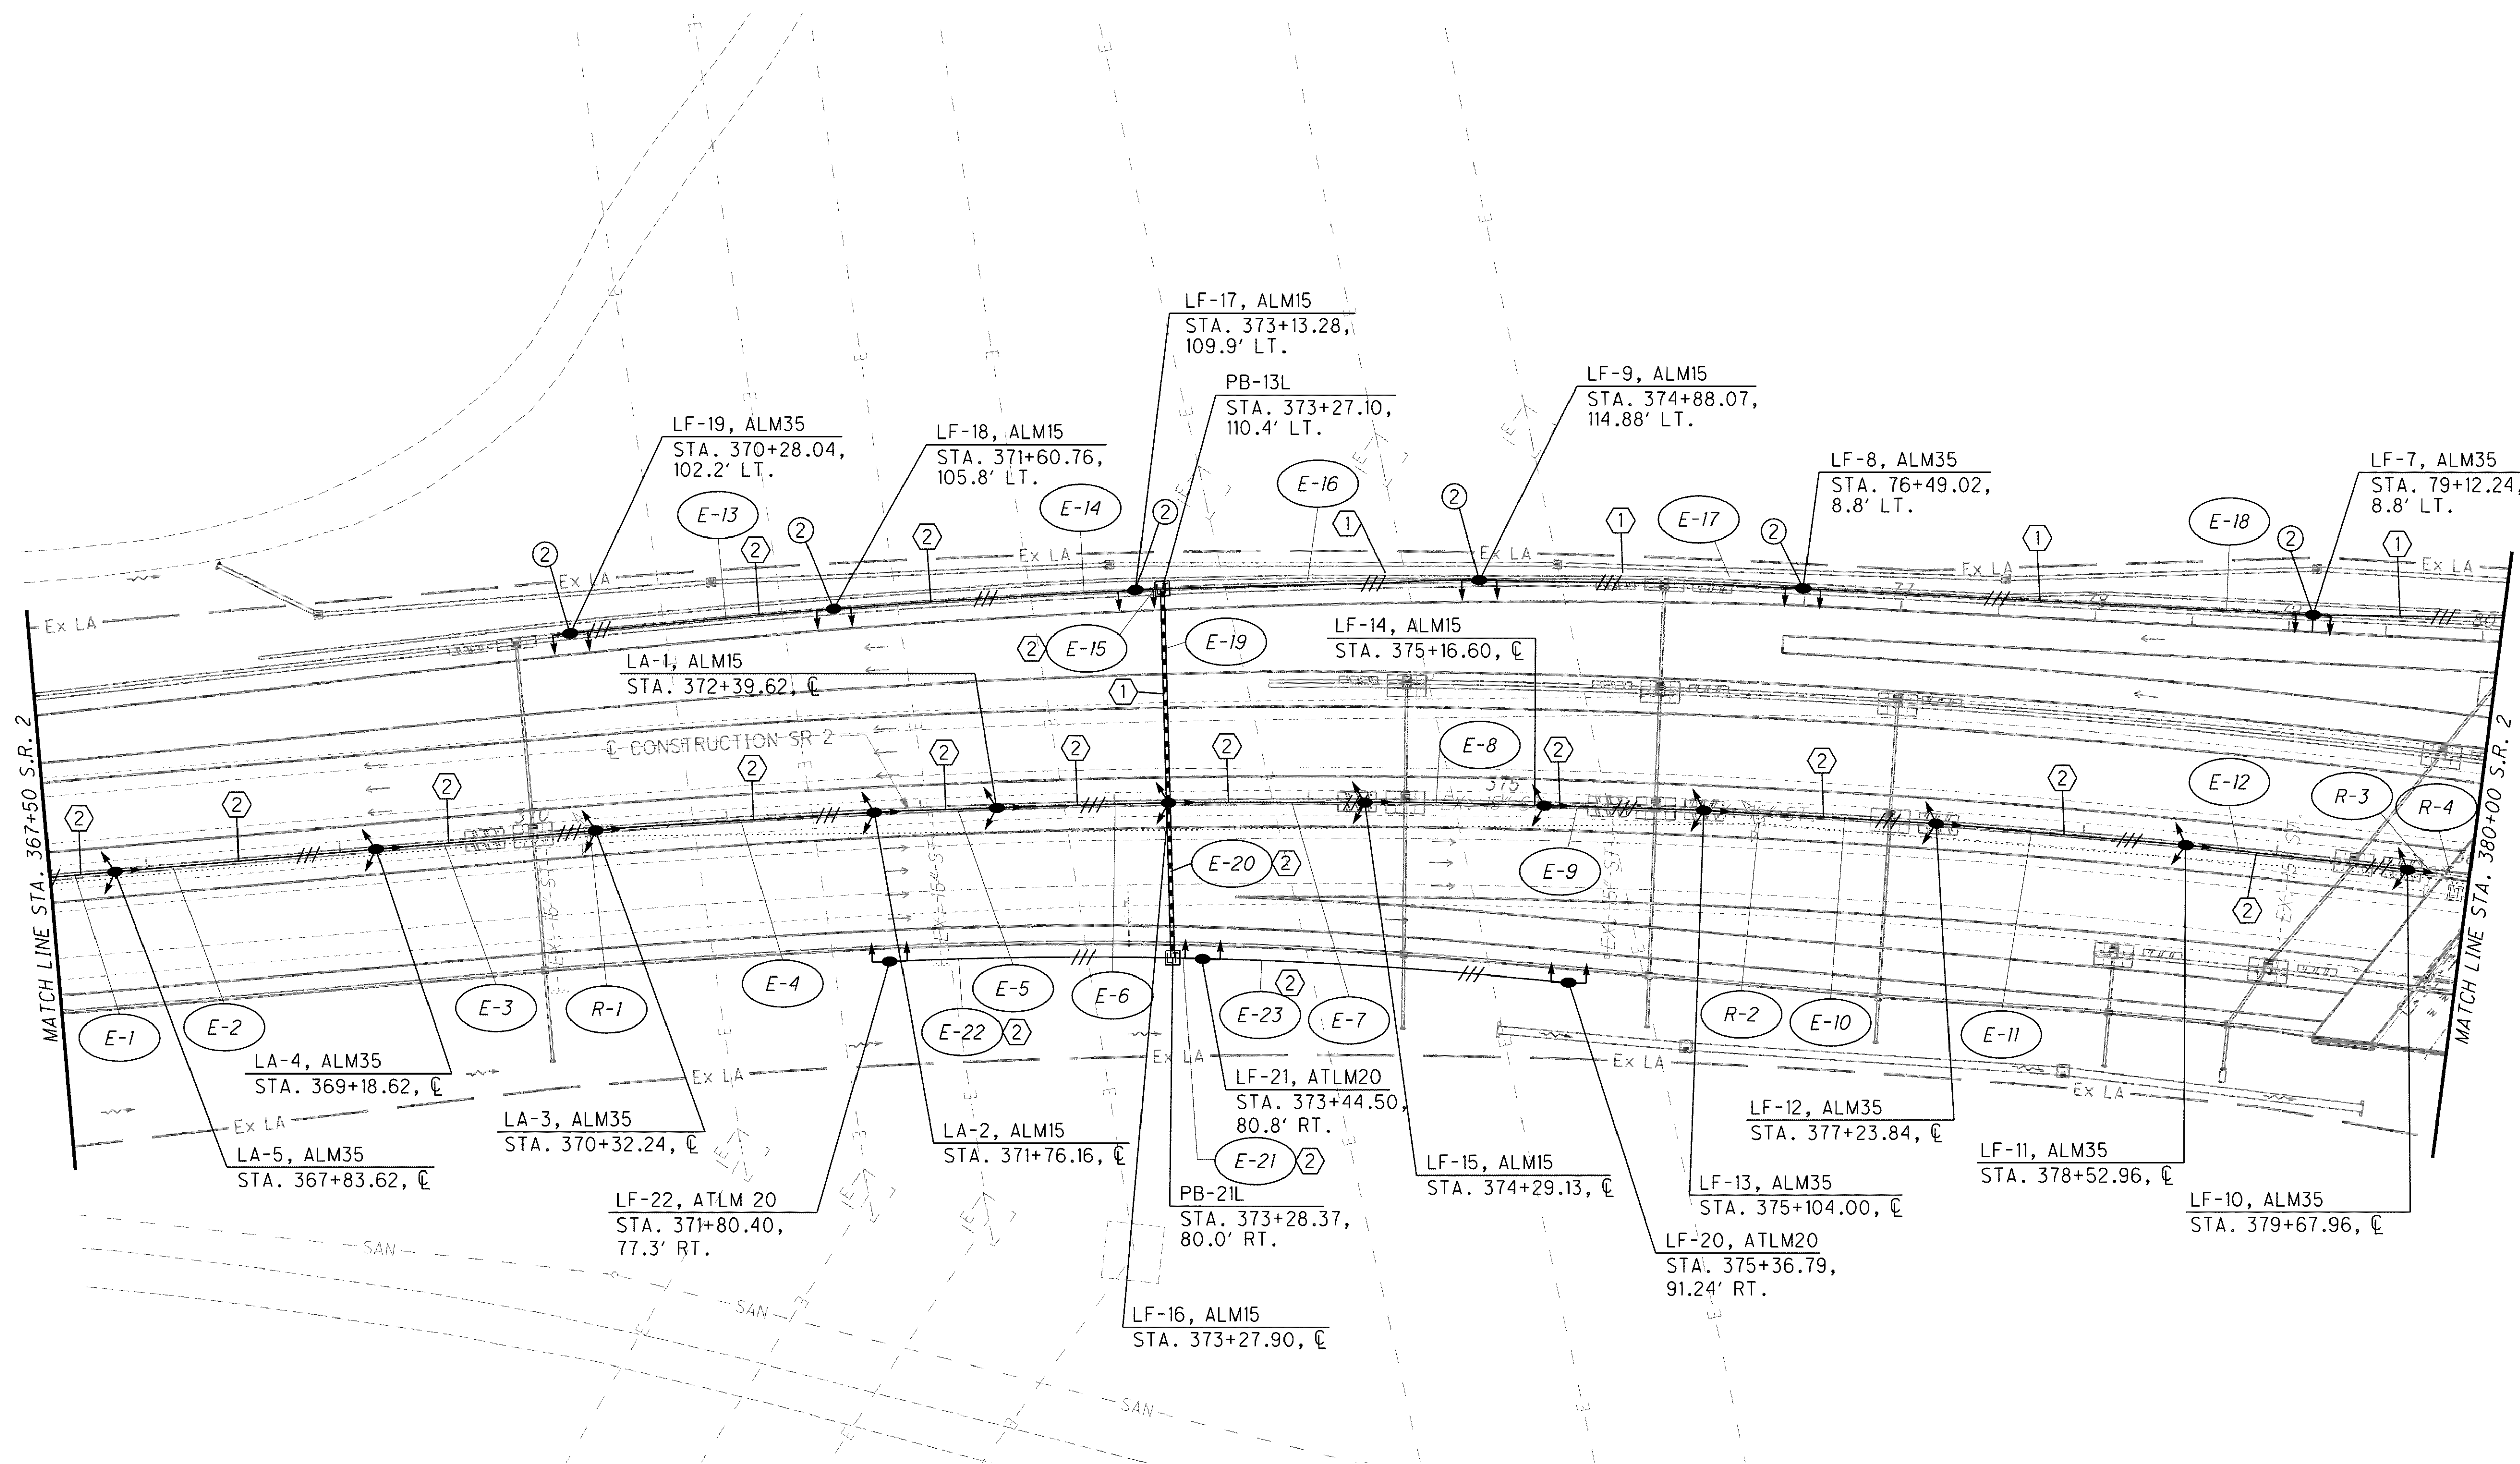

CALCULATED
JMS
CHECKED
ZFB

0 50 100
25
HORIZONTAL
SCALE IN FEET

LIGHTING PLAN
STA. 367+50 TO STA. 380+00

LAK-2-3.32

1248
1679

NOTES:

- 1.) SEE SHEET 1240 FOR GENERAL NOTES AND WIRING NOTES.
- ② LIGHT POLE MOUNTED ON CONCRETE BARRIER. SEE TYPICAL SECTIONS ON SHEET 17 .
- 3.) COORDINATE WITH FIRST ENERGY PRIOR TO INSTALLATION OF LIGHT POLES WITHIN TRANSMISSION LINE CROSSING RIGHT-OF-WAY. MAINTAIN REQUIRED OSHA AND NESC CLEARANCE FROM TRANSMISSION LINES DURING INSTALLATION.