

# TYPE-404

## TYPICAL SECTION RICHMOND STREET (S.R. 283)


## LIBERTY STREET

LAKE COUNTY

LAK- 283-16.85

SCALE: 1" = 1'-0"

SYMMETRICAL ABOUT CENTERLINE

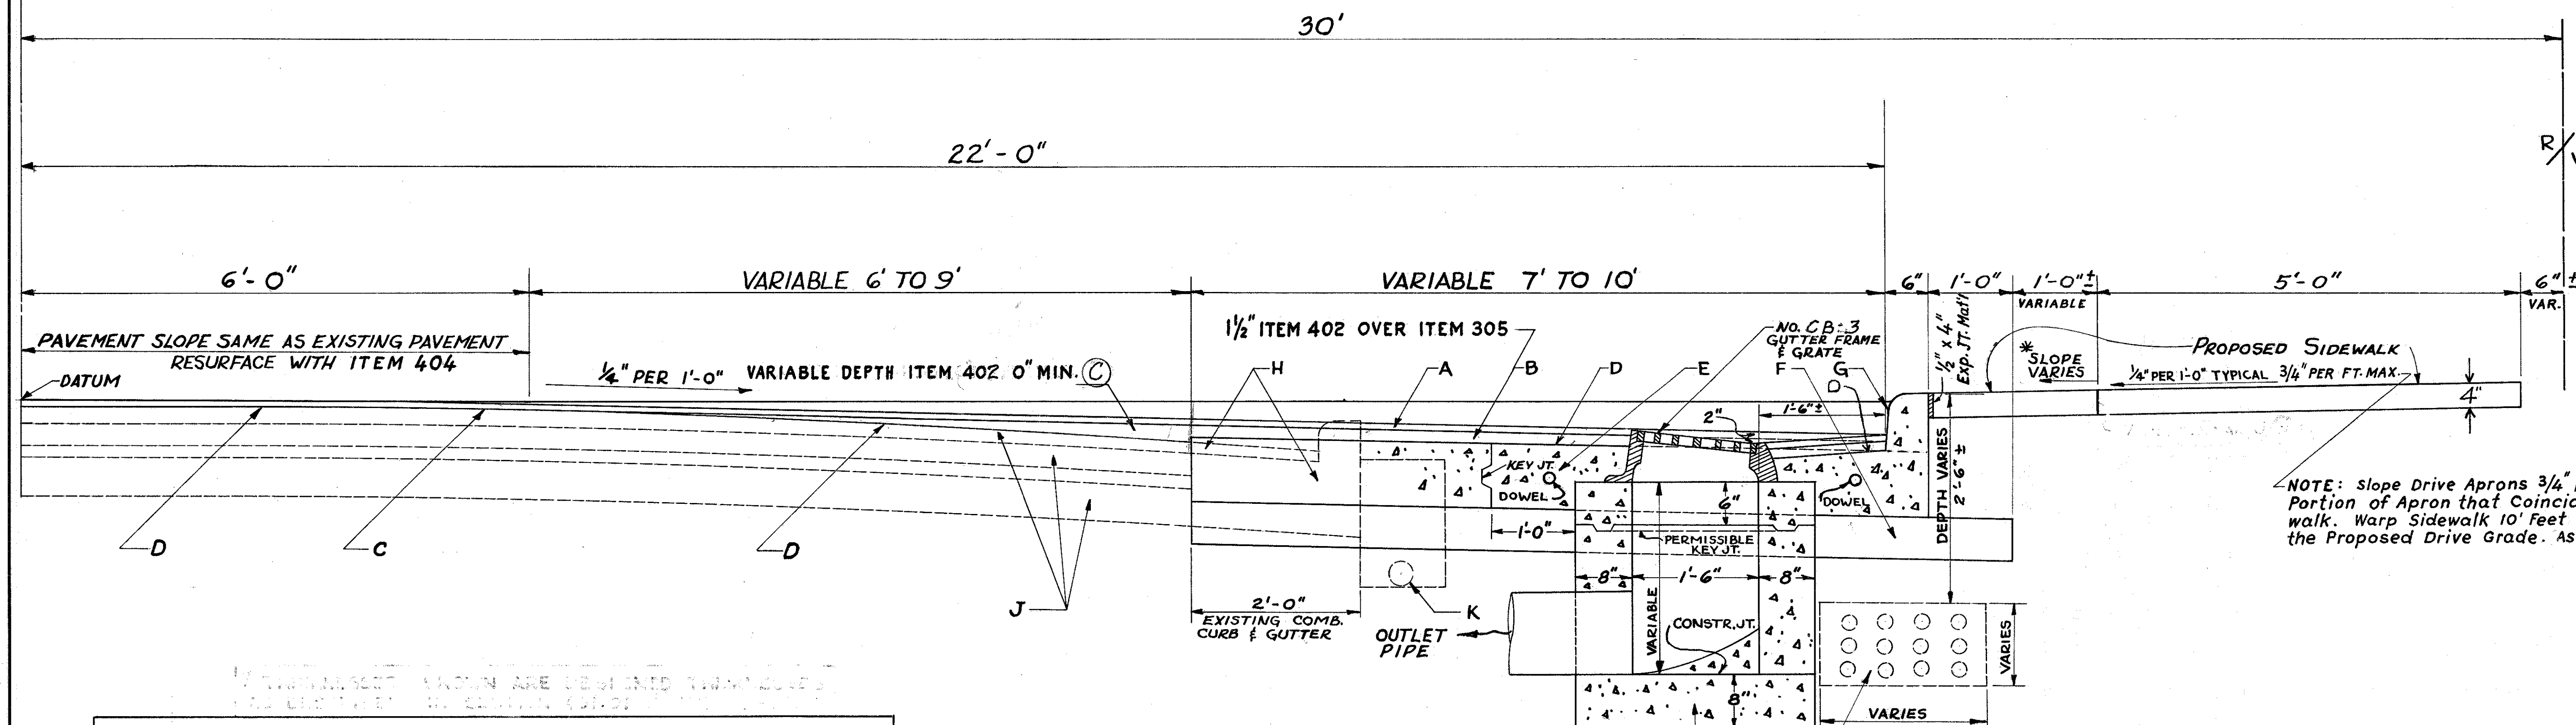

NOTE: Slope Drive Aprons 3/4" per 1'-0" Maximum for 5 Foot Portion of Apron that Coincides with Adjacent Sidewalk. Warp Sidewalk 10' feet each Side of Apron to Meet the Proposed Drive Grade. As Directed by the Engineer.

### LEGEND

- (A) ITEM 404 1" ASPHALT CONCRETE (70-85)
- (B) ITEM 402 1 1/2" ASPHALT CONCRETE (70-85)
- (C) ITEM 402 0" MINIMUM ASPHALT CONCRETE PRE-LEVELING COURSE USING 404 COMPOSITION (70-85)
- (D) ITEM 407 TACK COAT 702.04 MS-2 or RS-1 or 702.02 RC-70 or RC-250 applied at the rate of 0.10 gal. per sq. yd.
- (E) ITEM 305 9" PORTLAND CEMENT CONCRETE BASE COURSE
- (F) ITEM 310 6" SUBBASE GRADING "C" OR "D"
- (G) ITEM 609 CONCRETE CURB, STANDARD TYPE 2-B
- (H) ITEM 202 REMOVAL & DISPOSAL OF EXISTING CURB AND GUTTER & WEARING COURSE
- (J) EXISTING CONCRETE AND BRICK BASE & ASPHALT SURFACE PAVEMENT
- (K) EXISTING 4" UNDERDRAIN

PROPOSED TREATMENT OF STD. No. CB-3 CATCH BASINS AROUND ELECTRIC DUCT (CURB CASTINGS NOT REQUIRED FOR MODIFIED STD. #CB-3)

Use Std. No. CB-3 Modified as Above, Wherever Existing Utilities & Pipe Lines, as Discovered During Construction, Would Interfere With the Placing of the Std. No. CB-3 (The Standard No. CB-3 C.B. Shall be Used When Feasible)

Payment for Any Additional Excavation in Determining the Type of Catch Basin to be Used, Shall be Included in the Unit Price Bid for That Basin.

\*NOTE: CROSS SECTIONS SHALL GOVERN OVER TYPICAL SECTIONS WHERE VARIABLE CONDITIONS ARE ENCOUNTERED IN SLOPES