


- ① 3 ELECTRODE GAS TUBE-TII340A-20 OR SURRESTOR SRA-16 OR EQUIVALENT (FOR LOOP AMP NOT EXCEEDING 20V ON LOOP CIRCUIT)
 - ② 3 ELECTRODE GAS TUBE-TII 3178 OR SURRESTOR SPA-60A OR EQUIVALENT
 - ③ POWER LINE ARRESTOR (3 ELECTRODE) TII 412A-(20) OR SURRESTOR SPA 300
 - ④ 3 ELECTRODE GAS TUBE-TII317A OR SURRESTOR SRA-16,63,64 OR EQUIVALENT
- NOTE: ALL UNUSED CONDUCTORS MUST BE GROUNDED AT BOTH ENDS AND ALL ARRESTORS SHOULD BE MOUNTED AS CLOSE AS POSSIBLE TO THE FIRST TERMINATION OF INCOMING PROTECTED LINE.

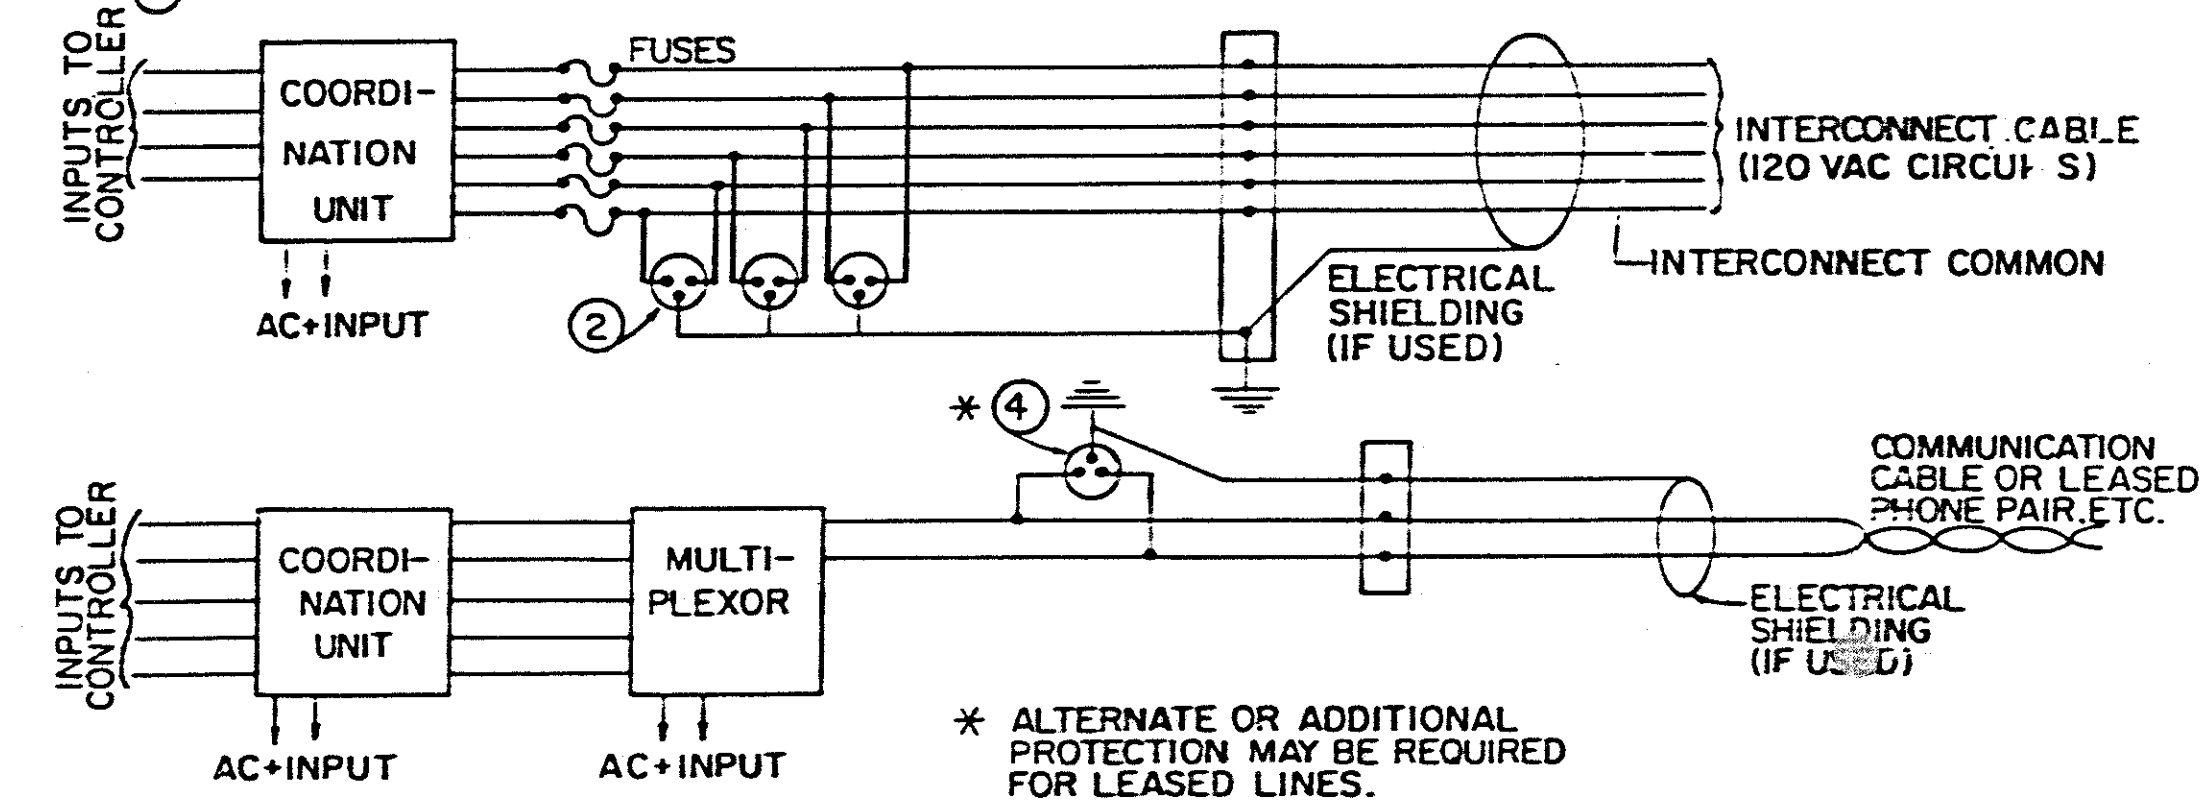

LIGHTNING PROTECTION SYSTEM