


**TYPE 1 DRIVEWAY**

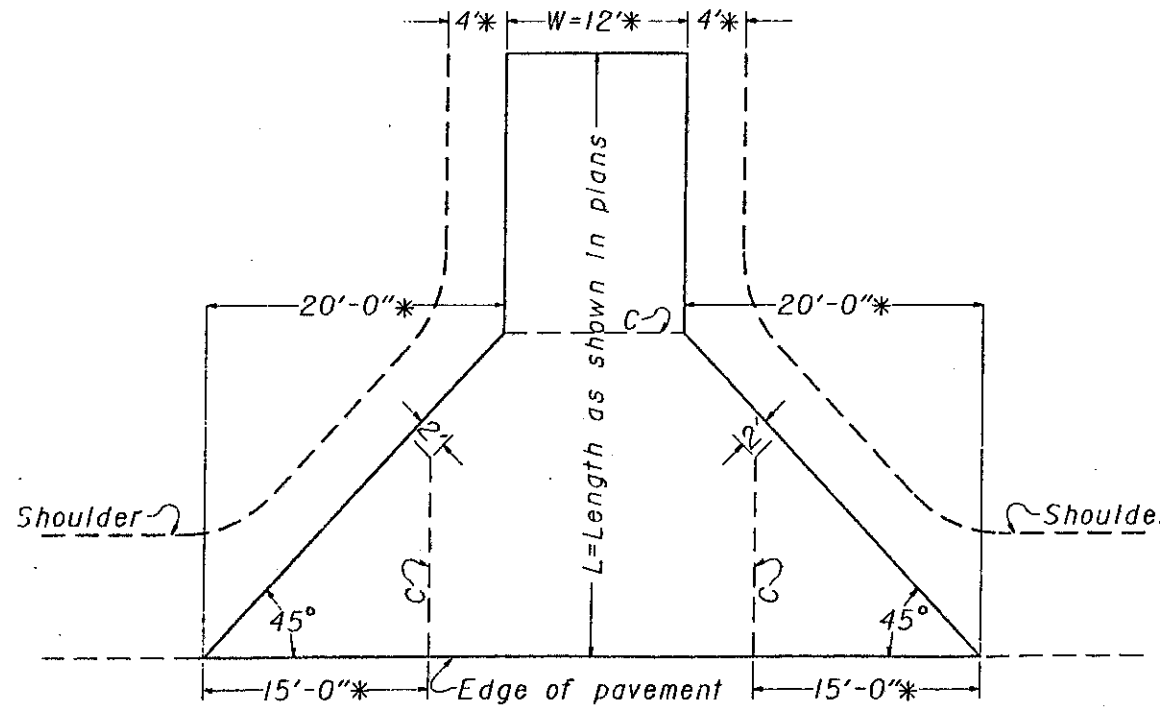

**TYPE 2 DRIVEWAY**

**NOTES**


**GENERAL:** The design details shown hereon shall govern the construction of driveways unless otherwise shown in the project plans.

The pavement type and thickness shall be specified in the project plans.

Driveway and mail box approaches shall be combined when feasible.

**JOINTS:** Impressed joints for portland cement concrete driveways shall be 1/4" minimum width by 3" ± depth and shall be sealed with 705.04 or ASTM D 1850.

In addition to the joints shown hereon, impressed joints without tie bars shall be placed in portland cement concrete driveways at intervals not to exceed seventeen feet in the portion of the driveway back of the flare.

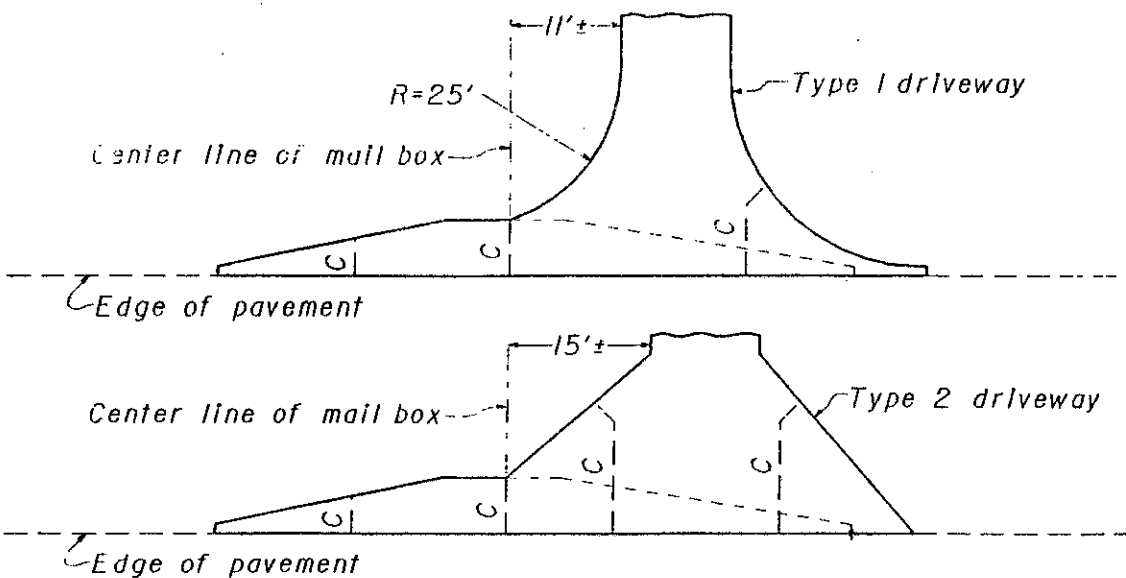


**COMBINED DRIVEWAY & MAIL BOX APPROACH**

A	A	B
80 to 90	20'	20'
75 to 85	25'	16'
65 to 75	28'	13'
55 to 65	33'	12'


C=Impressed joint without tie bars for portland cement concrete.

\* Unless otherwise shown in the plans.

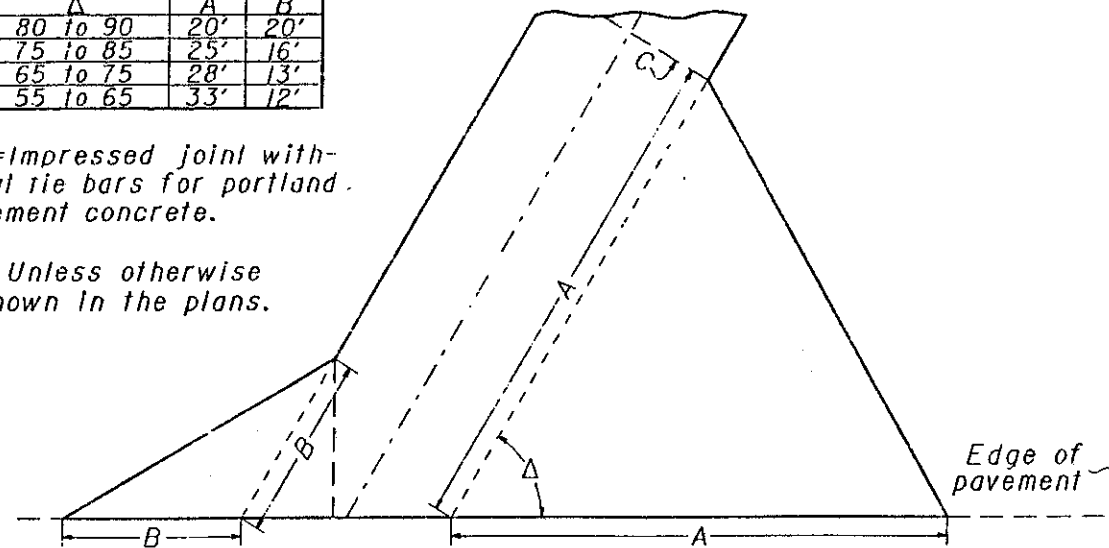


**TYPE 2 SKEWED DRIVEWAY**

Transition from standard curb section to drop curb section to be made in 18" distance from driveway.

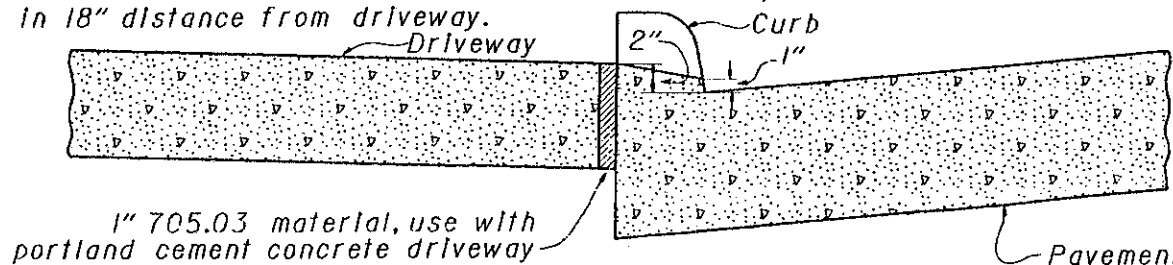

1" 705.03 material, use with portland cement concrete driveway

**DROP CURB DETAILS AT DRIVEWAYS**

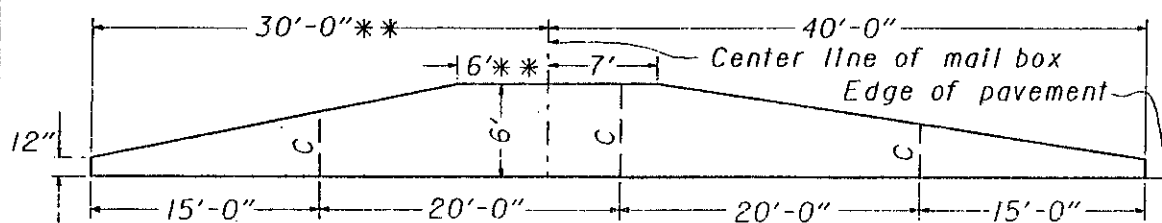

\*\* Add 3 feet for each additional mail box

**TYPICAL MAIL BOX APPROACH**

BUREAU OF LOCATION AND DESIGN  
OHIO DEPARTMENT OF TRANSPORTATION

DATE  
2-21-92

**DRIVEWAYS**

STANDARD  
CONSTRUCTION  
DRAWING

**BP-4.1**

APPROVED *D.K. Hulman* ENGR., L & D