NOTES: REINFORCING STEEL SHALL CONFORM TO ITEM 709.01, ASTM A615M, GRADE 420, fy=420MPa

CONCRETE SHALL BE CLASS "C", fc'=27.5MPa

BENDING DIAGRAMS



TYPE 1



TYPE 2



KEY DETAIL



TYPE 14

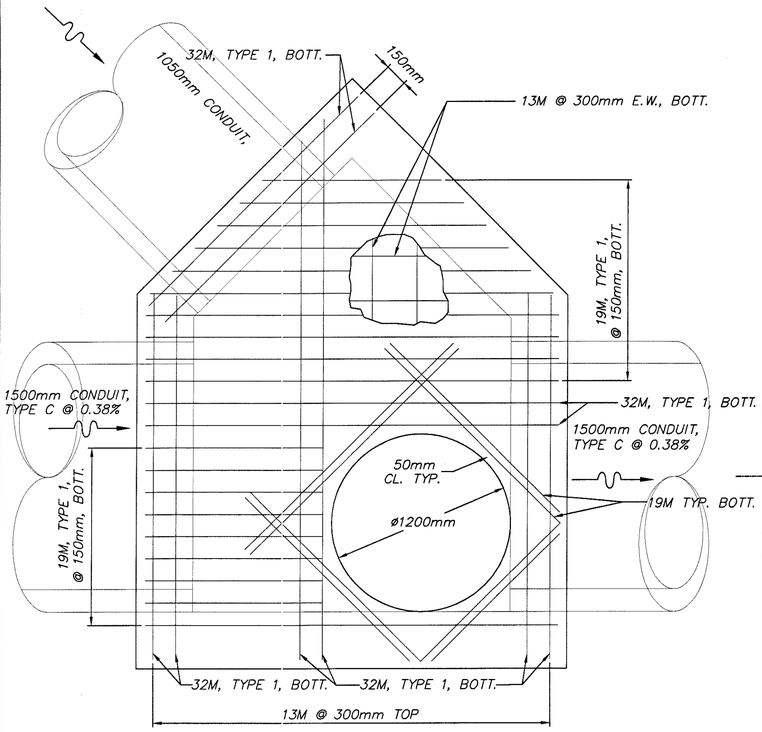

TOP SLAB DETAIL

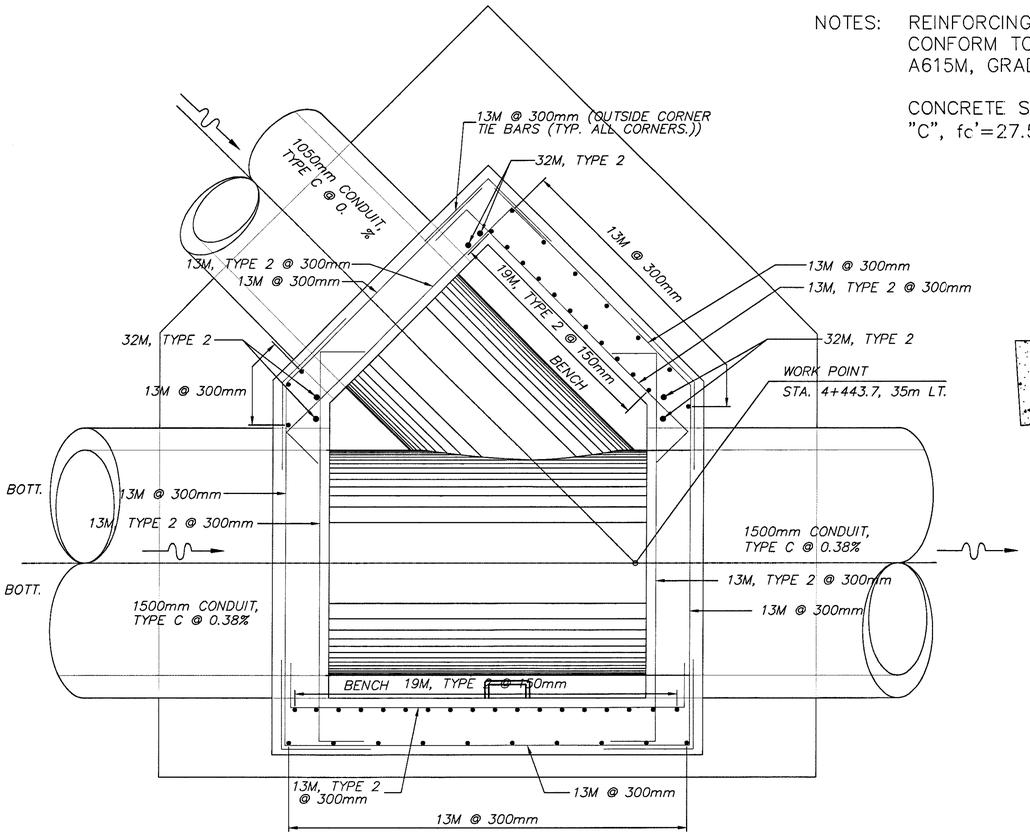

SECTION B–B

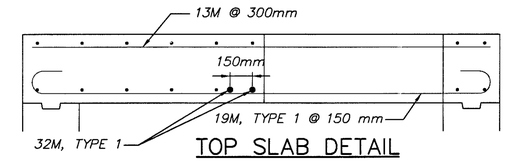

TOP SLAB DETAIL

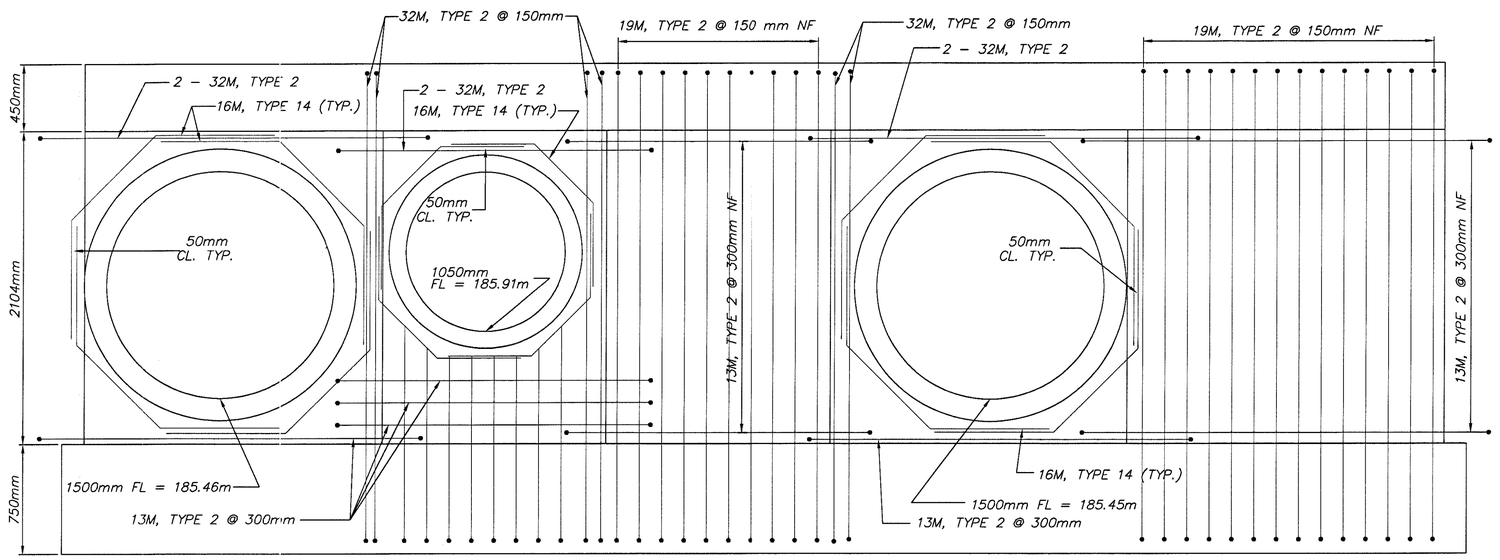

INTERIOR WALL ELEVATION

NOTE: INSIDE WALL REINFORCING STEEL ONLY (SHOWN)

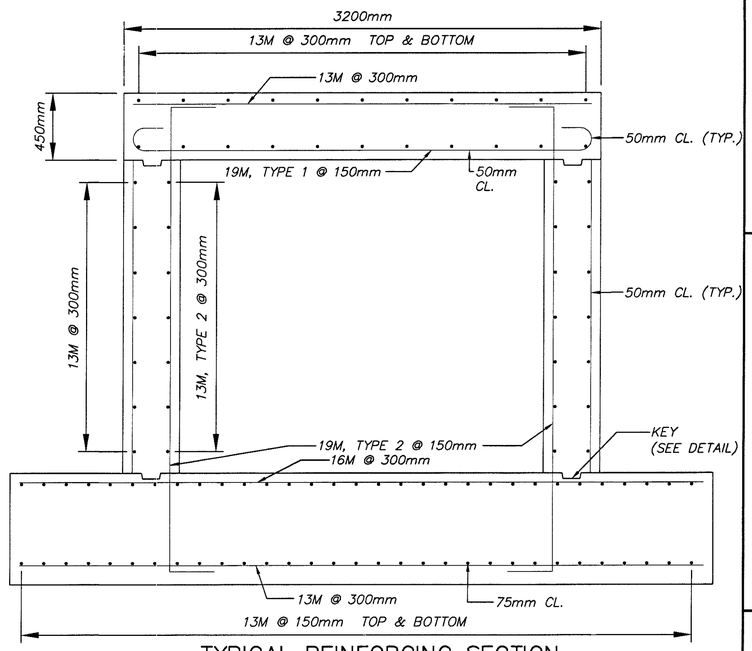

TYPICAL REINFORCING SECTION

AS SHOWN
HORIZONTAL
SCALE IN METERS

CALC. BY:
CHECKED BY:

DRAINAGE DETAILS
JUNCTION CHAMBER

LAK-640-3.444

185A
214

94014-PG-185A-DD2\11-24-00

94-014