



**SERVICE STOP BOX
ADJUSTED TO GRADE**
N.T.S.

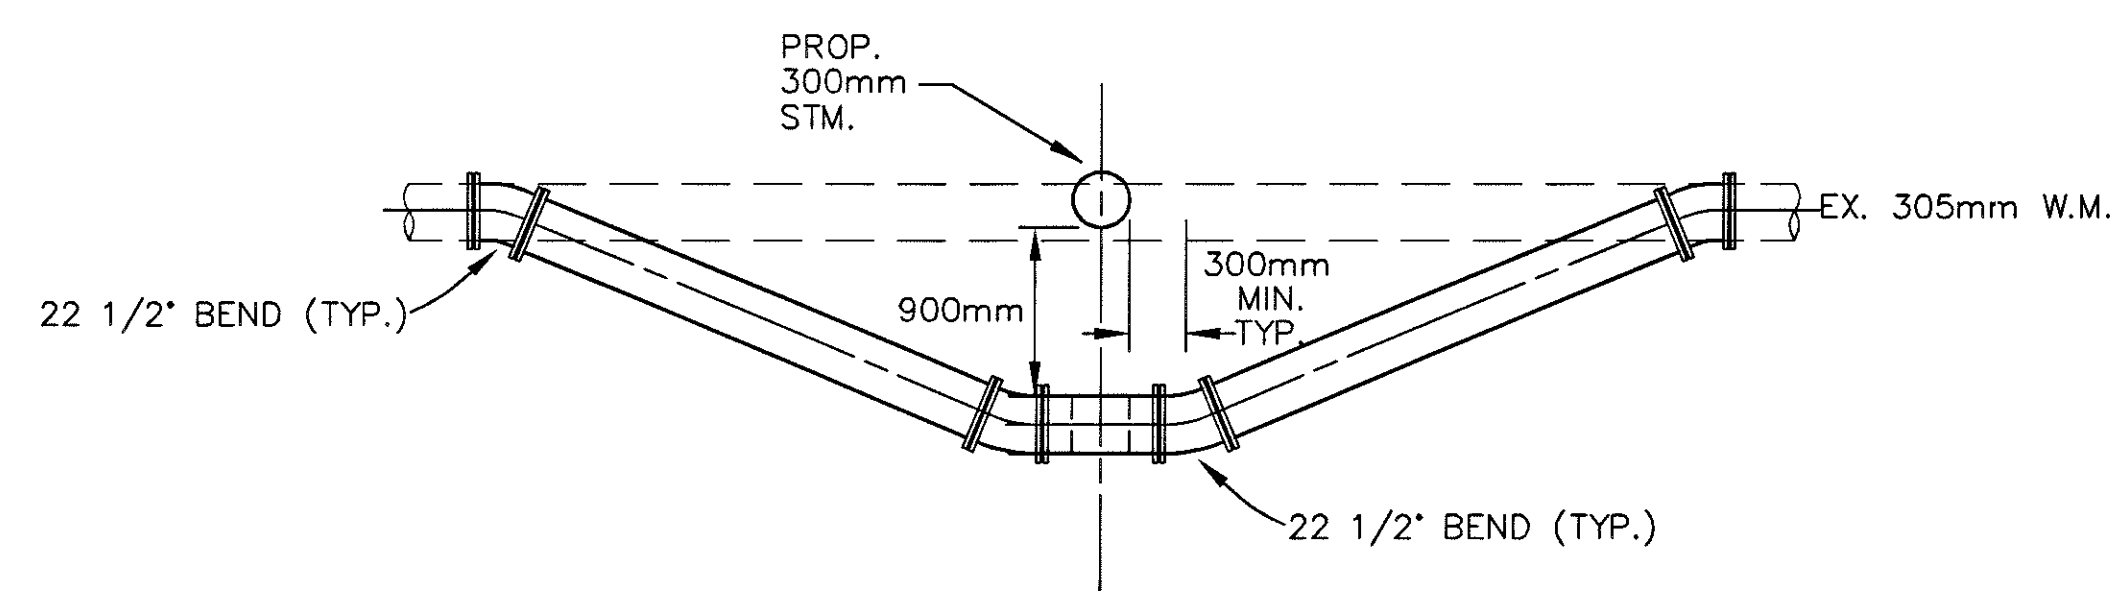


**WATER MAIN LOWERING
DETAIL**
N.T.S.

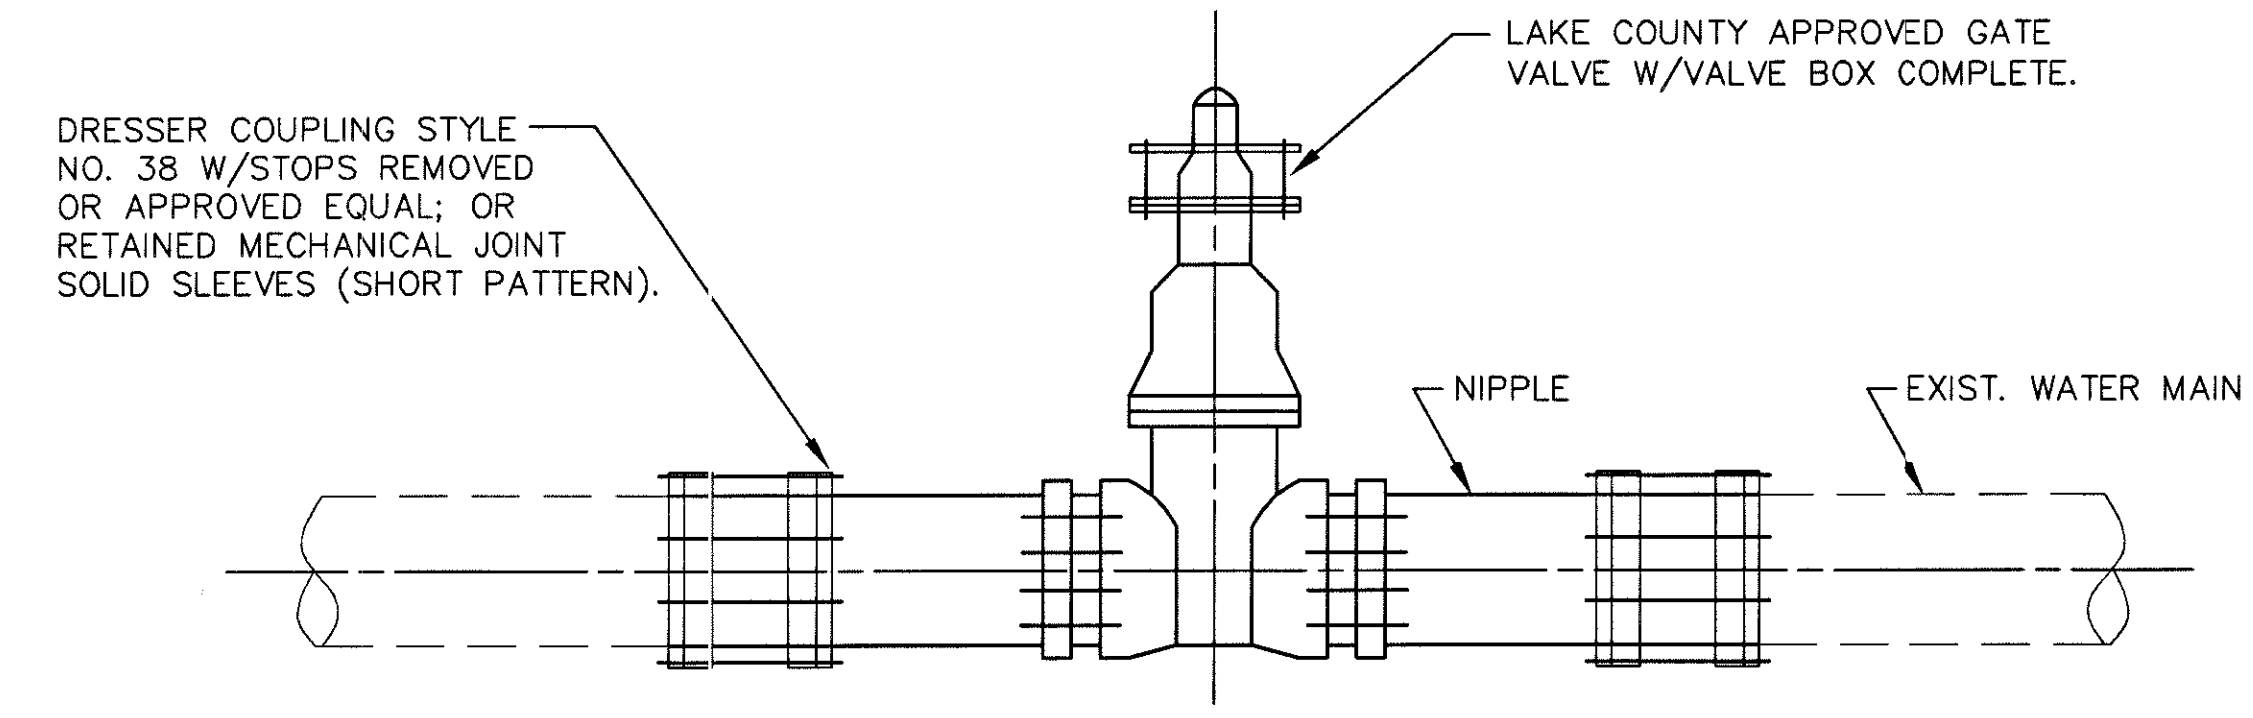

NOTE: BEFORE CUTTING EXISTING WATER MAIN, THE NIPPLES SHALL BE CONNECTED TO THE MECHANICAL JOINT BELL END GATE VALVE. AFTER CUTTING PIPE, FINAL CONNECTIONS SHALL BE MADE WITH COUPLINGS/SOLID SLEEVES AS SPECIFIED.

CUTTING-IN-VALVE DETAIL
N.T.S.

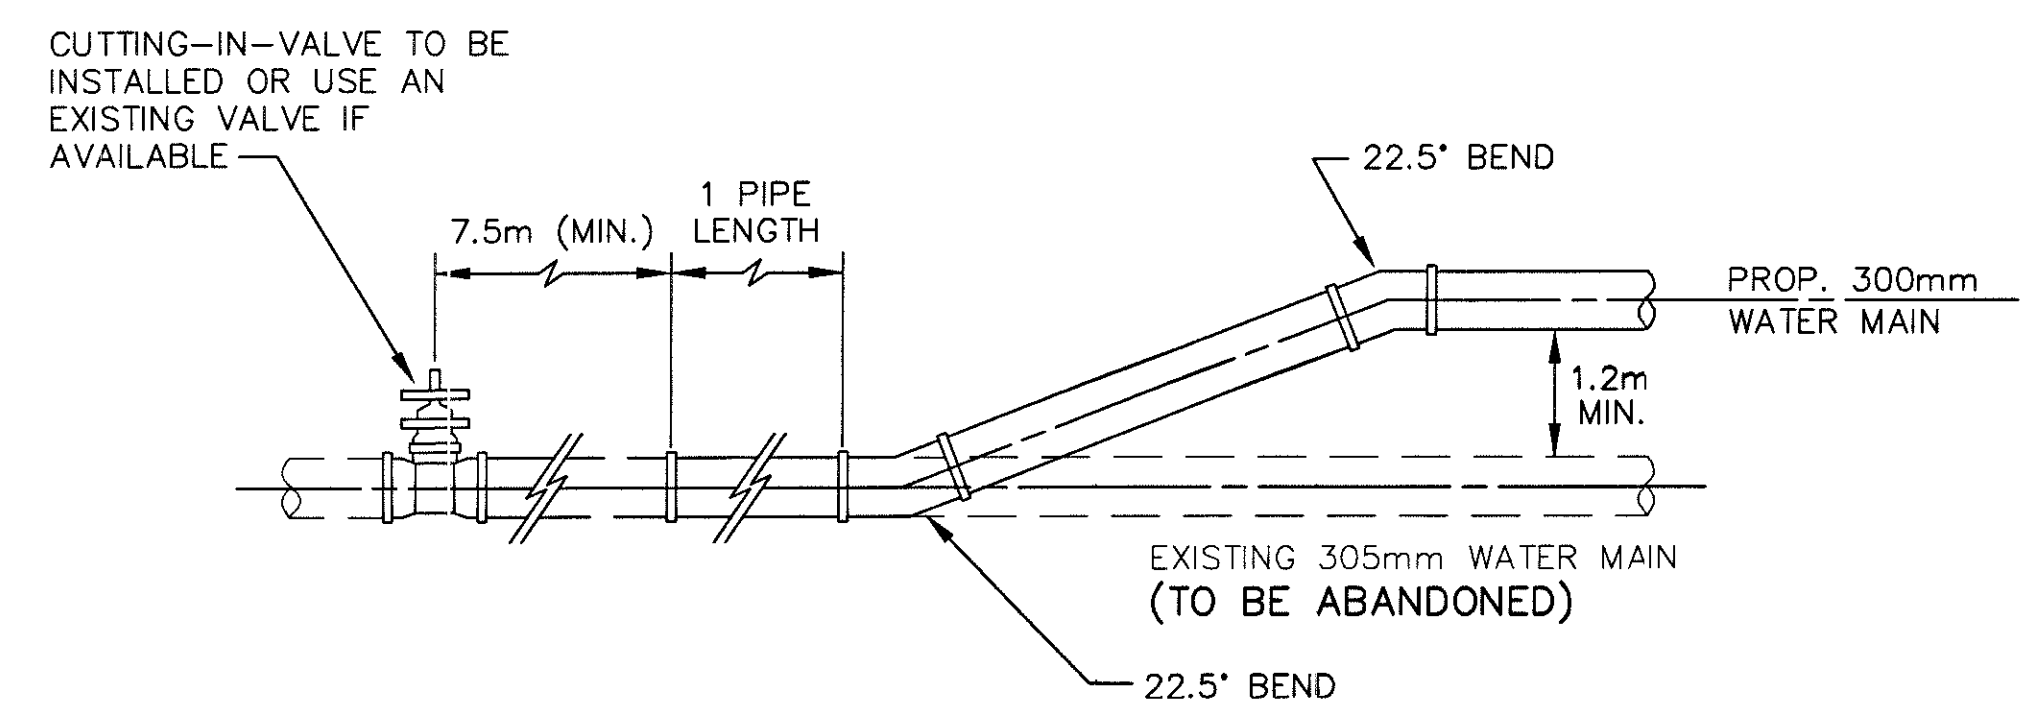

**WATER MAIN TIE-IN
(TYPICAL)**
N.T.S.

CALC. BY:
CHECKED BY:

MISCELLANEOUS DETAILS
(WATERWORK)

LAK-640-3.444

190
214