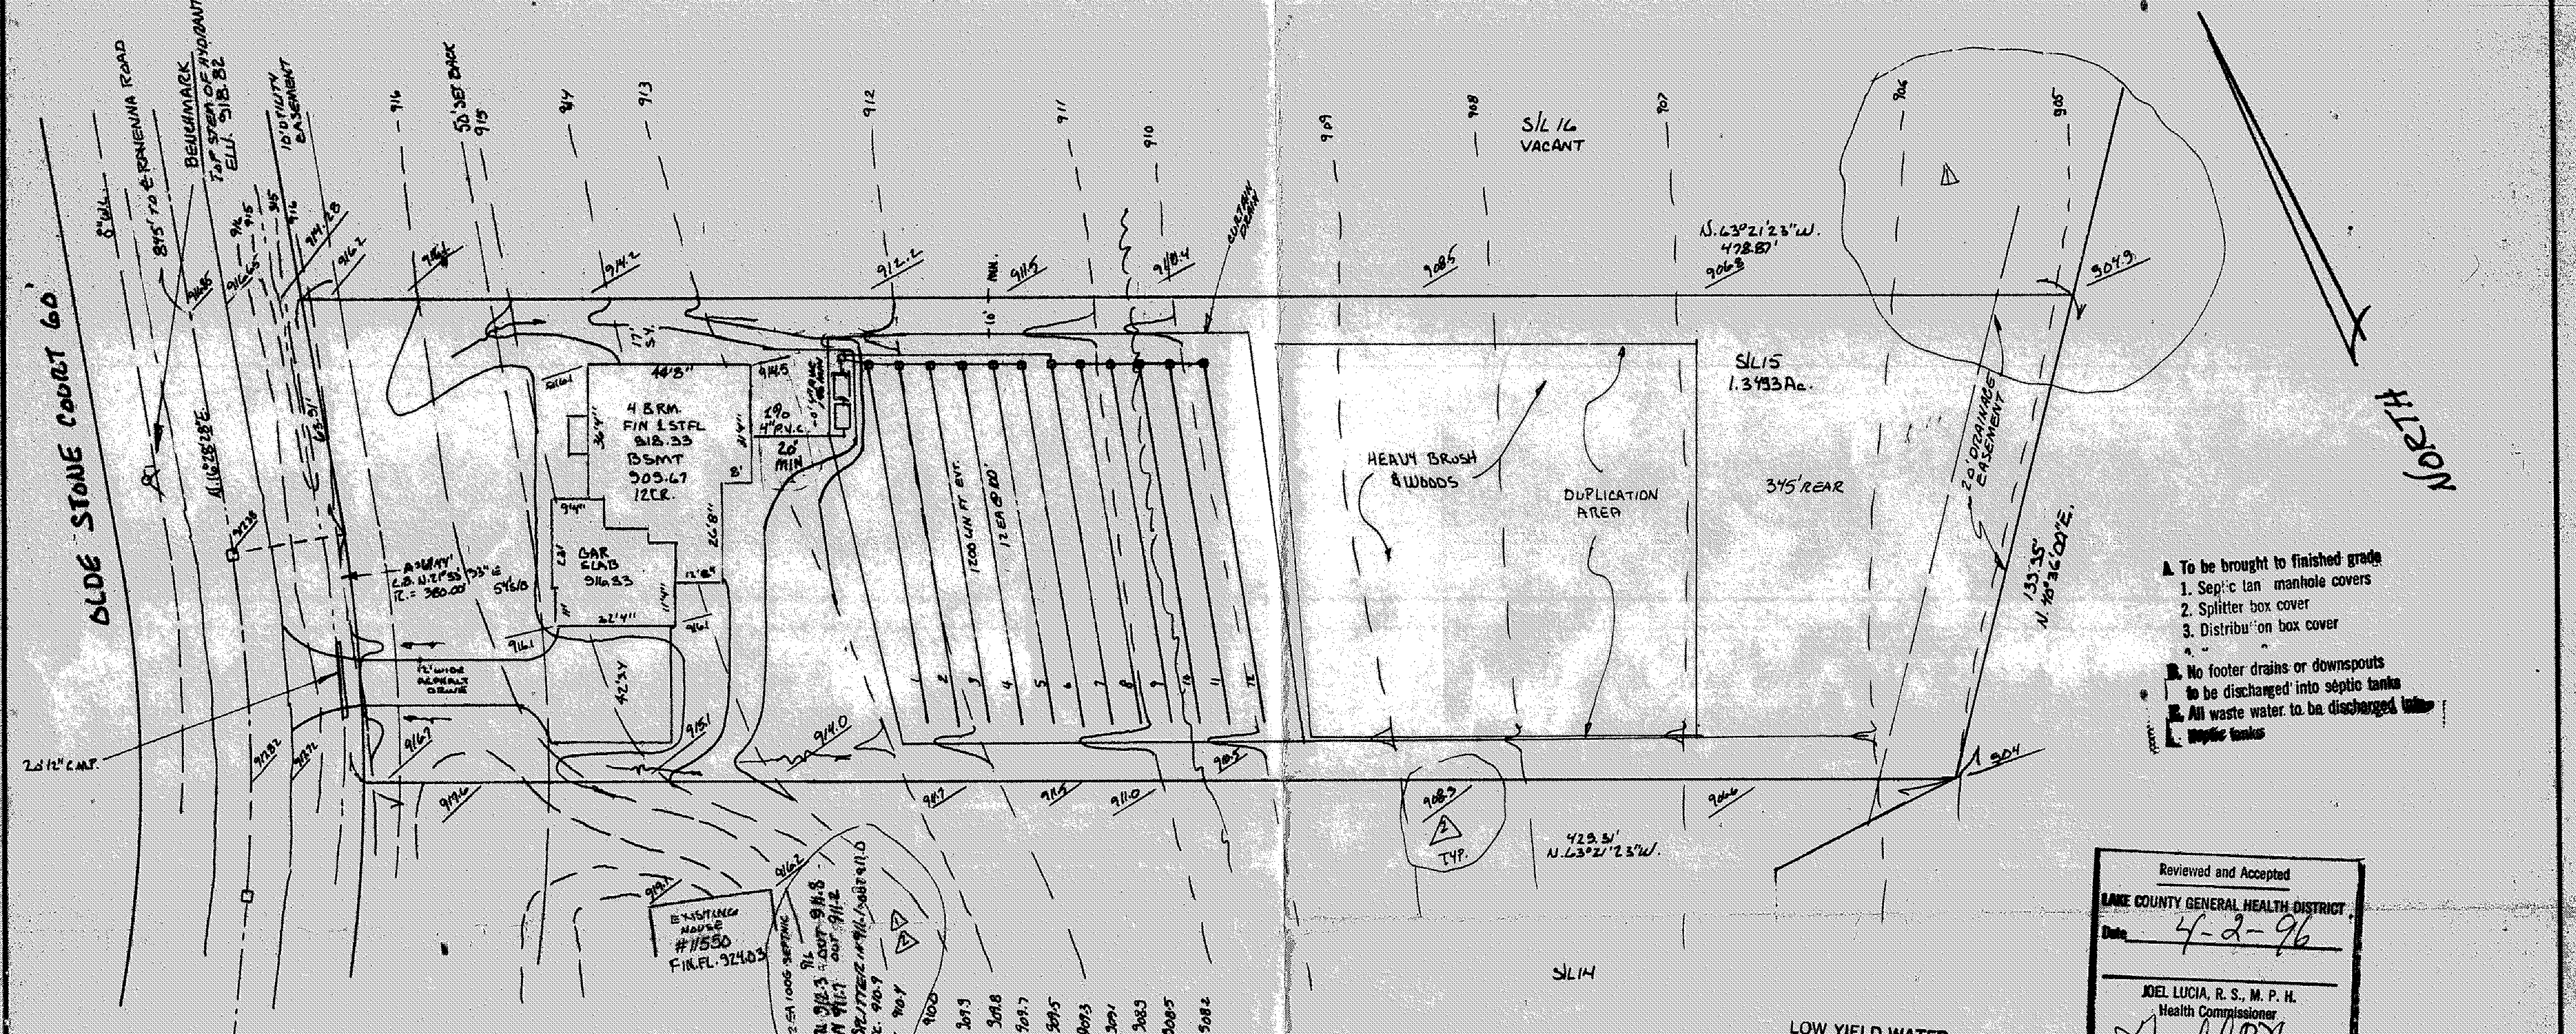

A To be brought to finished grade
1. Septic tank manhole covers
2. Splitter box cover
3. Distribution box cover

B. No footer drains or downspouts to be discharged into septic tanks

C. All waste water to be discharged into septic tanks

Reviewed and Accepted
LAKE COUNTY GENERAL HEALTH DISTRICT
Date 4-2-96
JOEL LUCIA, R. S., M. P. H.
Health Commissioner
By [signature]

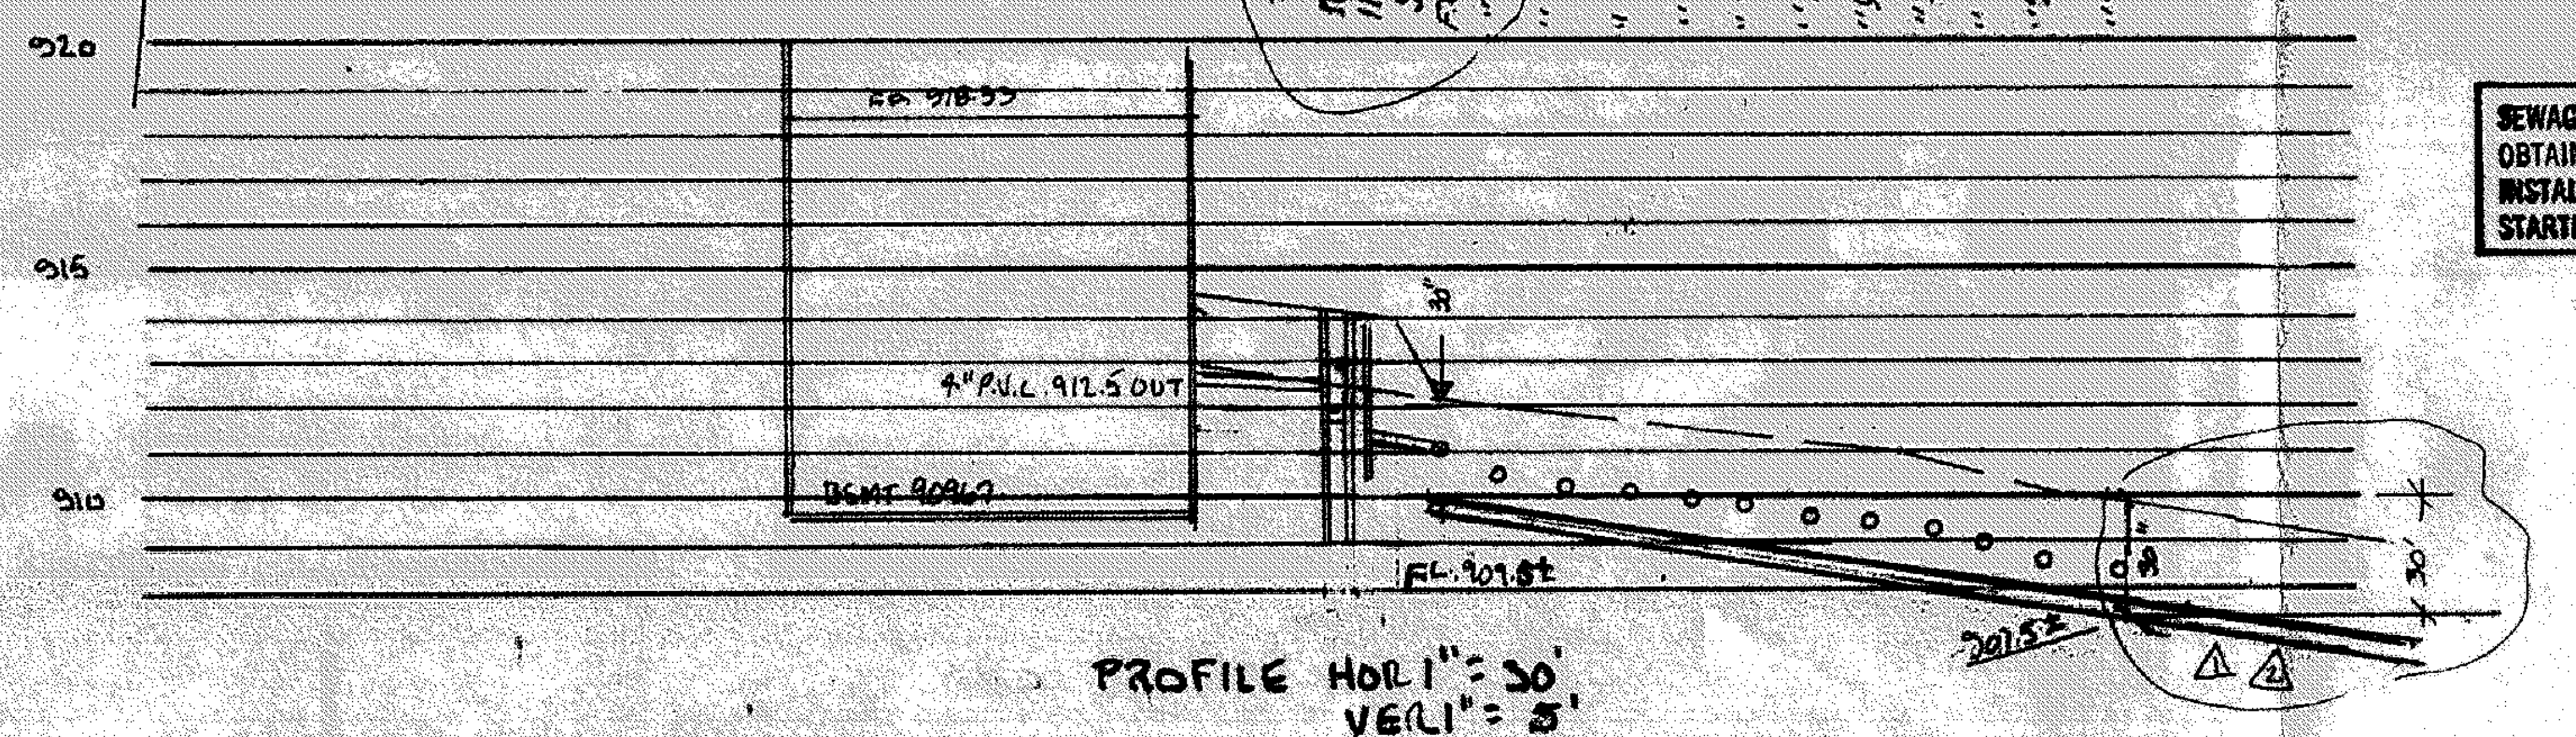

LOW YIELD WATER FIXTURES REQUIRED ON ALL:
— Shower Head
— Toilet

SEWAGE DISPOSAL PERMIT MUST BE OBTAINED BY A LAKE COUNTY LICENSED INSTALLER BEFORE INSTALLATION IS STARTED.

Grading Plan Approved as shown and/or noted
THOMAS P. GILLES, P.E.
Lake County Engineer
By GJH Date 4.4.96

2 WORKING DAYS BEFORE YOU DIG
CALL TOLL FREE 800-362-2764
OHIO UTILITIES PROTECTION SERVICE

"I, the undersigned hereby certify that this topography, indicated by 6", 1' or 2' contours, and elevations shown hereon represent an actual field survey made by me on the 19 day of MAR, 1996 and that the elevations were taken at appropriate intervals and that as of that date they existed as indicated hereon."

John C Skonieczny — Name
RS6356 — Reg. No

I CERTIFY THAT THIS PLAN WAS PREPARED BY ME AND IS CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF.
John C Skonieczny
REG. SURVEYOR #6356
JOHN C. SKONIECZNY
PAINESVILLE, OHIO 44077
Ph. 352-7742

REVISIONS
1. MAR-26-96 AS PER L.D.C.
2. MAR-28-96 AS PER L.D.C.

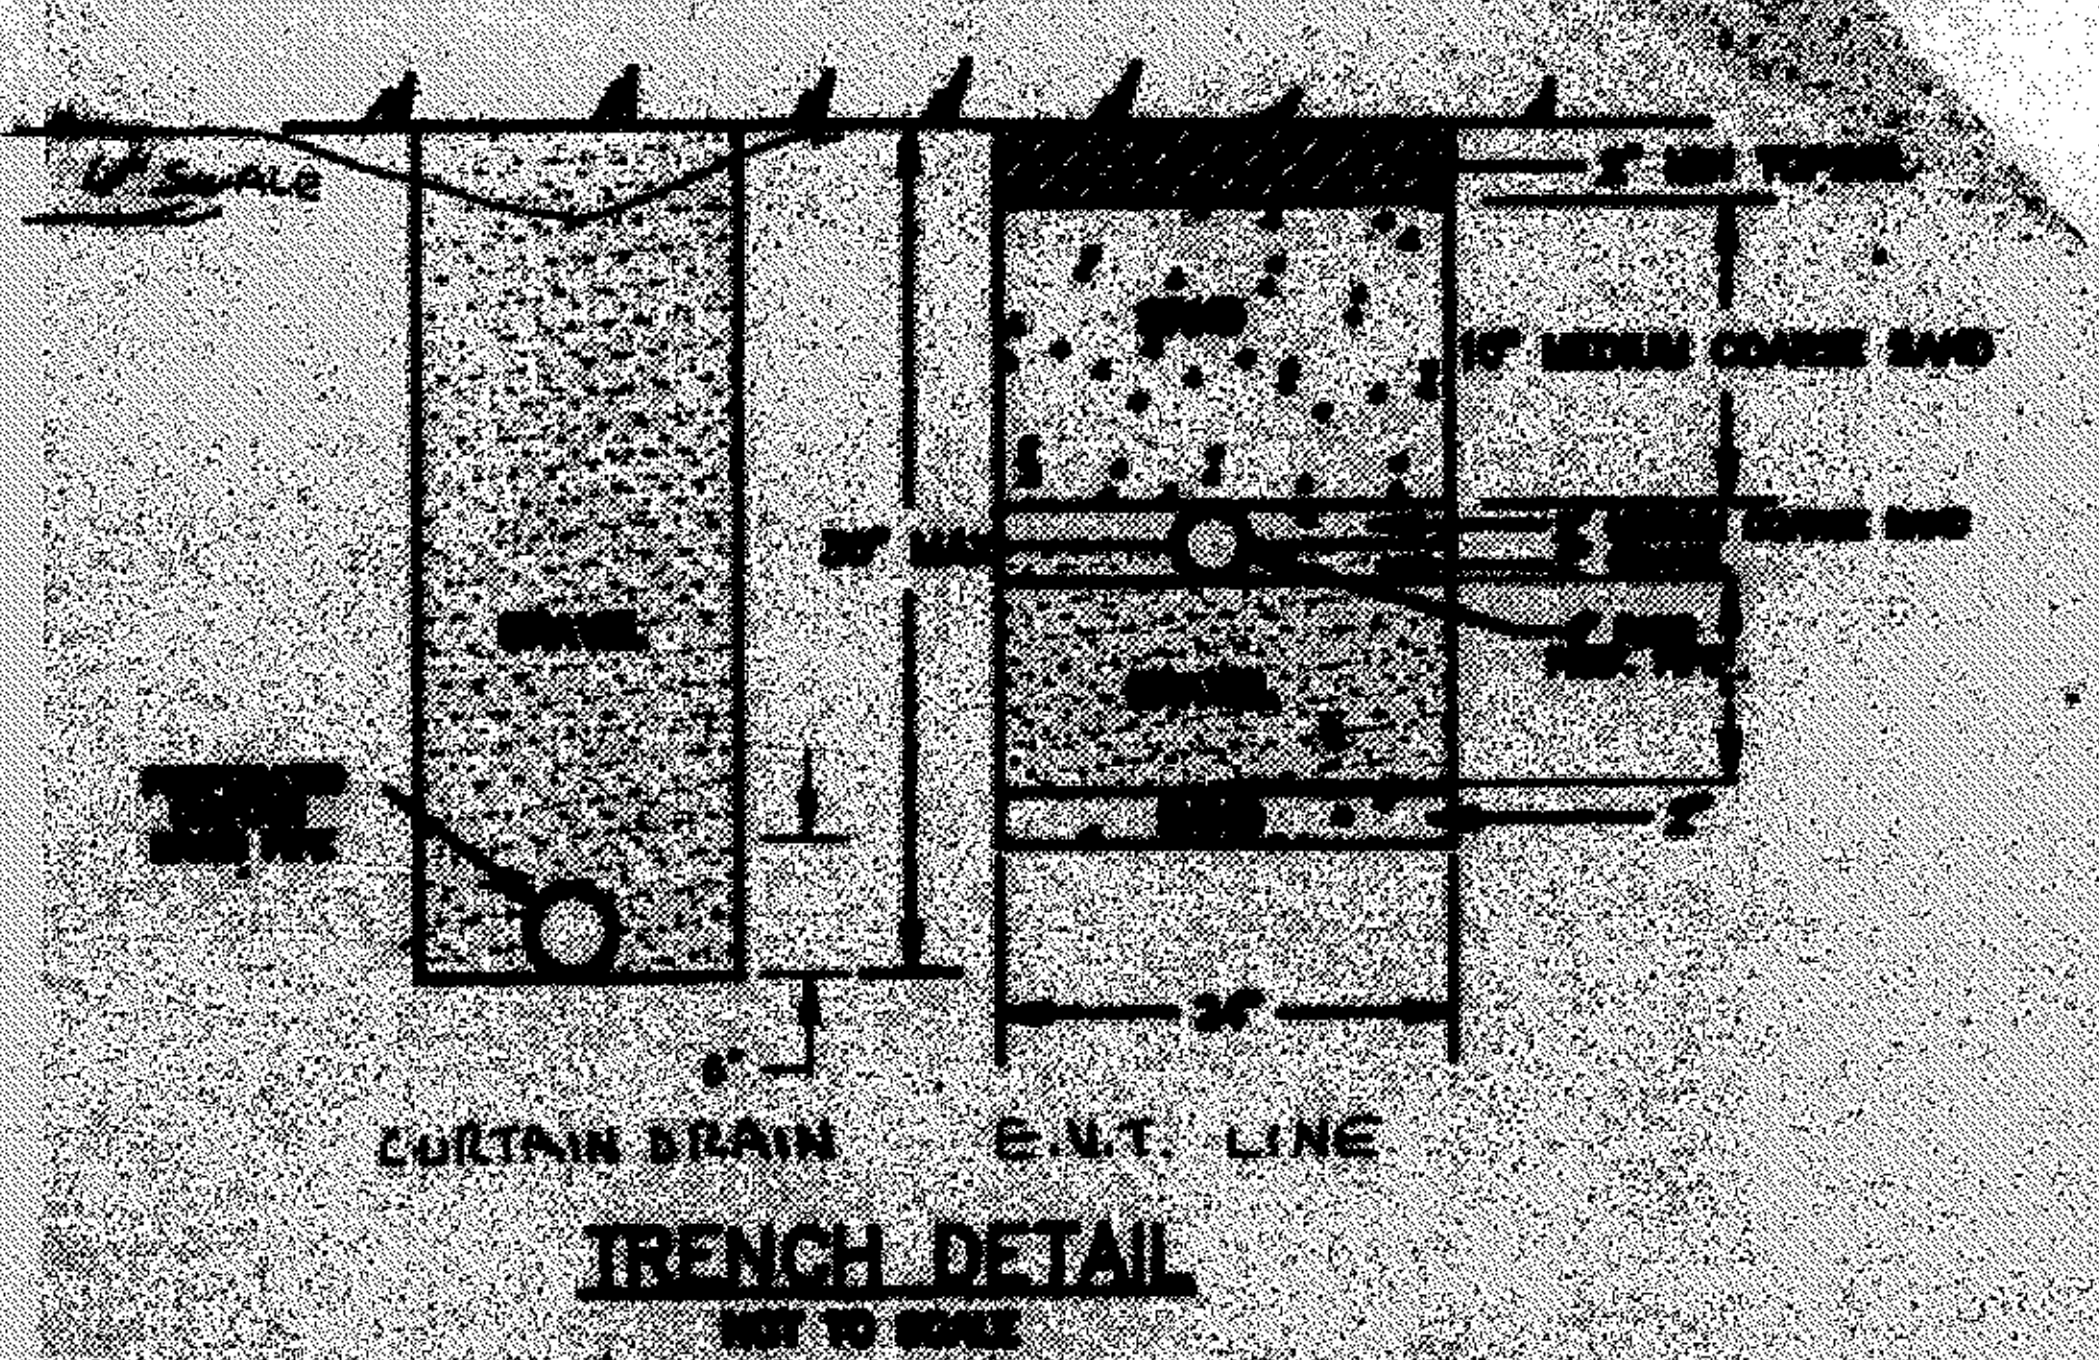

RECOMMENDED FOR APPROVAL
BY [signature]
DATE 3/29/96

ZONING PERMIT #0496-8382
ISSUED 4/2/96
SUBJECT TO APPROVAL BY:
Lake County Sanitary Eng. ☐
Lake County Eng. Dept. ☒
Lake County Planning Comm. ☐
Lake County Bldg. Dept. ☒

--- EXISTING / PROPOSED GRADES
→ SWALE

SITE PLAN FOR: C.D.T. HOMES INC.

SCALE: 1" = 30" | APPROVED BY | DRAWN BY: [initials]
DATE: MAR 96

BEING SUBLOT 15 IN THE OLDE STONE MEADOWS SUBD. AS RECORDED IN VOL 20-12-1 L.C.R.P.
TOWNSHIP OF CONCORD COUNTY OF LAKE STATE OF OHIO

JOB# 96-2188
DRAWING NUMBER 96-1426