


POWER SERVICE DATA

POWER SERVICE	SERVICE VOLTAGE	LOAD (KVA)	SERVICE ENTRANCE CONDUCTORS (AWG)	MAIN DISCONNECT RATING (AMPS)	CIRCUIT No.	CIRCUIT LOAD (AMPS)	CIRCUIT BREAKER SIZE (AMPS)	CIRCUIT CONDUCTOR SIZE (AWG)	CONDUCTORS PER CIRCUIT	MAINTAINING AGENCY	MUNICIPALITY SERVED
V	480V, 1-PHASE	28.5	1/0	100	A	28.1	40	4	2 + GROUND	LAKE COUNTY ENGINEER	CITY OF WILLOUGHBY
					B	19.8	30	4			
					C	11.5	20	2			

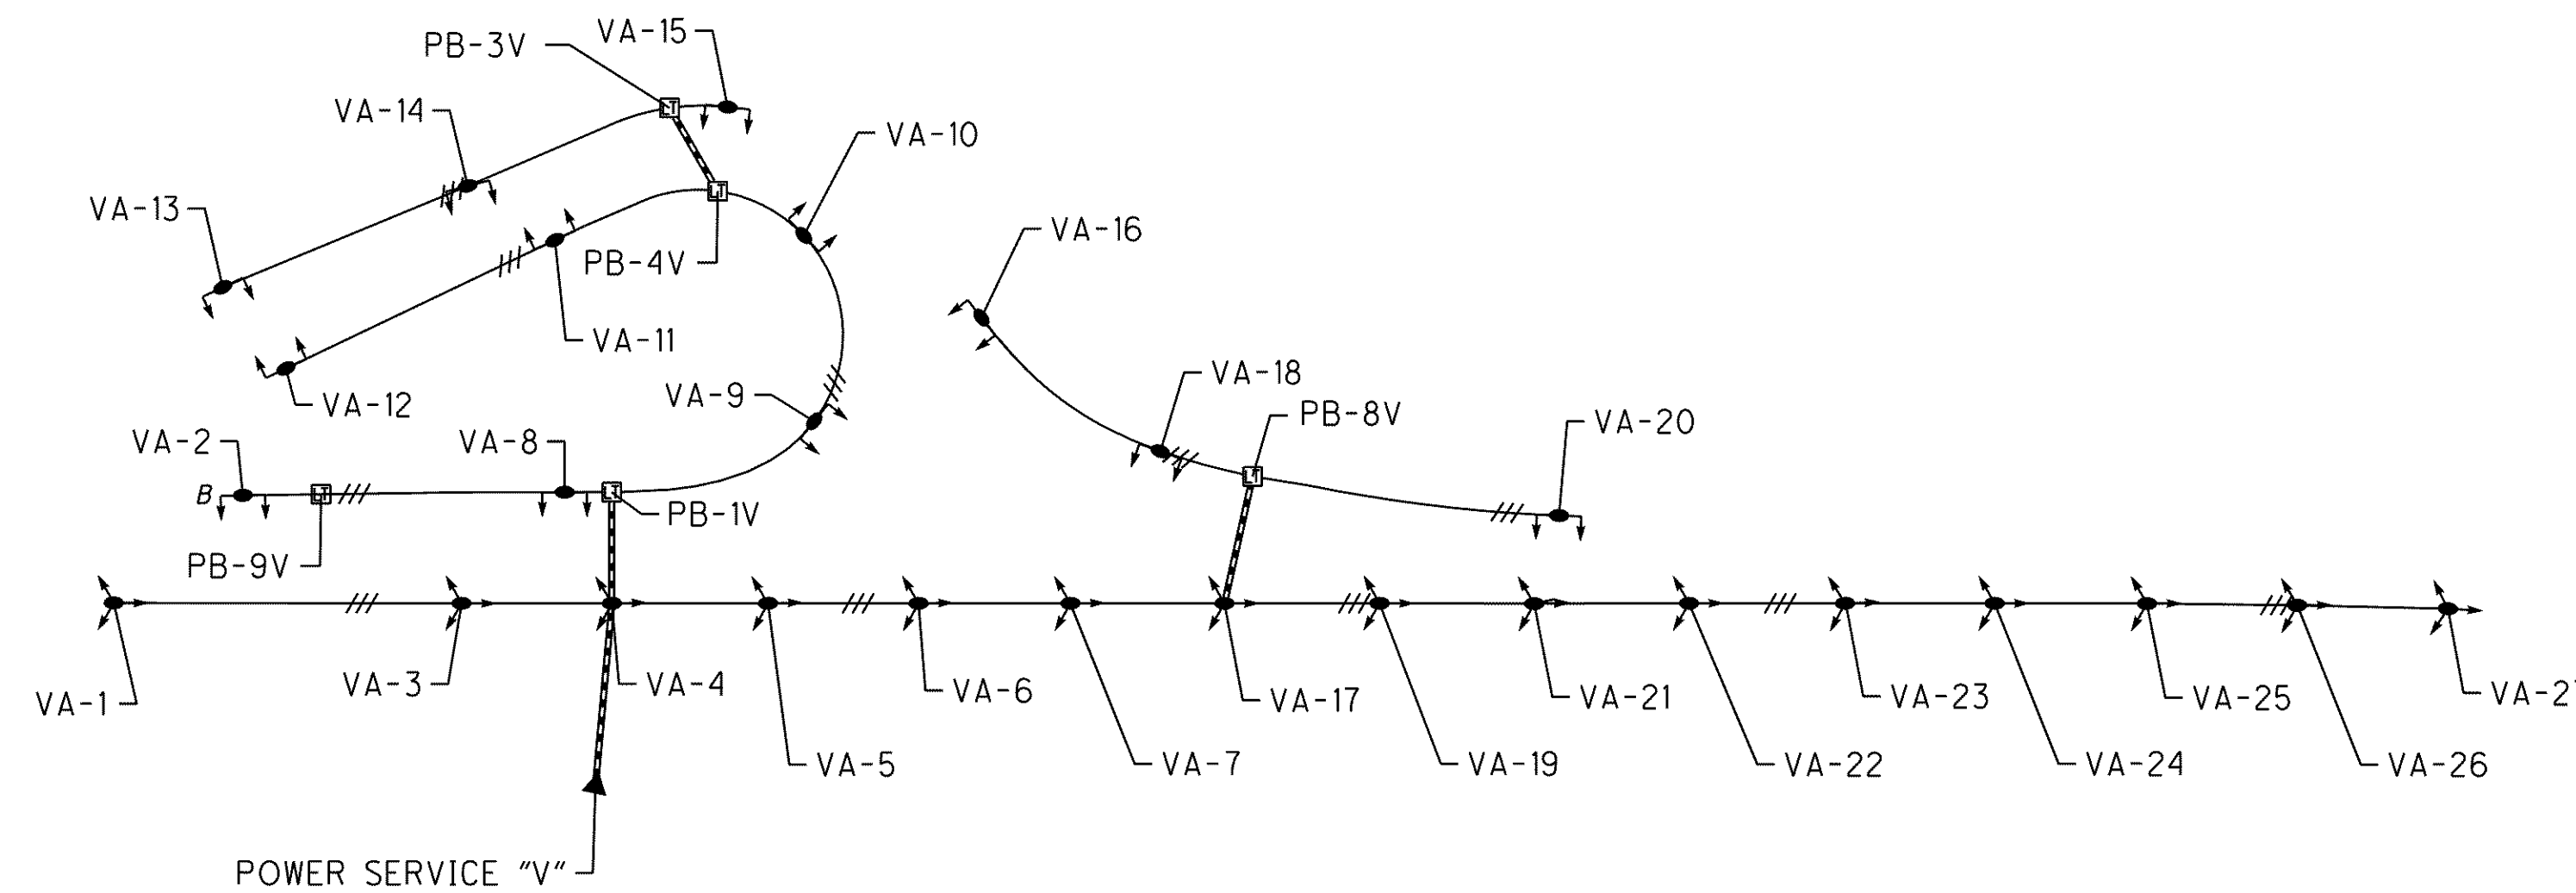

CIRCUIT A
POWER SERVICE "V"

g:\project\lak\13486\lighting\sheets\13486LC002.dgn 7/11/2008 8:44:21 AM dshaner

CALCULATED
JMS
CHECKED
ZFB

LIGHTING CIRCUIT DIAGRAMS
POWER SERVICE "V"

LAK - 2 - 3.32

1266
1679