


POWER SERVICE DATA											
POWER SERVICE	SERVICE VOLTAGE	LOAD (KVA)	SERVICE ENTRANCE CONDUCTORS (AWG)	MAIN DISCONNECT RATING (AMPS)	CIRCUIT No.	CIRCUIT LOAD (AMPS)	CIRCUIT BREAKER SIZE (AMPS)	CIRCUIT CONDUCTOR SIZE (AWG)	CONDUCTORS PER CIRCUIT	MAINTAINING AGENCY	MUNICIPALITY SERVED
L	480V, 1-PHASE	52.5	1/0	150	A	14.6	20	2	2 + GROUND	LAKE COUNTY ENGINEER	CITY OF WILLOUGHBY
					B	29.2	40	4			
					C	13.5	20	4			
					D	16.7	30	2			
					E	12.5	20	4			
					F	22.9	30	2			

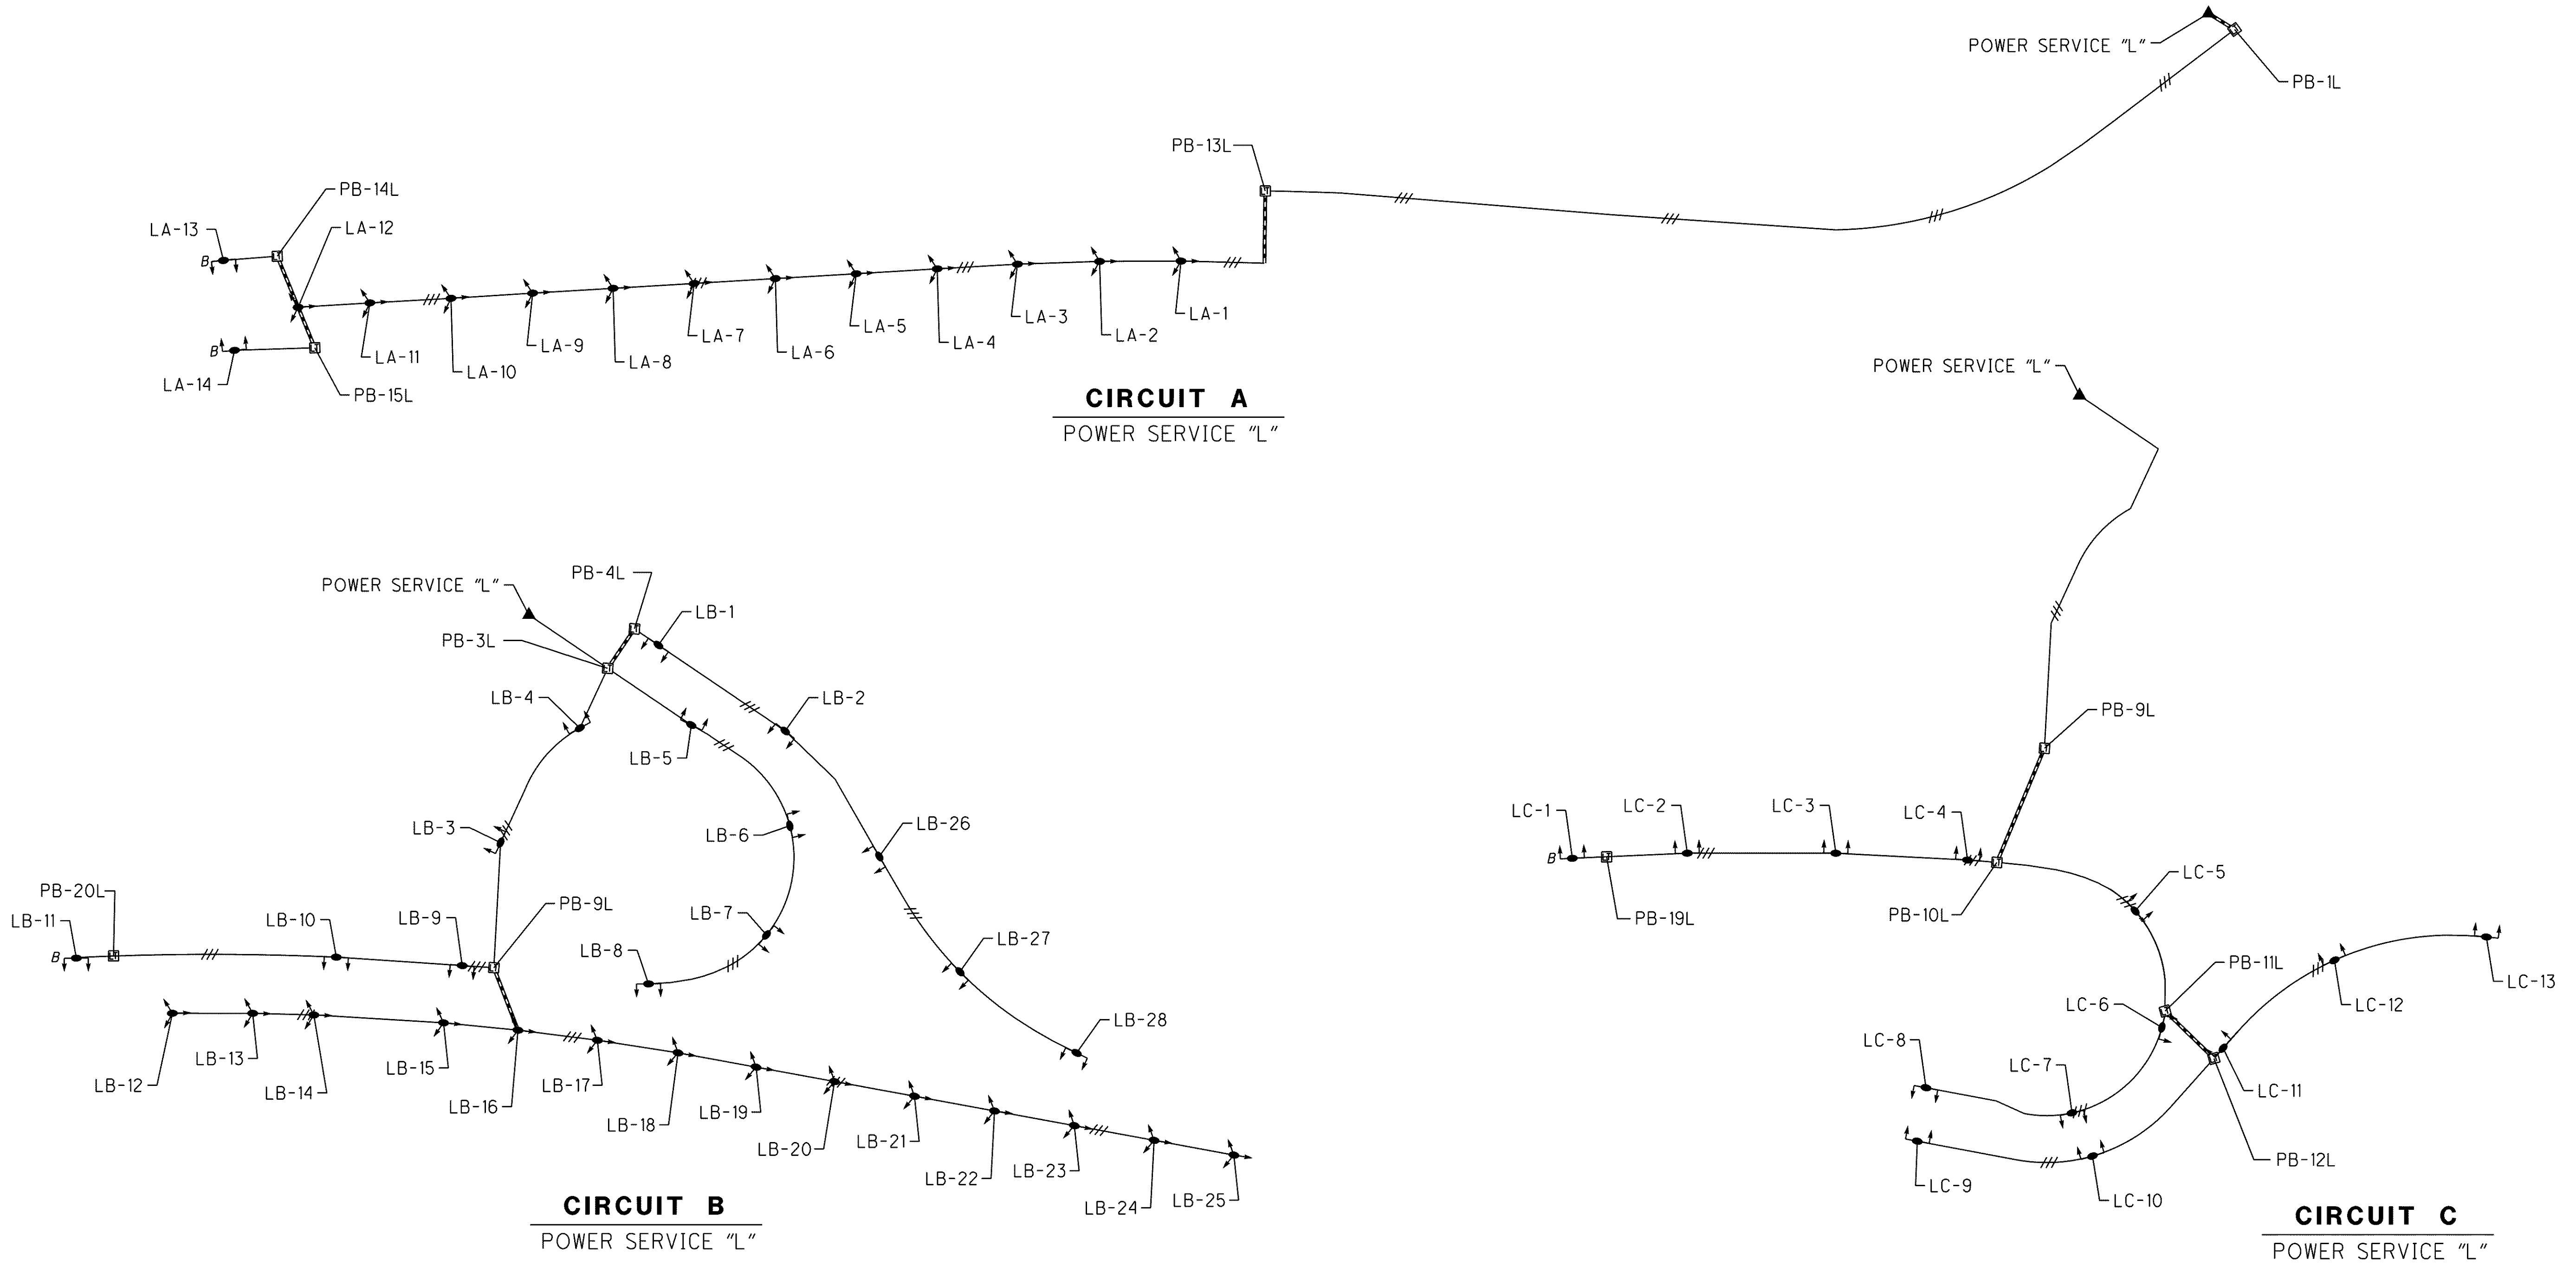

g:\project\lak\13486\lighting\sheets\13486LC004.dgn 7/11/2008 8:44:27 AM cshaner