



Power Service HR 37+00 Rt.
Circuit C

10 lights @ 400 Watts each	= 4000 W.
1 sign @ 175 " "	= 175 W.
1 sign @ 350 " "	= 350 W.
Total ballast loss	= 920 W.
Total Circuit Watts	= 5445 W.

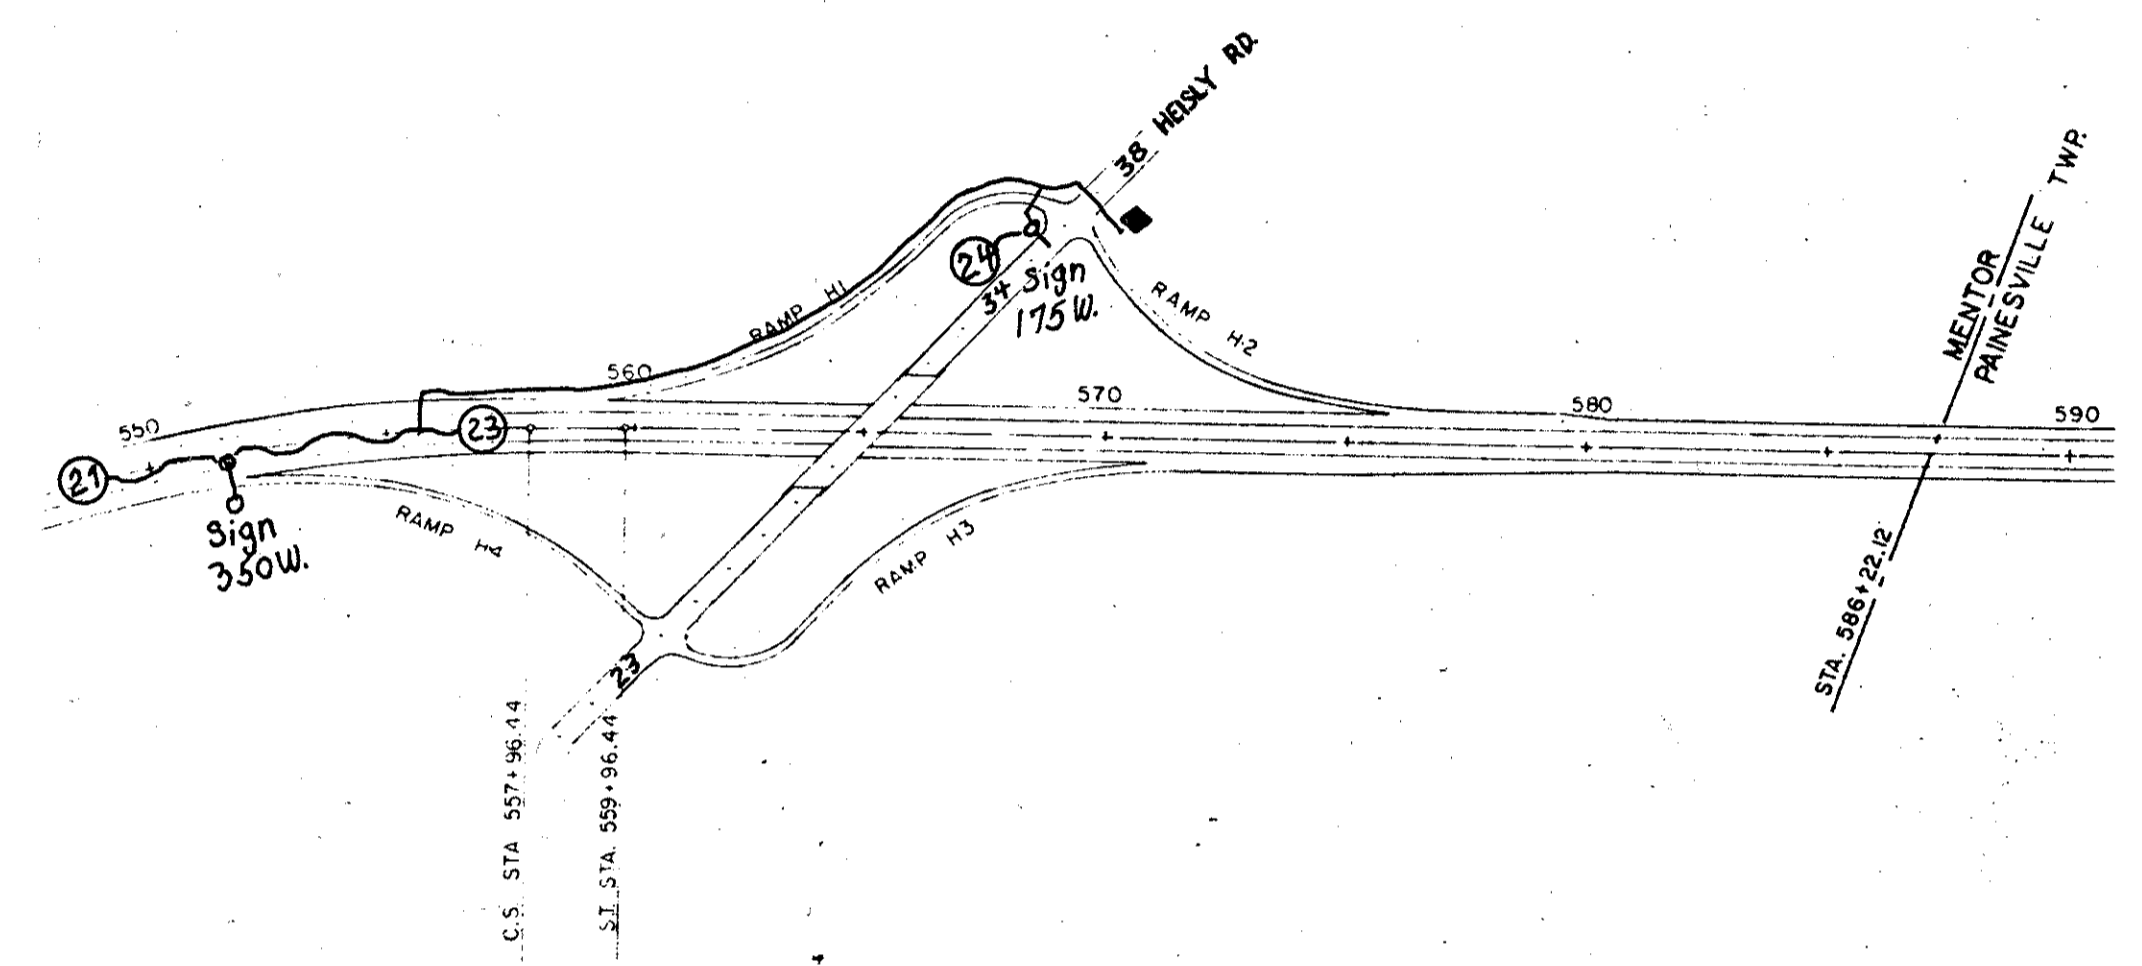

Power Service SOF 28+70 Lt.
Circuit E

20 lights @ 400 Watts each	= 8000 W.
4 signs @ 175 " "	= 700 W.
2 signs @ 100 " "	= 200 W.
Total ballast loss	= 1840 W.
Total Circuit Watts	= 10,740 W.

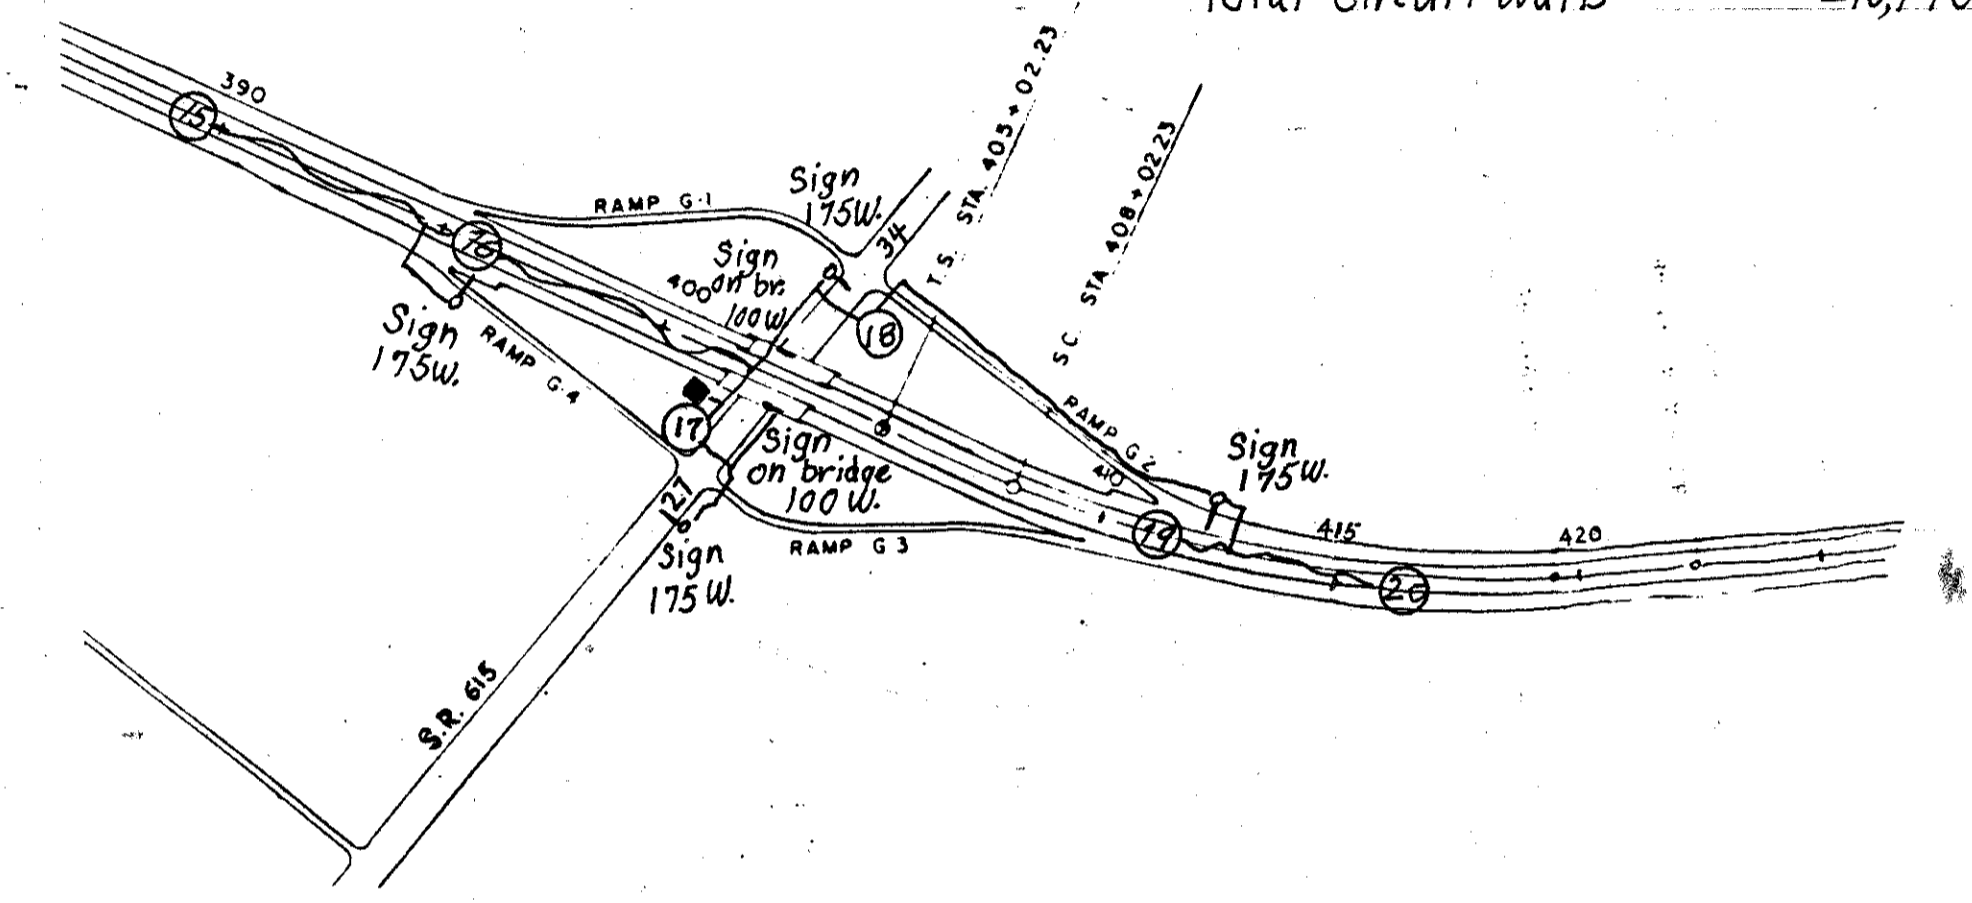

Power Service HR 37+00 Rt.
Circuit D

10 lights @ 400 Watts each	= 4000 W.
2 signs @ 175 Watts "	= 350 W.
Total ballast loss	= 880 W.
Total Circuit Watts	= 5230 W.

