

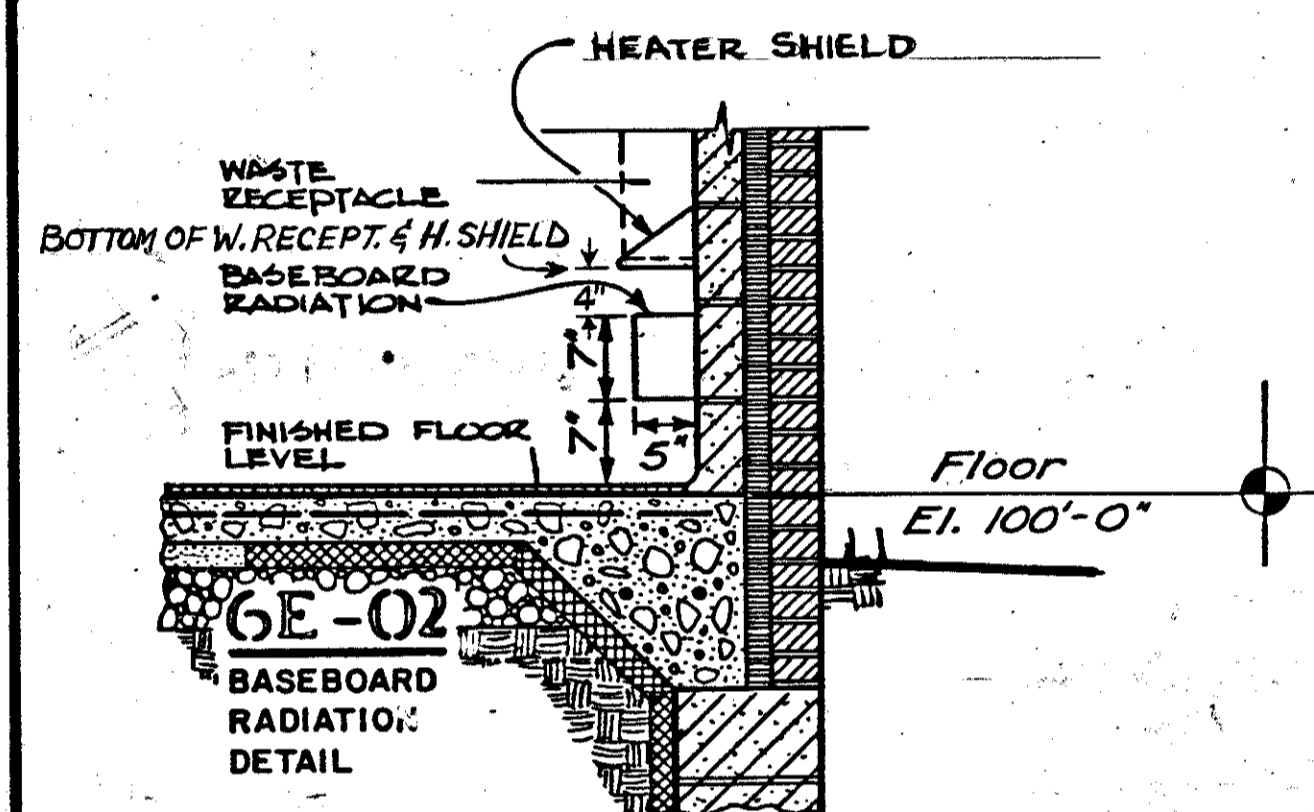
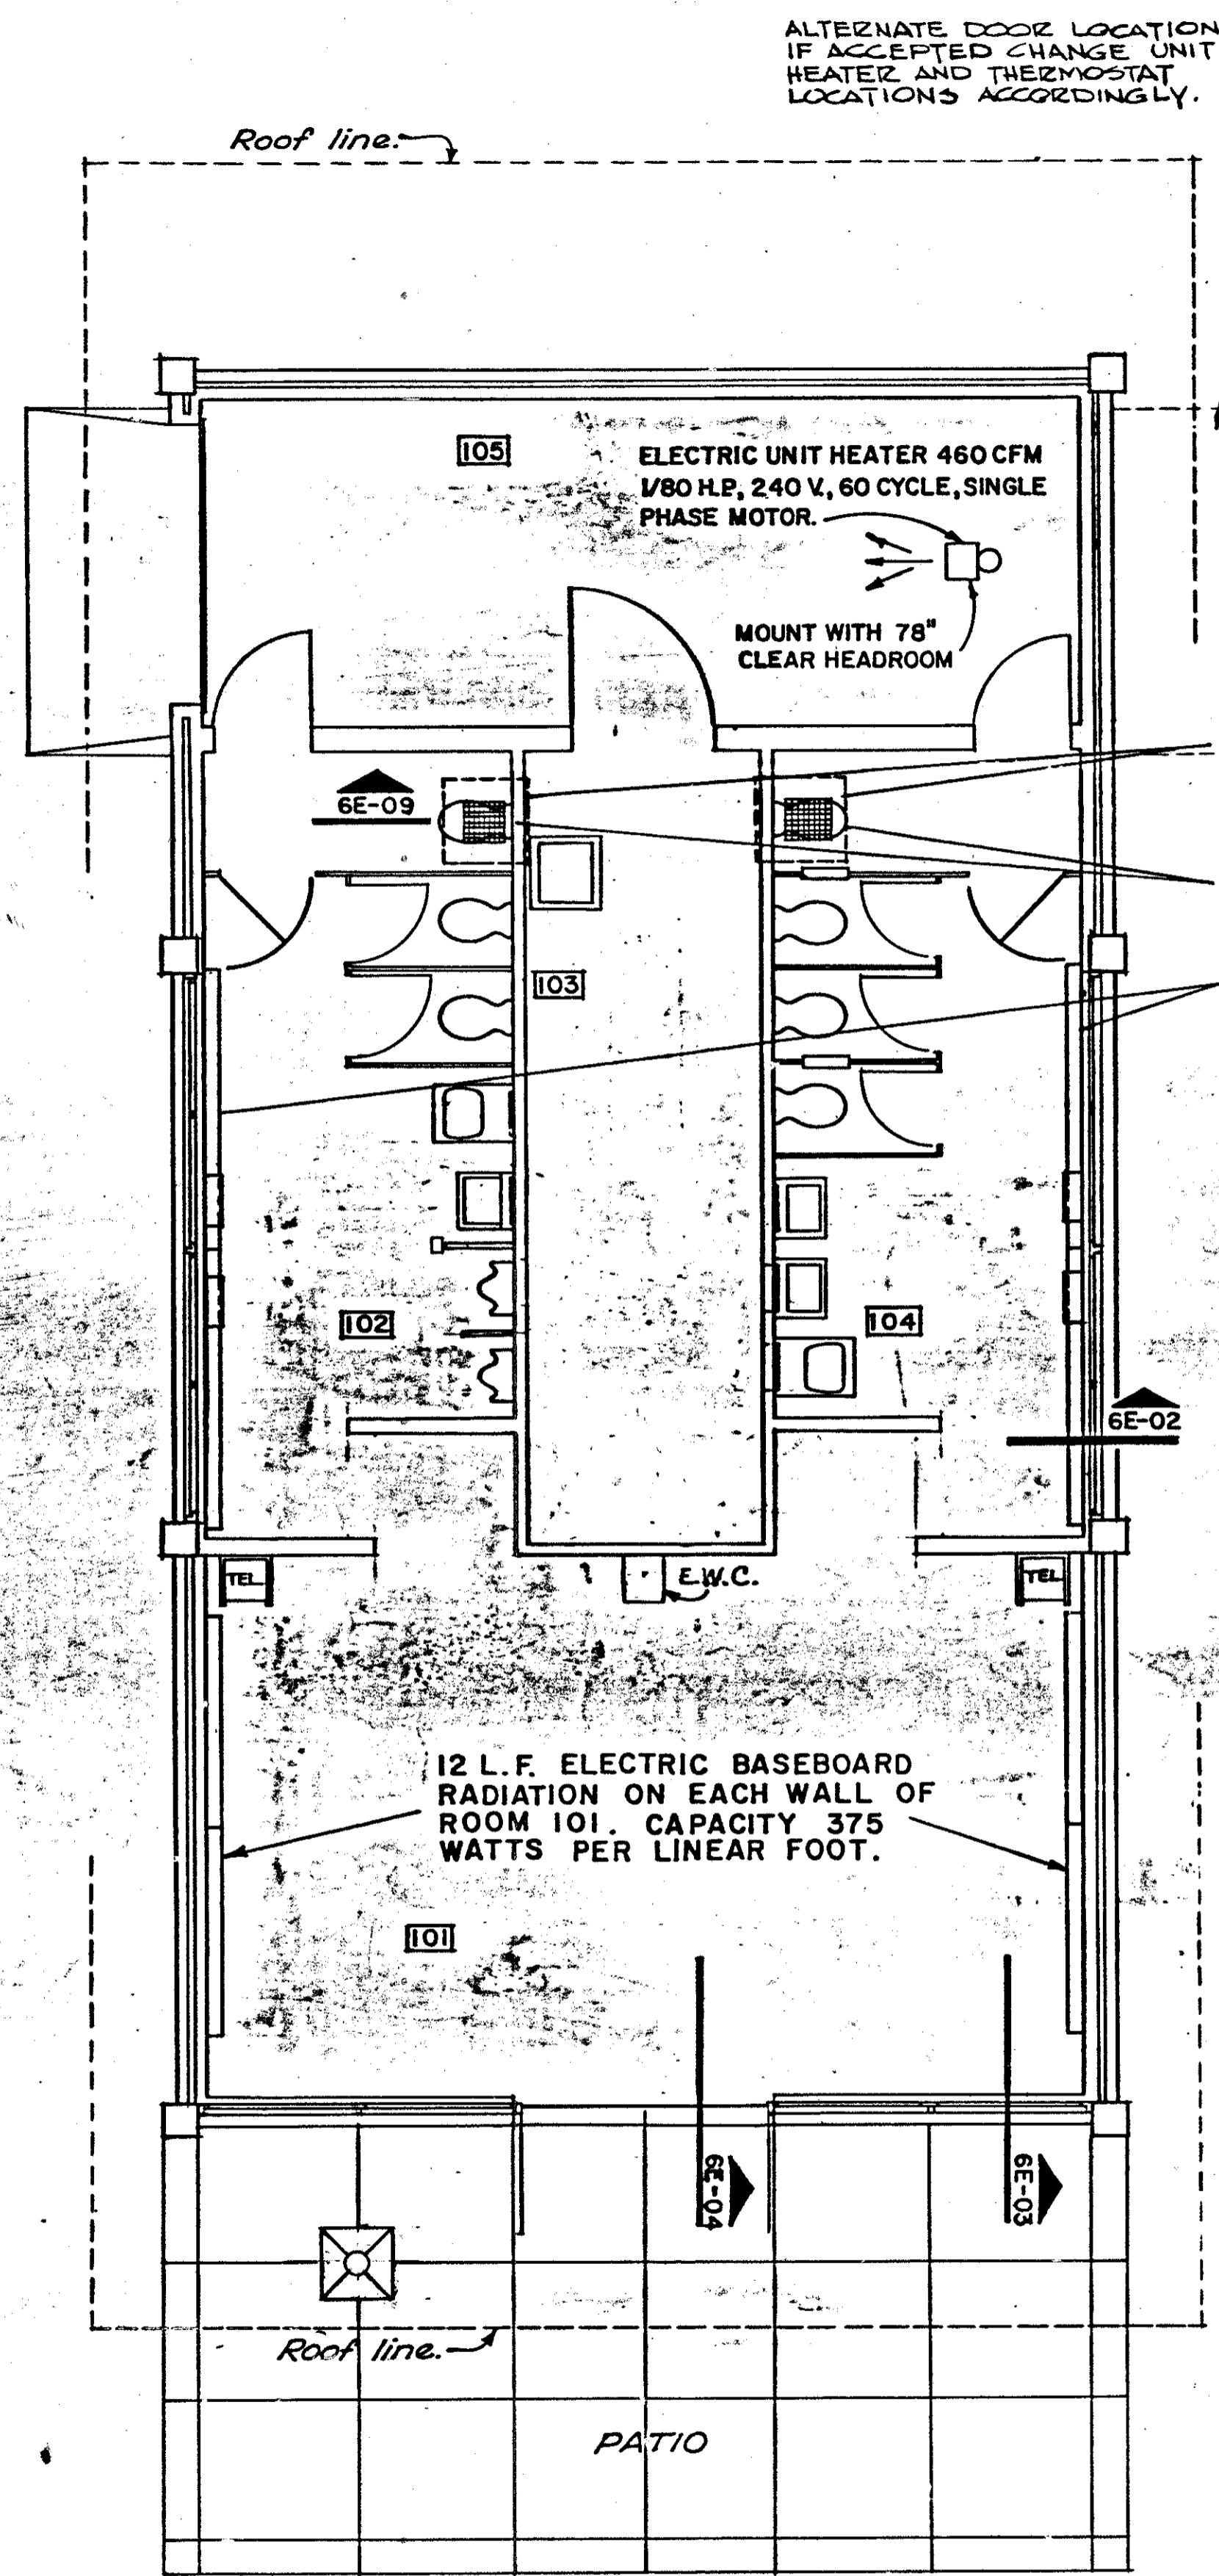


LAKE COUNTY  
LAK-90-11.90

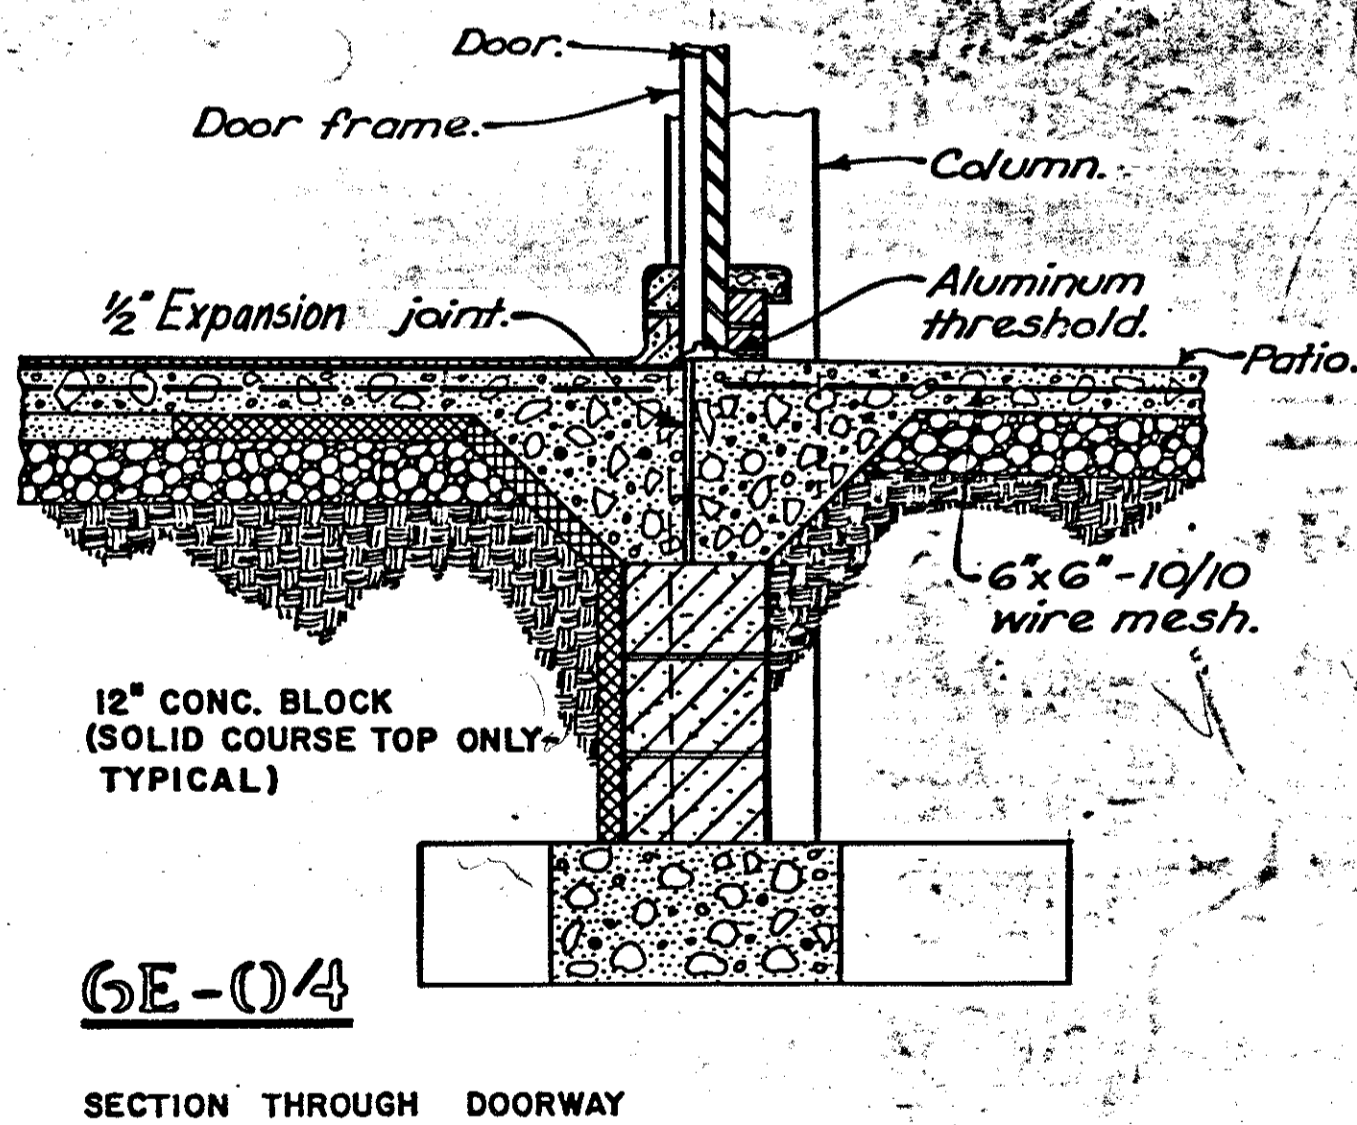

NOTE: For details not shown in 6E-02, 6E-03 & 6E-04, see 6B-05.

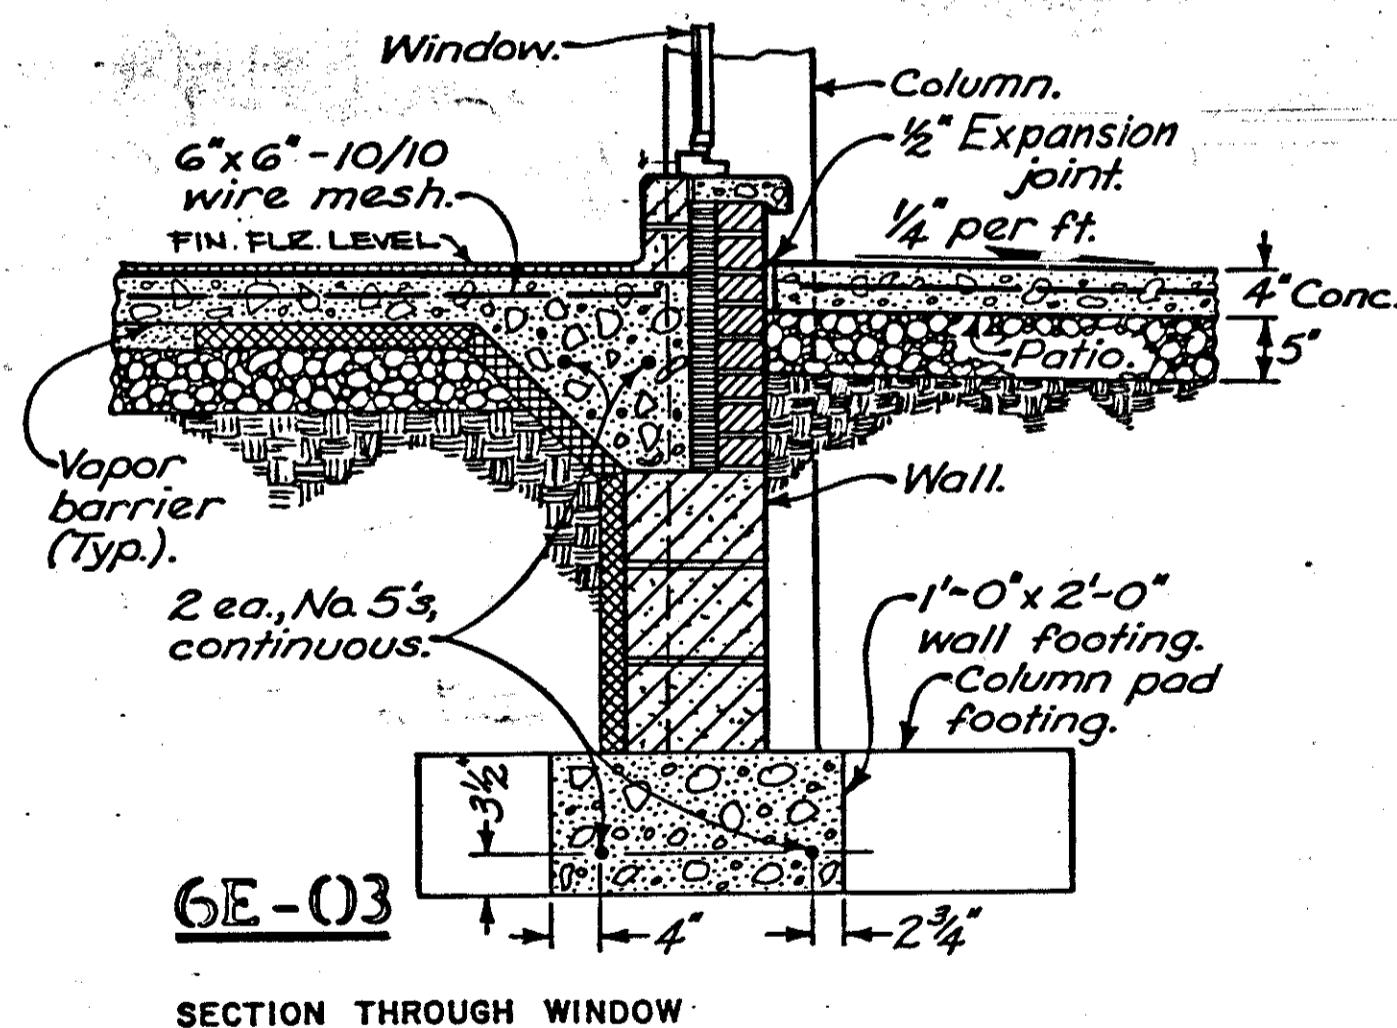


ALTERNATE DOOR LOCATION IF ACCEPTED CHANGE UNIT HEATER AND THERMOSTAT LOCATIONS ACCORDINGLY.

TWO EACH POWER ROOF VENTILATORS WITH PREFABRICATED SOUND CURBS. CAPACITY -410 CFM AT 1/4" S.P. AND 1/20 H.P. MOTOR EACH. SEE 6E-09

14"x14" CEILING MOUNTED EXHAUST GRILLS WITH 14"x14" DUCTS THROUGH DECK TO POWER ROOF VENTILATOR.


16 L.F. ELECTRIC BASEBOARD RADIATION FOR EACH OF TWO TOILET ROOMS. CAPACITY 625 WATTS PER LIN. FT.

14"x14" DUCT SECURE TO SOUND CONTROL CURBS

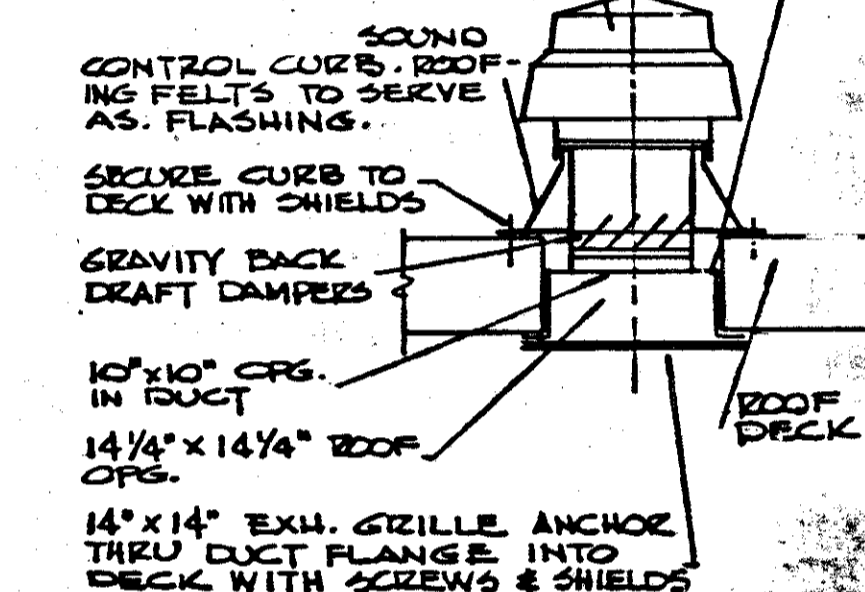

6E-09  
POWER ROOF VENTILATOR DETAIL  
RMS. 102 & 104  
3/4" = 1'-0"

NOTE:  
ALL HEATING UNITS SHALL HAVE BUILT-IN, VANDAL PROOF THERMOSTATS AS SPECIFIED

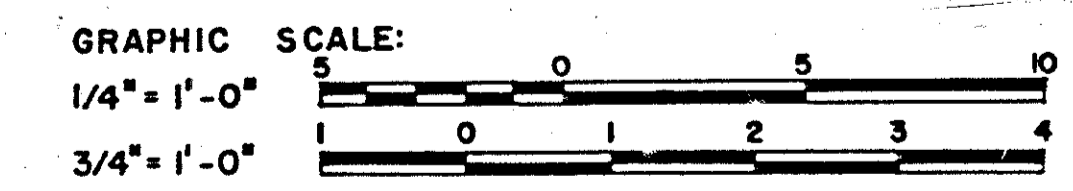

6E-06  
FLOOR PLAN HEATING AND VENTILATING  
1/4" = 1'-0"

OHIO BUREAU OF DESIGN SERVICES		SHEET NO. RRA 6E
DEPARTMENT OF TRANSPORTATION		
<b>MOTORIST SERVICES BUILDING &amp; STORAGE UNIT</b>		
REVISIONS 3-1-78 BY O.D.O.T. 7-6-78 1-22-80 2-11-81 12-18-81 10-13-82	PREPARED BY DEPARTMENT OF PUBLIC WORKS ASSOCIATE ARCHITECTS ADAMS, HARDER, KINGSLOE, KOCHER, SWEARINGEN	DATE 9-1-70

and 9/22/82