


4" AND 6" WATER MAINS SOUTH SIDE I-90

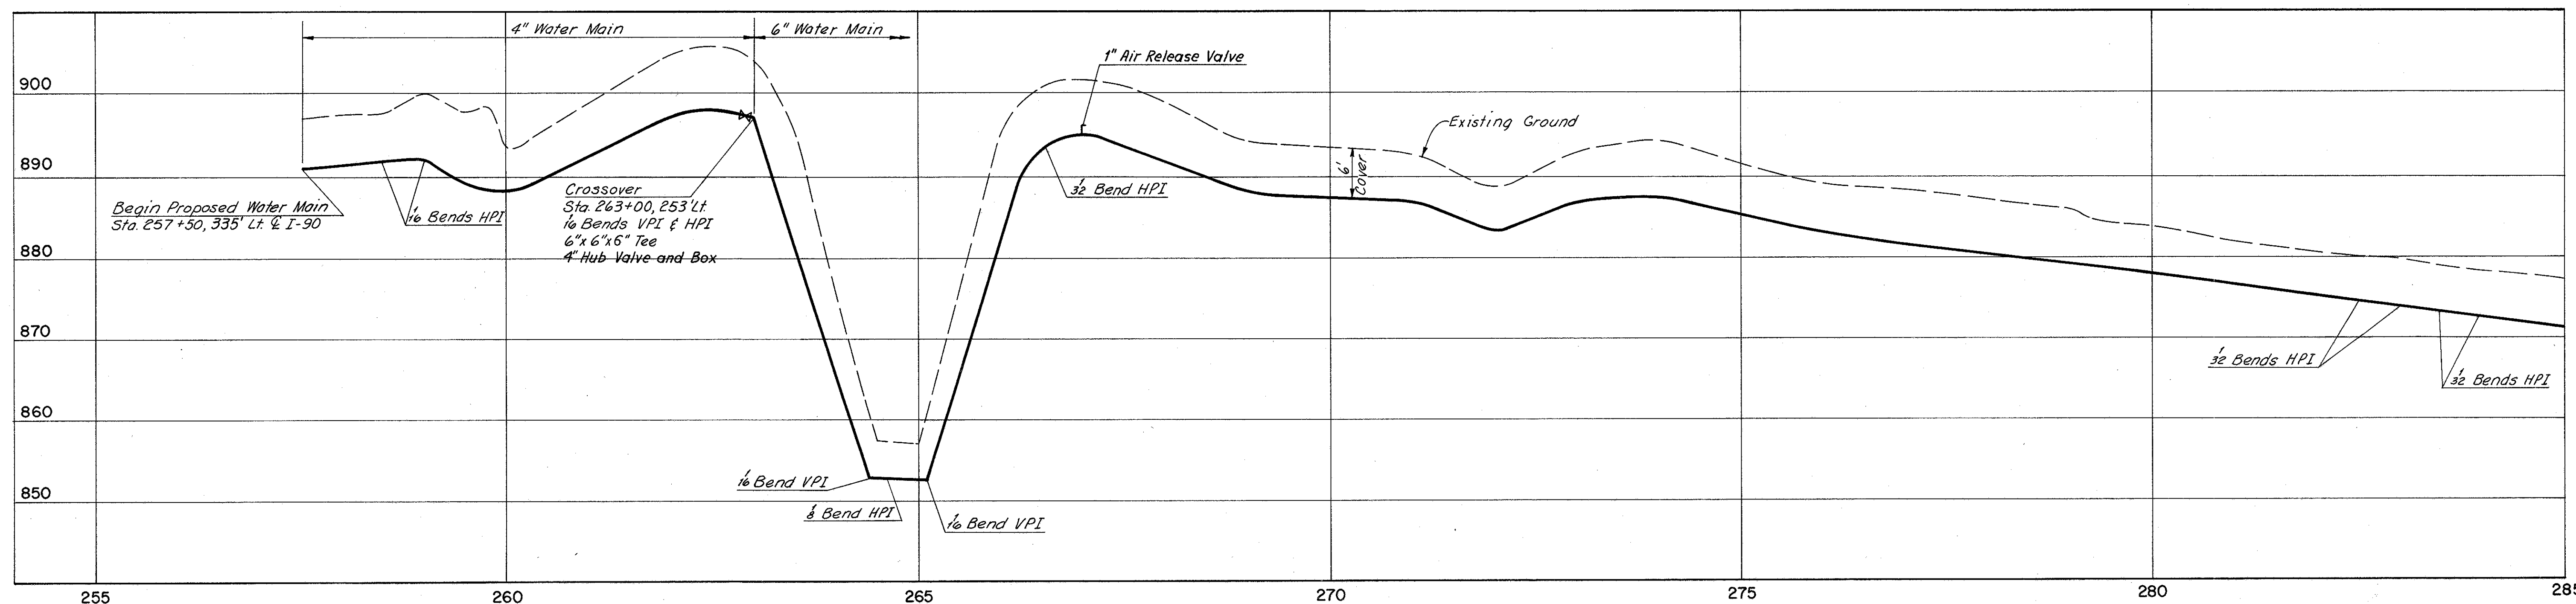

4" AND 6" WATER MAINS NORTH SIDE I-90

Note:
1. The normal cover over the water pipe shall be six (6) feet; the minimum cover shall be five (5) feet and the maximum eight (8) feet.
2. See Sheets 15 and 16 for water main location.
3. See Sheet 109 for crossover profile.