
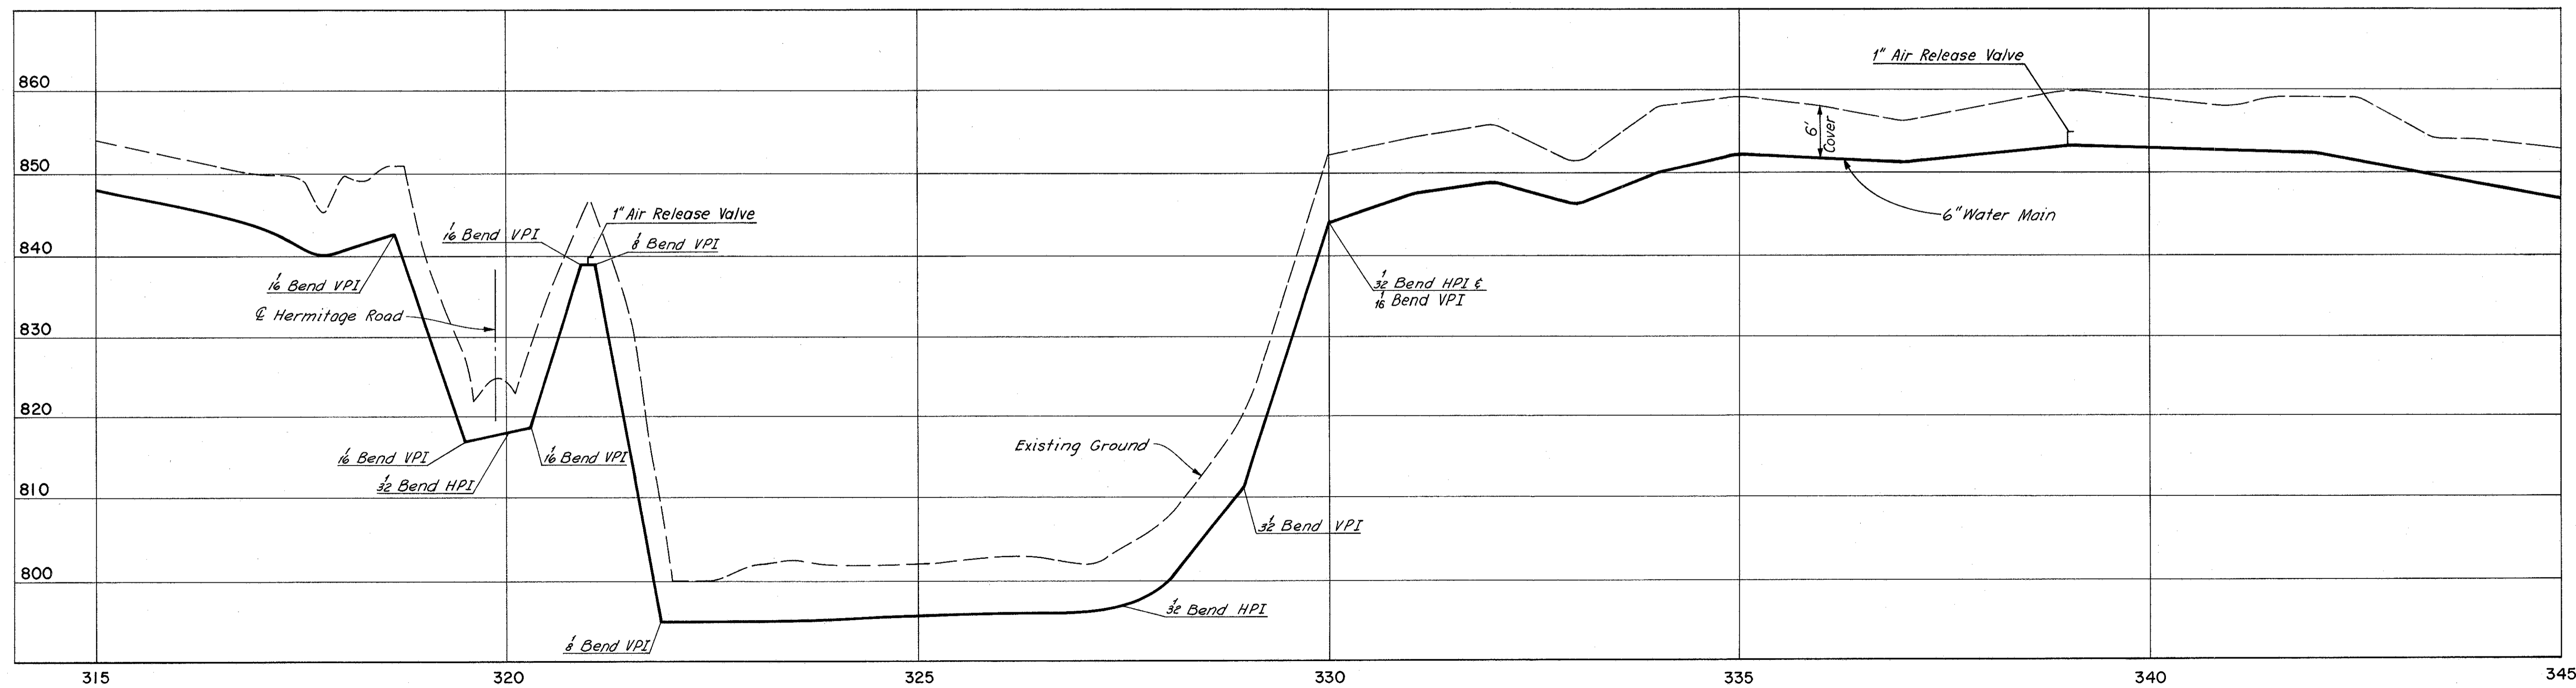


FED. RD. DIVISION	STATE	PROJECT	
2	OHIO		

108
III

LAKE COUNTY
LAK.-90-3.56

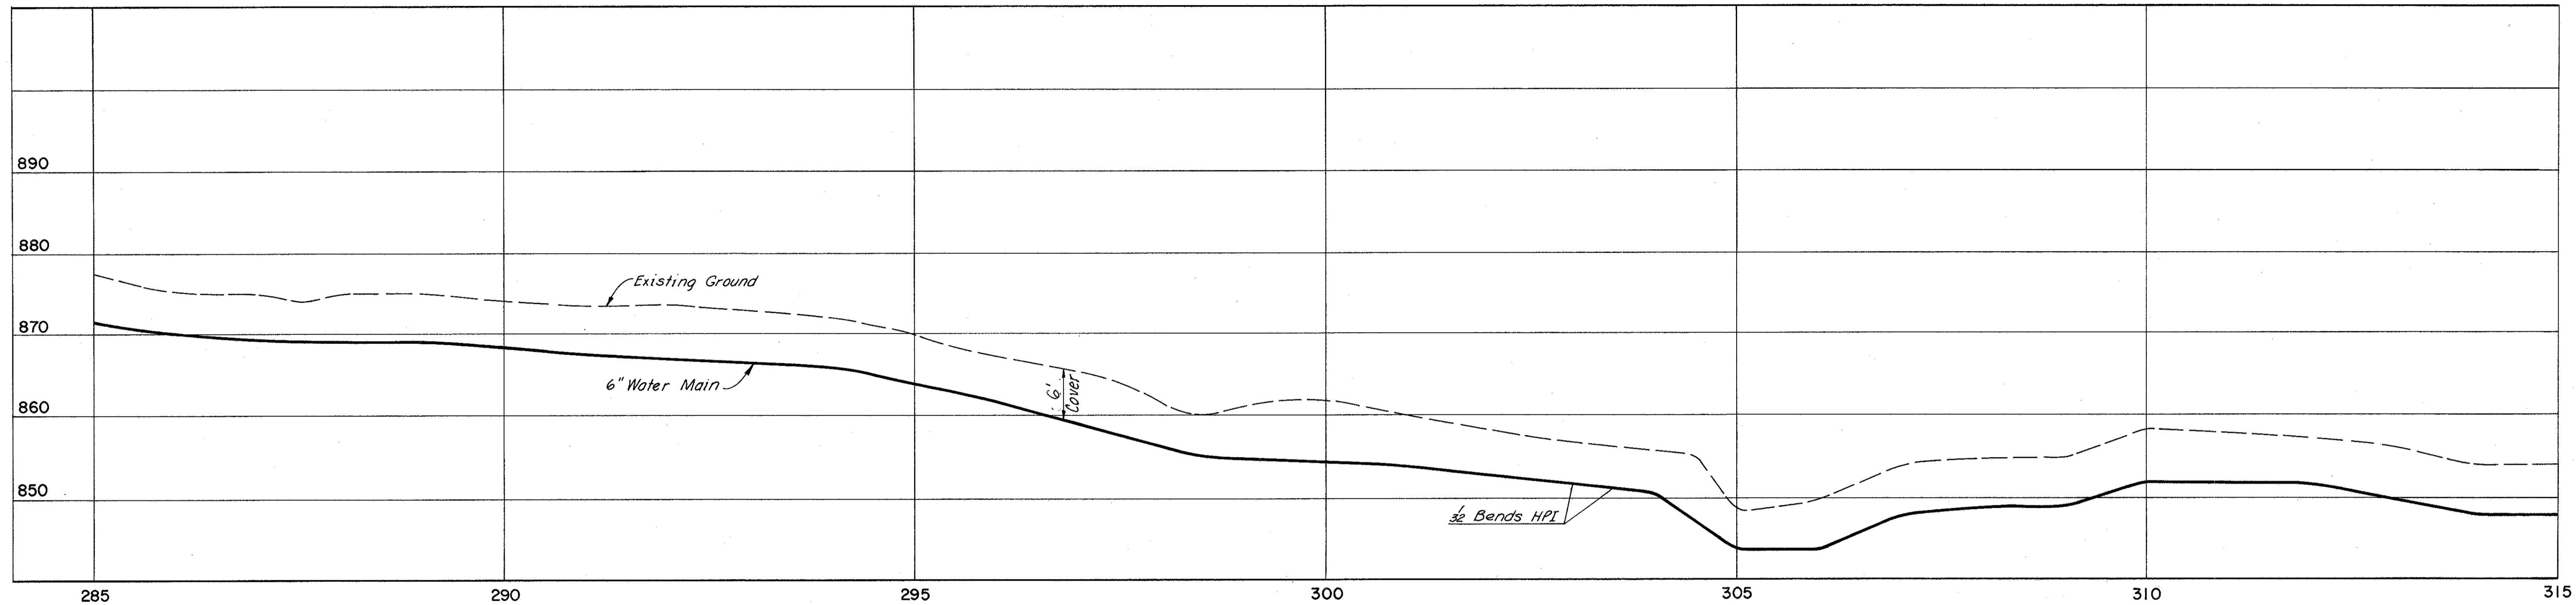

Note:
 1. The normal cover over the water pipe shall be six (6) feet; the minimum cover shall be five (5) feet and the maximum eight (8) feet.
 2. See Sheets 16 and 17 for water main location.

VERT. 1" = 10'
 SCALE HOR. 1" = 100'
HOWARD, NEEDLES, TAMMEN & BERGENDOFF
 MADE E.R.H. DATE 2-20-73 CONSULTING ENGINEERS
 TRCD J.M.C. DATE 2-22-73
 CKD E.R.H. DATE 6-21-73 KANSAS CITY CLEVELAND NEW YORK